


NATIONAL HEATING GUIDE



Blue Book of the Industry

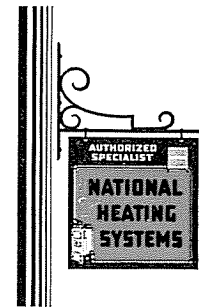


NATIONAL
RADIATOR
CORPORATION

General Offices - Johnstown, Pa.

Copyright 1930
National Radiator Corporation

NATIONAL SALES AND SERVICE

Serving . . .
The Heating Needs
of a Nation

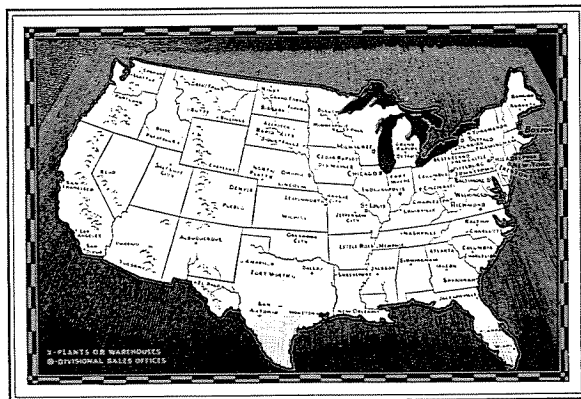

EMERGING constantly from eight great plants are steady streams of National products. Products in which science, skill, and unswerving standards are united to give to the world the latest and best in heating equipment.

Offered to the trade through distributing offices and warehouses located in leading cities, these products are backed by a quality of National service and cooperation that gives a new meaning to these terms.

With its outstanding products, and its helpful, intelligent service, The National Radiator Corporation competently and completely serves the heating needs of a Nation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL SALES AND SERVICE

National Service Through These Branch
Offices, Plants and Warehouses

| | | |
|--------------------|--------------------------------|--|
| BALTIMORE, MD. | Office and Warehouse | 2622 Matthews St. |
| BOSTON, MASS. | Office | 93-97 Oliver St. |
| | Warehouse | Framingham, Mass. |
| BUFFALO, N. Y. | Office | 259-265 Delaware Ave. |
| | Warehouse | Dunkirk, N. Y. |
| CHICAGO, ILL. | Office and Warehouse | 2445 N. Keeler Ave. |
| | Plant | 1111 E. 83rd St. |
| CINCINNATI, OHIO | Office and Warehouse | 3530 Spring Grove Ave. |
| CLEVELAND, OHIO | Office and Warehouse | 935 E. 63rd St. |
| DETROIT, MICH. | Office | Suite 903, Fisher Bldg. |
| DUNKIRK, N. Y. | Plant | Stelgeski St. |
| FRAMINGHAM, MASS. | Plant | Arlington St. |
| INDIANAPOLIS, IND. | Office and Warehouse | 431 W. Georgia St. |
| JOHNSTOWN, PA. | Office | 221 Central Ave. |
| | Plant | Bridge St. |
| | " | Central Ave. |
| MILWAUKEE, WIS. | Office and Warehouse | 2003 St. Paul Ave. |
| NEW CASTLE, PA. | Plant | Cascade Park |
| NEW YORK, N. Y. | Office | 55 W. 42nd St. |
| | Warehouses— | |
| | | 5 Commercial Avenue, Garden City, L. I. Bush Terminal, Bldg. No. 3, Brooklyn, N. Y. Lincoln Terminal, Bldg. No. 7, Kearny, N. J. |
| OMAHA, NEB. | Office and Warehouse | 1101 Jackson St. |
| PHILADELPHIA, PA. | Office | 508 Liberty Trust Bldg. |
| | Warehouses— | |
| | | E. State St. & Whitehead Rd., Trenton, N. J. Front St. & Lebanon Valley R. R., Reading, Pa. |
| PITTSBURGH, PA. | Office | 1509 Arrott Bldg. |
| | Warehouse | New Castle, Pa. |
| RICHMOND, VA. | Office and Warehouse | 3032 Norfolk St. |
| ST. LOUIS, MO. | Office and Warehouse | 1042 Central Industrial St. |
| TRENTON, N. J. | Plant | E. State St. & Whitehead Rd. |
| WASHINGTON, D. C. | Office and Warehouse | 2205 5th St., N. E. |

National Heating Accessories stocked at all warehouses.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL PRODUCTS INDEX

INDEX

NATIONAL BONDED BOILERS

| | |
|---|-----|
| National Offices, Plants and Warehouses..... | 3 |
| National Boiler Bond..... | 9 |
| National Bonded Jacketed Square Boilers..... | 16 |
| National Bonded Crimson Flame Boilers..... | 34 |
| National Bonded Round Boilers..... | 42 |
| National Bonded Contento Boilers..... | 52 |
| National Bonded Novus Sectional Boilers..... | 58 |
| National Bonded Imperial Sectional Boilers..... | 68 |
| National Bonded Super-Smokeless Boilers..... | 90 |
| National Bonded Low Water Line Boilers..... | 124 |
| National Hot Water Supply Boilers..... | 152 |
| National Bonded Oil Burning Boilers..... | 158 |

NATIONAL RADIATION

| | |
|--|-------------|
| National Aero Tube-Type Radiation..... | 172 |
| Three-Tube Aero Radiation..... | 176 |
| Four-Tube Aero Radiation..... | 178 |
| Five-Tube Aero Radiation..... | 180 |
| Six-Tube Aero Radiation..... | 182 |
| Seven-Tube Aero Radiation..... | 184 |
| Aero Radiation Pedestals..... | 184 |
| Legless Aero Radiation..... | 186 |
| National Panel Radiation..... | 210 and 187 |
| National Wall Radiation..... | 192 and 188 |
| National Aero Bathroom Radiator..... | 189 and 188 |
| Dimensions—Aero Tube-Type Radiation..... | 190 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL PRODUCTS INDEX

INDEX (continued)

| | |
|--|-------------|
| National Aero Wall Radiator..... | 188 and 192 |
| National Legless Radiator Hangers..... | 200 |
| National Wall Radiator Hangers..... | 202 |
| National Aero Prime Indirect Radiation..... | 204 |
| National Aero Pin Indirect Radiation..... | 205 |
| Directions for Ordering National Aero Wall Radiation..... | 207 |
| National Radiation Standard Tappings..... | 208 |
| National Panel Radiation..... | 187 and 210 |
| National Unit Heaters..... | 222 |

NATIONAL HEATING ACCESSORIES

| | |
|--|-----|
| National Sta-Pak Steam and Hot Water Radiator Valves..... | 234 |
| National Steam and Hot Water Radiator Valves... | 237 |
| National Radiator Valve Roughing-in Measurements..... | 239 |
| National Novus Automatic Air Valve..... | 240 |
| National Compression Air Valves..... | 240 |
| Dole Siphon Air Valves..... | 241 |
| National Marval Siphon Auto-Air Valves..... | 243 |
| Hoffman Venting and Thermostatic Valves..... | 244 |
| Hoffman Adjustable Modulating Valve..... | 249 |
| Hoffman Return Line Valves..... | 250 |
| Hoffman Damper Regulator..... | 253 |
| Hoffman Differential Loop..... | 254 |
| Hoffman Kompo-Gage..... | 256 |
| Hoffman Specialties—Group Assortments..... | 257 |
| Thrush System of Hot Water Heating..... | 259 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL PRODUCTS INDEX

INDEX (continued)

| | |
|---|-----|
| Thrush Dual-Control Unit..... | 263 |
| Galvanized Expansion Tanks and Brackets..... | 265 |
| Pop Safety Valves..... | 265 |
| Mueller System of Hot Water Heating..... | 266 |
| Jewell Temperature Regulators..... | 267 |
| Taco Heaters..... | 269 |
| Rotary Hack-Saw Tool..... | 274 |
| Naraco Steam and Hot Water Regulators..... | 275 |
| McDonnell and Miller Duplex Boiler Feeder..... | 277 |
| Regulating Valves, Steam and Gas..... | 278 |
| Empire Steam Traps..... | 278 |
| Arrow Hot Water Storage Tanks..... | 279 |
| Arrow Manholes, Handholds and Flanged Openings..... | 280 |
| National Floor and Ceiling Plates..... | 281 |
| National Hot Water Thermometers..... | 281 |
| National Steam and Altitude Gauges..... | 281 |
| National Expansion-Tank Brass Water Gauges..... | 283 |
| National Draw-Off Cocks..... | 283 |
| National Spud, Socket, and Nipple Wrenches..... | 284 |
| National Radiator and Boiler Brushes..... | 285 |
| National Bronze and Bronzing Liquid..... | 286 |
| National Black Asphaltum..... | 286 |
| National Solder-Seal and Se-Ment-Ol..... | 287 |
| National Vinco Cleaner..... | 287 |
| Rogaco Portable Electric Pipe Machine..... | 288 |

NATIONAL ENGINEERING DATA

| | |
|--------------------|-----|
| Section Index..... | 292 |
|--------------------|-----|

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

A New Force . . .

in the Selling of Heating Equipment

THE National Radiator Corporation realizes that the time has arrived when the heating trade is ready for a far reaching merchandising idea, which will allow its members to sell a Heating System, rather than boilers, pipes and radiators.

The time has arrived, in short, to sell National "Made-to-Measure" Heating Systems, scientifically designed to supply the latest and best in heating results.

National is the first to introduce such an unusual and original idea in the art of merchandising Heating Equipment. It is an idea that properly places the stress on results rather than on causes, and folks today are primarily interested in results.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

With the National "*Made-to-Measure*" Heating Systems was born an entirely new conception of what home heating can mean in health and happiness. Not only do these systems bring economy, dependability, convenience, and protection, but they *provide warmth to fit each individual room.*

Back of this idea is scientific engineering data, prepared especially for National, by eminent heating authorities. These data eliminate many complicated calculations and facilitate quick and accurate determination of correct radiation, boiler and other heating equipment requirements for the heating contractor. The installation operations of the heating contractor are further simplified by the convenient form in which the data are presented.

This revolutionary, new National "*Made-to-Measure*" idea so advances the science of modern heating that it is destined to open new fields of interest, and become a mighty force in the new-day methods of merchandising heating equipment.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL BOILER BOND

A Bond . . .

Guarantees National Boiler Performance and Quality

THE boiler properly has been called the heart of the heating system. For on the boiler alone rests the responsibility to economically convert fuel to heat, and set up a process of heat circulation to and through the room radiators. Conditions under which a boiler must perform its important tasks vary considerably and for this very reason the boiler should be selected with utmost care, both as regards character of design, and capacity. The first step to permanent satisfaction is the right boiler for the right job.

The bond, a miniature reproduction of which is shown on the following page, is issued by a strong financial institution with resources of over Thirty-Nine Million Dollars, (\$39,000,000.00). It contains four distinct guaranteed stipulations as to the performance, manufacture, testing and replacement of defective parts. It is absolute assurance to you and your customers that the boiler will deliver in actual practice what the manufacturer claims for it.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BOILER BOND

The Fidelity and Casualty Company of New York
92 Liberty Street, New York, N. Y.

Resources in Excess of Thirty-Nine Million Dollars

Know All Men by These Presents That we, the National Radiator Corporation, a Delaware Corporation with offices in New York, N. Y., as Principal, and The Fidelity and Casualty Company of New York, a Corporation organized under the laws of the State of New York as Surety, are held and firmly bound for the period of one year from _____ 19____ to _____ of _____ for the faithful performance of the Agreements listed below.

Provided however that the obligation of The Fidelity and Casualty Company of New York as surety and guarantor hereunder for the faithful performance by the National Radiator Corporation of the agreements set forth herein shall not exceed the sum of _____

Blank Hundred and Blank Dollars

The Agreements apply to National Bonded Boiler No. _____, purchased _____ 19____ from _____ and are as follows, to wit:

1. In the event that any or all of the following representations contained in paragraph (a) below are shown to be incorrect or untrue at any time during the period above mentioned, then, in that event, to furnish, without charge, a new boiler of the same type and capacity which meets the representations set forth.
- (a) That the National Boiler covered by this Bond was manufactured and hydrostatically tested in accordance with the Code of the American Society of Mechanical Engineers covering the construction of Low Pressure Heating Boilers, and is so marked; also that all fittings and appliances furnished as standard equipment by the manufacturer are in accordance with the said Code.
2. In the event that an original manufacturing defect develops within one year from date of installation, then, in that event, to furnish a new replacement part, without charge, provided such defective part is returned to the nearest plant or warehouse of the National Radiator Corporation. (This does not cover breakage or damage due to rough handling or abuse.)
3. In the event that the boiler fails to deliver the capacity necessary to carry the direct cast iron radiation load published on the manufacturer's catalog current at the time of sale, and, provided the boiler has been installed under the manufacturer's specified requirements, is connected to a correctly installed system and chimney having proper draft, and is operated in accordance with the manufacturer's printed instructions, then, in that event, to furnish, without charge, additional boiler parts necessary to meet the required boiler capacity.

NATIONAL RADIATOR CORPORATION

Number _____ By _____
Date _____ *The Fidelity and Casualty Company of New York*
Counter-signed by _____
By _____
From L. S. 22-5234-4-1932

Facsimile of Surety Bond issued with each National Bonded Boiler

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BOILER BOND

The bonds are issued in different denominations, and the amounts will fully cover the purchase price of the boiler, regardless of size.

In order to remove any uncertainty regarding the amount of direct cast iron radiation which each National Bonded Boiler is guaranteed to heat, we list herein net radiator loads under the heading "Bonded Direct Cast Iron Radiation." This makes the selection of the proper boiler size a sure and simple matter. An allowance for normal piping is included in the bonded load.

Each National Bonded Boiler is guaranteed to heat the full amount of direct cast iron radiation listed in its rating table when connected to a properly installed system, in accordance with specified requirements listed herein.

MANUFACTURER'S SPECIFIED REQUIREMENTS

1. *Determining Direct Cast Iron Radiation Requirements:* Reduce all required types of radiation surfaces to an equivalent direct cast iron radiation basis. This basis being that one square foot of direct cast iron steam radiation will emit 240 B.T.U. per hour, and that one square foot of hot water radiation will emit 150 B.T.U. per hour.

2. *Corrections Applying:* Under ordinary conditions, the following factors may be used to convert the following surfaces to an Equivalent Direct Cast Iron Radiation basis:

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BOILER BOND

- Direct—Indirect Radiation, multiply by 1.25
- Indirect, multiply by 1.5
- Blast coils; use manufacturer's condensation chart and multiply condensation in pounds of steam per hour by 4.0
- Domestic Hot Water Supply. When coil in fire box is used, and small quantity of water is to be heated, multiply storage tank capacity in gallons—
 - for steam by 2.0
 - for water by 3.0

If large quantities of water are to be heated, or indirect heaters are connected to the boiler, the radiator load should be computed as outlined in the Engineering Section of the National Heating Guide, page 364 and page 371.

3. *Radiation Requirements:* The amount of radiation required to properly heat a building to the specified temperature is to be determined by using the method outlined in the National Heating Guide, current at the time the boiler is sold, or in accordance with the methods adopted by the Heating and Piping Contractors National Association, or the American Society of Heating and Ventilating Engineers, and in current use by them.

4. *Piping and Peak Load Allowances:* The published Direct Cast Iron Radiation Loads listed herein include allowances for heat losses from piping and peak

NATIONAL BOILER BOND

loads under ordinary conditions. If the actual surface in square feet of piping exceeds 25% of the Direct Cast Iron Radiation for steam, or 35% for water, additional allowances must be made for the extra surface. (See table in Engineering Section, Page 361 of the National Heating Guide showing the square feet of surface per lineal foot of pipe of various sizes.

5. *Draft:* The chimney to which the boiler is connected must be of recognized standard construction and dimensions, and provide sufficient draft to properly consume the required amount of fuel per hour.

6. *Fuel:* The Direct Cast Iron Radiation Loads listed herein are based upon the use of a free burning coal not smaller than nut size, and having a B.T.U. heat content per pound of at least 12,500. If coal having a less heat value is used, obviously more coal must be burned to get the same result, and more boiler capacity is required. Multiply the Equivalent Direct Cast Iron Radiation Load by the factor shown below, for coal having a heat value of less than 12,500 B.T.U.

| Heat Value of Coal in B.T.U. per Pound | Factor |
|---|--------|
| 12,500 | 1.00 |
| 12,000 | 1.07 |
| 11,500 | 1.13 |
| 11,000 | 1.21 |
| 10,500 | 1.28 |
| 10,000 | 1.36 |
| 9,500 | 1.46 |
| 9,000 | 1.56 |
| 8,500 | 1.67 |



NATIONAL BOILER BOND

Example: Direct Cast Iron Radiation Load, 430 sq. ft; coal to be used has heat value of 10,500 B.T.U. The corresponding factor as shown on page 13 is 1.28. Multiply 430 by 1.28, equals 550. Select a boiler with a Bonded Direct Cast Iron Radiation Load of not less than 550 sq. ft.

7. *Oil Burners:* If an oil burner is used, the burner must be properly installed and have a minimum capacity to burn each hour, with proper combustion, a quantity of oil containing 480 B.T.U. for each square foot of steam radiation and 300 B.T.U. for each square foot of water radiation. Direct Cast Iron Radiation Ratings for oil burning boilers are listed separately.

8. *Cleaning:* Oil, grease and foreign matter must be removed from the boiler and system by proper methods as outlined in Erecting Instructions furnished with each boiler.

9. *Operation:* Instructions for coaling and proper operation are furnished with each boiler, and the boiler must be operated in accordance therewith in order to come under the terms of this guarantee.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL BONDED BOILERS



NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

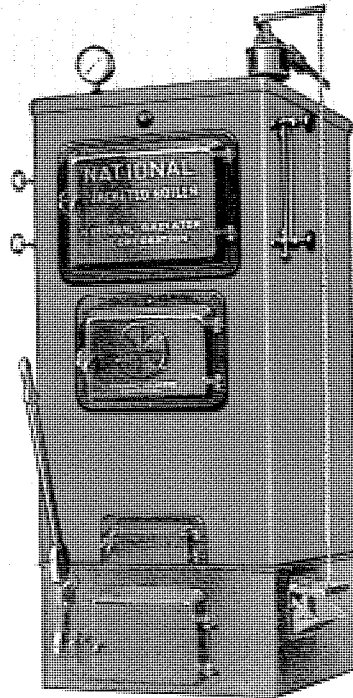

National No. 2-S-6

NATIONAL Jacketed Boilers are carefully made and thoroughly tested under a hydrostatic pressure more than four times normal. This rigid test eliminates trouble from leaks and assures care-free operation.

The No. 2 Series illustrated above is made in five sizes and is bonded to heat from 200 to 560 square feet of steam radiation or from 330 to 930 square feet of water radiation. Complete data and dimensions are given on pages 20 and 21.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Excellent . . .

**first impressions
reinforced on acquaintance**


ARCHITECT, engineer, heating contractor, user—all find in the National Jacketed Boiler common ground on which to meet; find many uncommon virtues to praise. Each boiler is designed in strict accord with the most advanced engineering principles. Ease of installation, economy of operation, and sound, dependable performance are the ends sought and attained.

Invariably the National Jacketed Boiler makes an excellent first impression, wins admirers at sight. Its splendid lines and balanced proportions, its attractive baked enamel finish, its harmoniously contrasting base and doors, set new standards of boiler beauty. This excellent first impression is reinforced on acquaintance with the unit's outstanding excellence in performance.

The accessories are of the highest quality. Those furnished as standard equipment on steam boilers include a sensitive all-metal, all-inclosed damper-regulator, that adjusts the drafts, maintaining a constant pressure automatically; a Bourdon-tube retard steam gauge, with water seal and non-glare dial; an A. S. M. E. standard pop safety valve; a water glass; two tri-cocks; and firing tools. Water equipment comprises an altitude gauge, thermometer, firing tools and a water temperature regulator, which automatically regulates the drafts.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

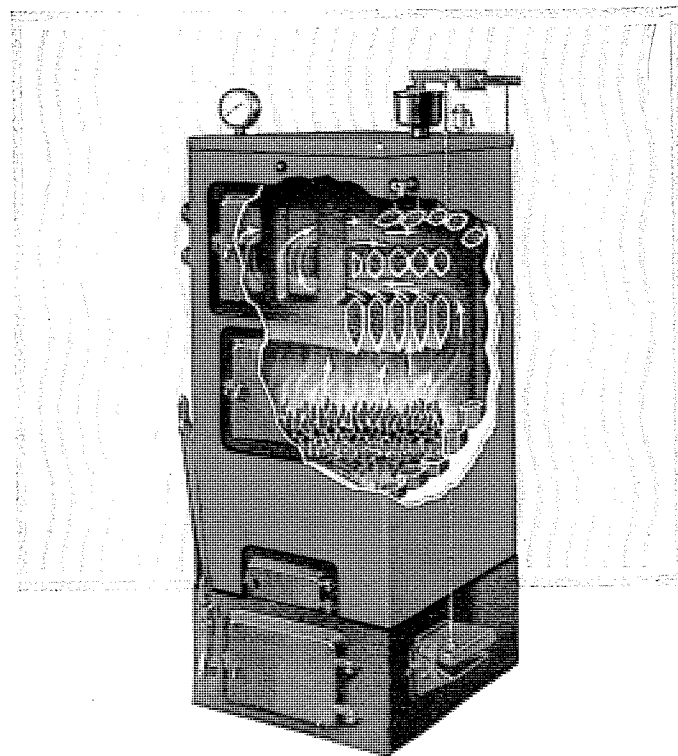

National No. 2-S-6 Interior View

NOTE how the burning gases, after they leave the firebox, travel upward into the first flue gallery, then forward, up, and back through the second flue gallery. This double set of three flue galleries is formed by numerous water tubes, within which the water circulates very rapidly, absorbing the heat and rushing it up to the radiators. This construction makes the boiler especially well adapted for use with oil burners—a field in which it enjoys an enviable reputation.

Complete data and dimensions are given on pages 20 and 21.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Designed . . .

with care and so
used with confidence

THE large fire box of the National Jacketed Boiler (its size is in striking contrast to those of similarly rated boilers) holds a heavy charge of fuel, making frequent attention unnecessary. Even with the fire box filled for an unusually long firing period, there is ample space between the top of the fuel and the crown sheet for proper and efficient combustion. This means that the gases distilled from the coal are burned at extremely high temperatures. If there is insufficient combustion space, the gases go up the chimney unconsumed; the coal is "burned" to ashes, but at a relatively low temperature, due to improper combustion of the gases.

The large cleanout doors at the top of the boiler expose all flue-ways for easy cleaning, and the boilers can, therefore, be operated at highest efficiency at all times.


Due to the scientific proportioning of the combustion chamber, arrangement of the heating surfaces and rapid circulation of the water within the boiler, National Jacketed Boilers are very rapid heaters. They have quick pick-up, a feature much appreciated when it is desired to quickly raise the temperature of the rooms, on cold winter mornings.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Series No. 2 Sizes and Ratings

For Steam, Vapor and Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Size Inches | Height Feet |
| Steam | | | | | | | | |
| 2-S-4 | 400 | 200 | 1.5 | 131 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-S-5 | 575 | 290 | 2.0 | 175 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-S-6 | 750 | 380 | 2.5 | 219 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-S-7 | 925 | 470 | 3.0 | 262 | 2-2 1/2" | 2-2 1/2" | 8 x 12 | 35 |
| 2-S-8 | 1100 | 560 | 3.5 | 306 | 3-2 1/2" | 3-2 1/2" | 8 x 12 | 35 |
| Water | | | | | | | | |
| 2-W-4 | 675 | 330 | 1.5 | 131 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-W-5 | 950 | 480 | 2.0 | 175 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-W-6 | 1250 | 630 | 2.5 | 219 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| 2-W-7 | 1550 | 780 | 3.0 | 262 | 2-2 1/2" | 2-2 1/2" | 8 x 12 | 35 |
| 2-W-8 | 1850 | 930 | 3.5 | 305 | 3-2 1/2" | 3-2 1/2" | 8 x 12 | 35 |

Standard Assembly of Boiler Sections

F—Front; I—Intermediate plain; U—Next to front uptake, plain; T°—Intermediate supply outlet, no return inlet; R°—Intermediate supply outlet, one return inlet on right side; B—Back, two return inlets.


| Boiler Numbers | Arrangement of Sections | | | | | | | | | Shaking Grates |
|----------------|-------------------------|---|----|----|----|----|---|----|---|----------------|
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | |
| 2-S-4 | 2-W-4 | F | T° | T° | B | | | | | 3 |
| 2-S-5 | 2-W-5 | F | T° | I | T° | B | | | | 4 |
| 2-S-6 | 2-W-6 | F | I | T° | I | T° | | | | 5 |
| 2-S-7 | 2-W-7 | F | U | T° | I | T° | I | B | | 6 |
| 2-S-8 | 2-W-8 | F | U | T° | I | R° | I | T° | B | 7 |

Supply Outlet Tappings: (°) after key letter indicates section has supply outlet tapping. Center to center distance between sections is 4 1/4 inches.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Series No. 2—Steam and Water Dimensions

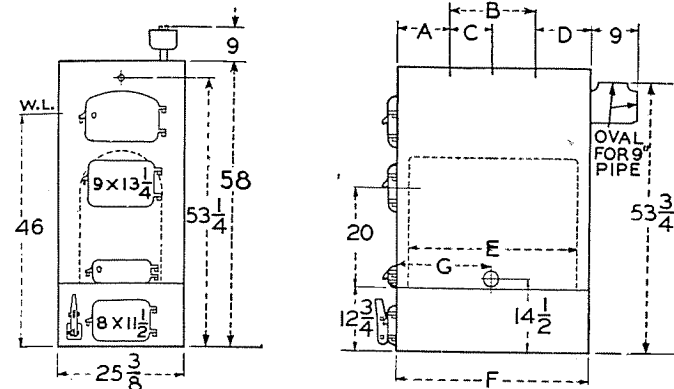


Measurements are subject to slight variations in assembly. Ash pit and foundation measurements are shown on page 32.

Supply Outlet Tappings: Two or more in top of intermediate sections. Letters A, B, C, and D refer to location of, and distance between, outlets.

Return Inlet Tappings: Two in rear of back section. Additional side inlet tapping in 8 section boilers.


Indirect External Water Heater Tapping: One 1 1/2" tapping located in rear of back boiler section. Bosses for additional 1 1/2" tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.



| Boiler Number | A | B | C | D | E | F | G |
|---------------|-------|---------|--------|--------|---------|---------|---------|
| 2-S-4 | 2-W-4 | 6 1/4" | 4 1/4" | ... | 6 1/4" | 12 1/4" | 17 1/8" |
| 2-S-5 | 2-W-5 | 6 1/4" | 8 1/2" | ... | 6 1/4" | 16 1/2" | 21 1/2" |
| 2-S-6 | 2-W-6 | 10 1/2" | 8 1/2" | ... | 6 1/4" | 20 3/4" | 25 3/4" |
| 2-S-7 | 2-W-7 | 10 1/2" | 8 1/2" | ... | 10 1/2" | 25 | 30 |
| 2-S-8 | 2-W-8 | 10 1/2" | 17 | 8 1/2" | 6 1/4" | 29 1/4" | 34 1/4" |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

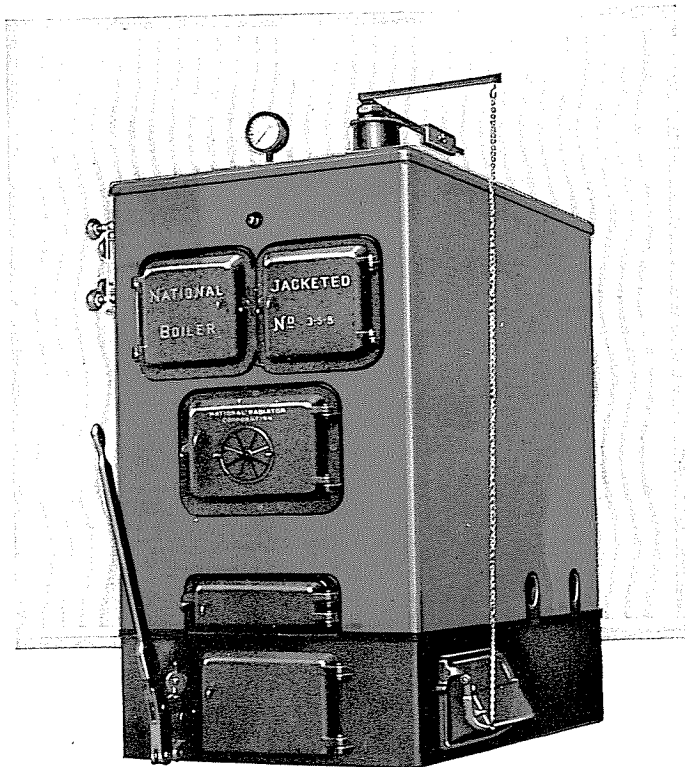


National No. 3-S-8

THE fine reputation of this boiler, built up over a period of many years, is due largely to its ability to burn with equal economy anthracite or bituminous coal, coke, oil, and gas.

This boiler is made in four sizes and is bonded to heat from 480 to 840 square feet of steam radiation or from 790 to 1390 square feet of water radiation. Complete data and dimensions are given on pages 24 and 25.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

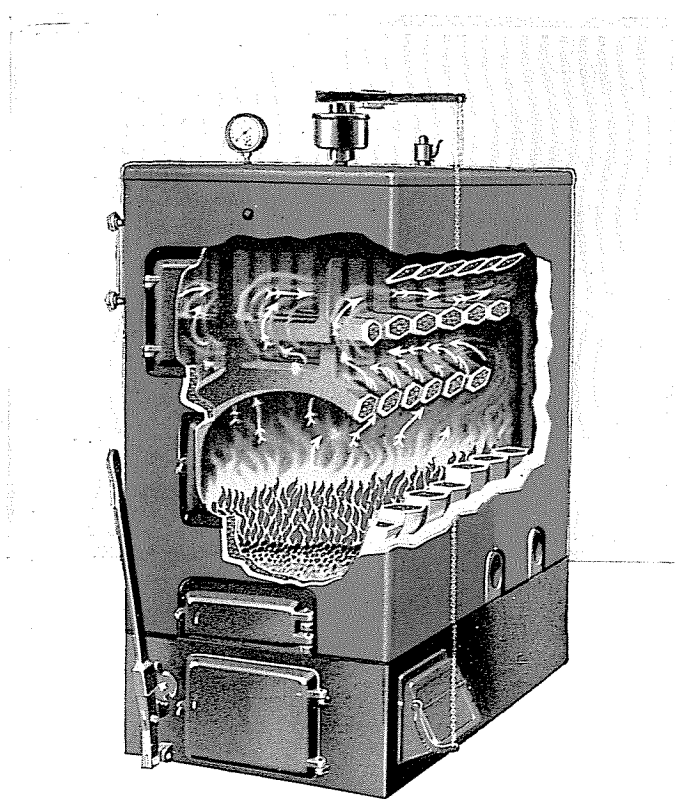


National No. 3-S-8 Interior View

THE water in this boiler is broken up into numerous small columns, which rapidly absorb the heat from the hot gases, as they swirl through the double set of three flue-ways, in a long, forward-and-back travel. This feature assures maximum heat absorption. It also admirably fits this unit for efficient oil burning.

Complete data and dimensions are given on pages 24 and 25.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS



Series No. 3—Sizes and Ratings

For Steam, Vapor and Hot Water

THE square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| 3-S-5 | 900 | 480 | 3.12 | 247 | 2-3" | 2-3" | 8 x 12 | 35 |
| 3-S-6 | 1,100 | 600 | 3.91 | 309 | 2-3" | 2-3" | 8 x 12 | 35 |
| 3-S-7 | 1,300 | 720 | 4.70 | 371 | 3-3" | 4-3" | 8 x 12 | 35 |
| 3-S-8 | 1,500 | 840 | 5.49 | 433 | 3-3" | 4-3" | 8 x 12 | 40 |

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| 3-W-5 | 1,500 | 790 | 3.12 | 247 | 2-3" | 2-3" | 8 x 12 | 35 |
| 3-W-6 | 1,850 | 990 | 3.91 | 309 | 2-3" | 2-3" | 8 x 12 | 35 |
| 3-W-7 | 2,200 | 1,190 | 4.70 | 371 | 3-3" | 4-3" | 8 x 12 | 35 |
| 3-W-8 | 2,550 | 1,390 | 5.49 | 433 | 3-3" | 4-3" | 8 x 12 | 40 |


Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it is 5 7/8 inches.

Return Inlet Tappings: One on each side of intermediate supply outlet section "R".

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1 1/2 inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

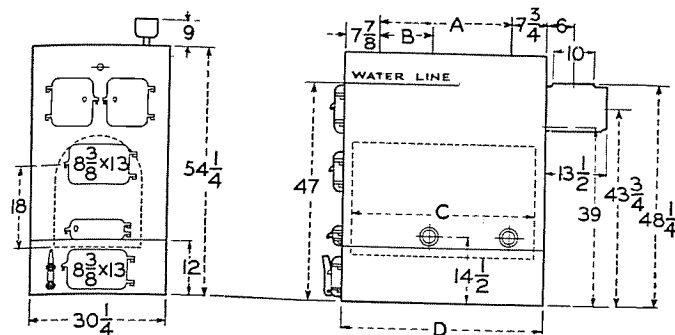

Series No. 3—Steam and Water Dimensions

| Boiler Numbers | | A | B | C | D |
|----------------|-------|---------|---------|---------|---------|
| 3-S-5 | 3-W-5 | 11 3/4" | | 23 1/8" | 27 3/4" |
| 3-S-6 | 3-W-6 | 17 5/8" | | 29 " | 33 1/2" |
| 3-S-7 | 3-W-7 | 23 1/2" | 11 3/4" | 34 7/8" | 39 1/4" |
| 3-S-8 | 3-W-8 | 29 3/8" | 17 5/8" | 40 3/4" | 45 " |

Measurements are subject to slight variations in assembly. Ash Pit and foundation measurements are shown on page 32.

Standard Assembly of Boiler Sections

F—Front; I—Intermediate plain; T°—Intermediate supply outlet, no return inlets; R°—Intermediate supply outlet, 2 return inlets; B—Back, no return inlets.


Arrangement of Sections

| Boiler Numbers | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | Shaking Grates |
|----------------|-------|---|----|---|----|----|----|----|---|----------------|
| 3-S-5 | 3-W-5 | F | T° | I | R° | B° | | | | 4 |
| 3-S-6 | 3-W-6 | F | T° | I | I | R° | B | | | 5 |
| 3-S-7 | 3-W-7 | F | T° | I | R° | I | R° | B | | 6 |
| 3-S-8 | 3-W-8 | F | T° | I | I | R° | I | R° | B | 7 |

(°) after key letter indicates section has supply outlet tapping. Center to center distance between sections is 5 7/8 inches. Grate bars are interchangeable

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

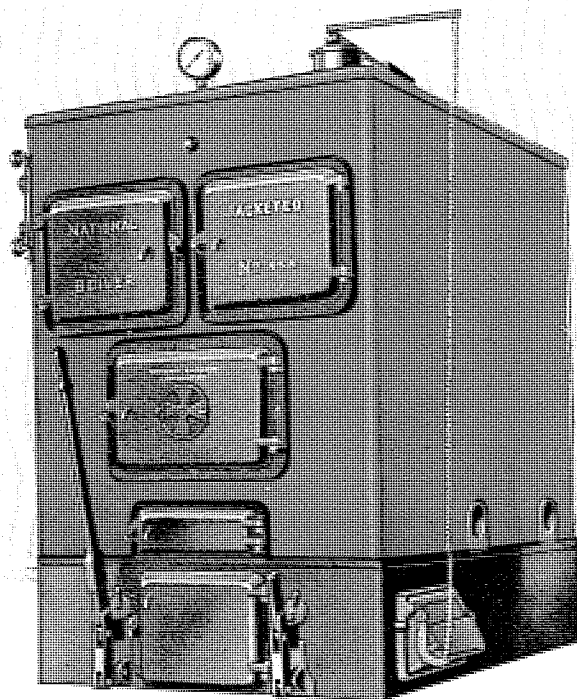

National No. 4-S-8

THE dependability, efficiency, and heating qualities of this boiler have been demonstrated in thousands of installations throughout the country. It ably meets the demand for a jacketed boiler for large residences, and small apartment buildings.

The No. 4 Series illustrated is made in five sizes and is bonded to heat from 700 to 1400 square feet of steam radiation and from 1150 to 2310 square feet of water radiation.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Quality . . .

hidden from inspection,
but apparent in operation


THE jacket of the National Jacketed Boiler is assembled without a single bolt or screw. An ingenious lock-lap joint permits quick setup, affords permanent rigidity. The material is 18-gauge open hearth steel, "two-pass" cold rolled, deoxidized to remove all scale, and then patent leveled to eliminate buckling. The successive coats of enamel are baked on, giving a beautiful vitreous-like finish easily cleaned, and resistant to dirt, wear, and time.

The openings in the jacket, and the tappings in the boiler, are in proper alignment. This makes the attachment of the trimmings simple and easy.

Every crevice between the sides, and the top, of the boiler and its jacket is filled with rock wool insulation, shredded and blown. Because of this process, the material is very finely divided, and a maximum number of "voids" or dead air spaces are established. It is these voids, *and not the material itself*, that insulates. Rock wool was chosen after exhaustive tests. Sheet types of insulation, while less costly, leave "flue spaces" for air circulation between jacket and boiler, causing loss of heat and decreased efficiency.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

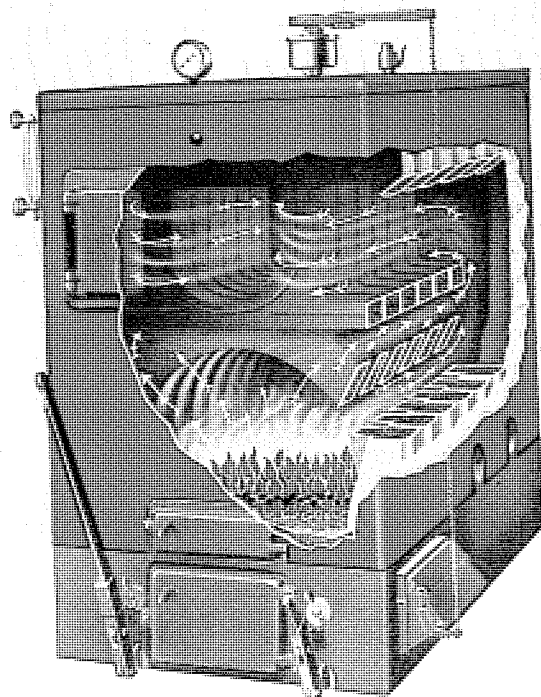

National No. 4-S-7 Interior View

IN this boiler the hot gases rise through the arched crown sheet, which provides a large amount of prime heating surface. They are then drawn to the rear of the boiler. Here they pass up into the two side flues, through which they travel to the front of the boiler and then back again through the central flue, which connects with the smoke outlet. This exceptionally long fire travel (2½ times the length of the boiler) enables this boiler to burn any fuel—coal, coke, oil or gas—with gratifying efficiency.

Complete data and dimensions on pages 30 and 31.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Satisfaction . . .

complete and lasting,
is assured

MINOR refinements contribute much to the appeal of National Jacketed Boilers. The draft door is of the butterfly-balanced type, offering sure, delicate control when operated either manually or automatically. The three-position shaking mechanism locks the grates at normal, allows restricted motion, or—if desired—the dumping of the fire. Grate lugs are cast on the base panels so that, in case of breakage through abuse, only a base panel, and not a boiler section, need be replaced. A skimmer tapping is placed at the water line for easy cleaning of oil from the water surface.


Steam boilers are provided with suitable tappings for the connection of external indirect water heaters, for supplying domestic hot water. (See page 269 for a description of various types of indirect heaters).

The National Jacketed Boiler is a remarkable contribution to domestic heating equipment. To the merit of attractiveness it adds efficiency, economy, convenience, quick pick-up, and a dependability that makes it a lifetime investment, fits it to be a true and trusted heart of the heating system.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Series No. 4 — Sizes and Ratings For Steam, Vapor and Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| 4-S-5 | 1,475 | 700 | 4.78 | 324 | 2-4" | 2-4" | 12 x 12 | 30 |
| 4-S-6 | 1,800 | 875 | 5.95 | 403 | 2-4" | 2-4" | 12 x 12 | 35 |
| 4-S-7 | 2,125 | 1,050 | 7.12 | 482 | 3-4" | 4-4" | 12 x 12 | 35 |
| 4-S-8 | 2,450 | 1,225 | 8.29 | 561 | 3-4" | 4-4" | 12 x 12 | 40 |
| 4-S-9 | 2,775 | 1,400 | 9.46 | 640 | 3-4" | 4-4" | 12 x 16 | 45 |

Water


| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| 4-W-5 | 2,400 | 1,150 | 4.78 | 324 | 2-4" | 2-4" | 12 x 12 | 30 |
| 4-W-6 | 2,900 | 1,440 | 5.95 | 403 | 2-4" | 2-4" | 12 x 12 | 35 |
| 4-W-7 | 3,500 | 1,730 | 7.12 | 482 | 3-4" | 4-4" | 12 x 12 | 35 |
| 4-W-8 | 4,000 | 2,020 | 8.29 | 561 | 3-4" | 4-4" | 12 x 12 | 40 |
| 4-W-9 | 4,500 | 2,310 | 9.46 | 640 | 3-4" | 4-4" | 12 x 16 | 45 |

Supply Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it is 6 7/8 inches.

Return Inlet Tappings: One on each side of next-to-back section "RU". Additional inlet tappings on each side of intermediate outlet section "R" in 7, 8, and 9 section boilers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

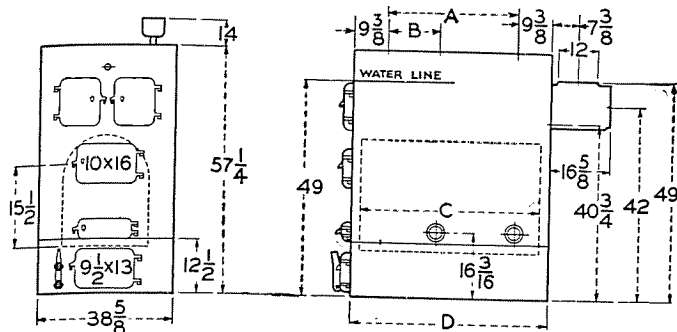

Series No. 4 — Steam and Water Dimensions

| Boiler Numbers | | A | B | C | D |
|----------------|-------|---------|---------|---------|---------|
| 4-S-5 | 4-W-5 | 13 3/4" | | 28 3/8" | 33 1/4" |
| 4-S-6 | 4-W-6 | 20 7/8" | | 35" | 40 1/8" |
| 4-S-7 | 4-W-7 | 27 1/2" | 13 3/4" | 42 7/8" | 47" |
| 4-S-8 | 4-W-8 | 34 3/8" | 13 3/4" | 49 3/4" | 53 7/8" |
| 4-S-9 | 4-W-9 | 41 1/4" | 20 7/8" | 56 3/8" | 60 3/4" |

Measurements are subject to slight variations in assembly.

Ash Pit and foundation measurements are shown on page 32.

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1 1/2 inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

Standard Assembly of Boiler Sections

F—Front; I—Intermediate plain; T°—Intermediate supply outlet, no return inlet; R°—Intermediate supply outlet, and 2 return inlets; RU°—Half uptake next to back, supply outlet and 2 return inlets; B—Back, no returns.

| Boiler Numbers | | Arrangement of Sections | | | | | | | | | Shaking Grates | | |
|----------------|-------|-------------------------|----|---|-----|-----|-----|-----|-----|---|----------------|------|---|
| | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | Front | Back | |
| 4-S-5 | 4-W-5 | F | T° | I | RU° | B | | | | | | 2 | 2 |
| 4-S-6 | 4-W-6 | F | T° | I | I | RU° | B | | | | | 3 | 2 |
| 4-S-7 | 4-W-7 | F | T° | I | R° | I | RU° | B | | | | 3 | 3 |
| 4-S-8 | 4-W-8 | F | T° | I | R° | I | I | RU° | B | | | 4 | 3 |
| 4-S-9 | 4-W-9 | F | T° | I | I | R° | I | I | RU° | B | | 4 | 4 |

(°) After key letter indicates section has supply outlet tapping.


Center to center distance between sections is 6 7/8 inches.

Grate bars are interchangeable.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Ash Pit and Foundation Recommendations Series No. 2, 3, and 4

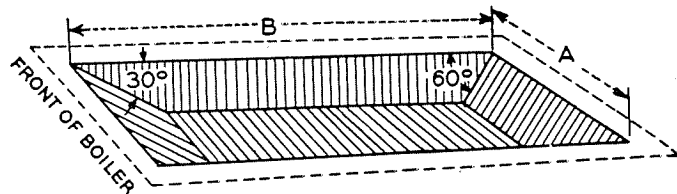

WARPED and burned grate bars are, in practically all cases, due to ashes accumulating until they come in contact with the grates. National grate bars are scientifically designed with ample cooling area, and will last indefinitely if ashes are kept away. As an added factor of safety in operating the boilers, it is recommended that an ash pit be constructed. The sketch above shows the construction. When the basement floor is not yet laid, the pit should be surrounded by a foundation 8 to 10 inches wide so that setting up the boiler need not be delayed.

Tables giving complete dimensions for proper pitting under National Jacketed Square Boilers are given on the opposite page.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED JACKETED SQUARE BOILERS

Ash Pit and Foundation Measurements Series No. 2 Steam and Water

| Boiler Numbers | | A | B | Depth of Pit |
|----------------|-------|-----|--------------------|--------------|
| 2-S-4 | 2-W-4 | 15" | 13" | 8" |
| 2-S-5 | 2-W-5 | 15" | 17 $\frac{1}{4}$ " | 8" |
| 2-S-6 | 2-W-6 | 15" | 21 $\frac{1}{2}$ " | 8" |
| 2-S-7 | 2-W-7 | 15" | 25 $\frac{3}{4}$ " | 8" |
| 2-S-8 | 2-W-8 | 15" | 30" | 8" |

Series No. 3 Steam and Water

| Boiler Numbers | | A | B | Depth of Pit |
|----------------|-------|-----|--------------------|--------------|
| 3-S-5 | 3-W-5 | 17" | 25" | 10" |
| 3-S-6 | 3-W-6 | 17" | 30 $\frac{3}{4}$ " | 10" |
| 3-S-7 | 3-W-7 | 17" | 36 $\frac{1}{2}$ " | 10" |
| 3-S-8 | 3-W-8 | 17" | 42 $\frac{1}{4}$ " | 10" |


Series No. 4 Steam and Water

| Boiler Numbers | | A | B | Depth of Pit |
|----------------|-------|--------------------|--------------------|--------------|
| 4-S-5 | 4-W-5 | 22 $\frac{1}{2}$ " | 30" | 10" |
| 4-S-6 | 4-W-6 | 22 $\frac{1}{2}$ " | 36 $\frac{3}{4}$ " | 10" |
| 4-S-7 | 4-W-7 | 22 $\frac{1}{2}$ " | 43 $\frac{1}{4}$ " | 10" |
| 4-S-8 | 4-W-8 | 22 $\frac{1}{2}$ " | 50 $\frac{1}{2}$ " | 10" |
| 4-S-9 | 4-W-9 | 22 $\frac{1}{2}$ " | 57 $\frac{1}{2}$ " | 10" |

NOTE: When the basement floor is not yet laid, surround the pit with a foundation 8 to 10 inches wide. These measurements refer to sketch on opposite page.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CRIMSON FLAME BOILERS

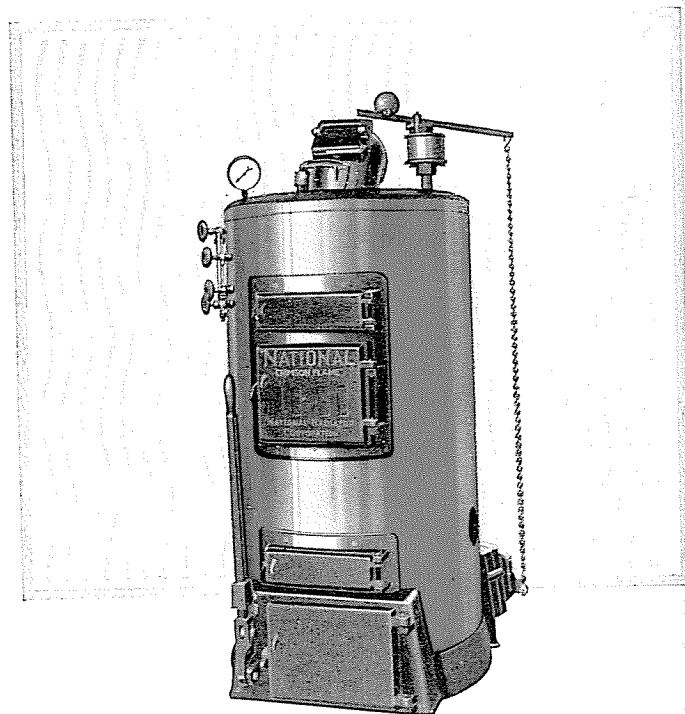

National Crimson Flame Boiler

THE rich warm color of the Crimson Flame Boiler is a vivid promise of the flood of friendly warmth which it will furnish for the home—a promise that is abundantly fulfilled. The boiler is furnished for steam, hot water and vapor systems, in a range of sizes suitable for any ordinary home application. Complete data and dimensions are shown on pages 40 and 41.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CRIMSON FLAME BOILERS

Warmth . . .

Vividly promised,
Honestly delivered


WITH sterling worth that has won the esteem of users—with simplified, scientific design that heating experts praise—the National Crimson Flame meets the requirements of those who seek a touch of color in the basement and a flood of friendly warmth in the home.

The Crimson Flame can be completely assembled easily and quickly. The jacket is made of open hearth steel, “two-pass” cold rolled, deoxidized to remove all scale, and patent leveled to eliminate buckling. The successive coats of striking crimson enamel are baked on, giving a beautiful vitreous-like finish that is easily cleaned, and that resists dirt, wear, and time.

The boiler is snugly encased in a blanket of rock wool insulation on wire mesh, which prevents the dispersion of heat, thereby increasing the effective heating output of the boiler.

The Crimson Flame, in addition to the striking attractiveness conferred by its beautiful colored jacket, has a background in design which assures lasting satisfaction. Its moderate price is made possible because of mass production, and attendant manufacturing economies.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

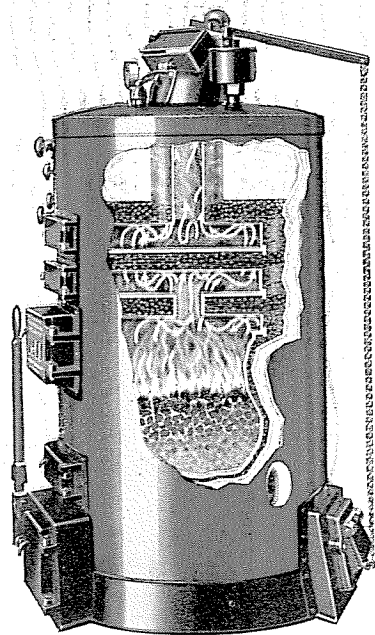

National Crimson Flame—Interior View

THE flames play against the bottom of the section above the fire box, then pass through water-surrounded ports of scientifically proportioned area, and "mushroom" out over the entire bottom of the section above, on their course toward the smoke stack. This process continues till the gases, their temperature reduced to a minimum, reach the chimney.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Straight Talk . . .

on Zig-Zag Fire Travel

THE Fire Travel in the National "Crimson Flame" is much longer than the linear distance between fire pot and smoke outlet would indicate. The zig-zag path of the hot gases carries them back and forth between ports, promoting rapid heat transfer, and a consequent increase in boiler efficiency.

Water legs on each side of the fire pot contribute to rapid water circulation, which means quick pick-up—a highly appreciated feature on cold mornings, when it is desired to raise the temperature fifteen or twenty degrees in a short time. In the steam boiler, the steam liberating area is large, giving a heavy overload capacity without danger of the water leaving the boiler.

The sectionalized design of the boiler has two outstanding advantages. It effectively takes up the expansion and contraction occasioned by the rapid changes in temperature within the boiler; and if through accident the boiler should be broken, it makes repair merely a matter of procuring and installing one small section—a comparatively inexpensive and simple proposition.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED CRIMSON FLAME BOILERS

Styled . . .

for beauty
engineered for efficiency

NATIONAL Crimson Flame Boilers are designed to perform efficiently with domestic sizes of anthracite, bituminous coal, and coke. They can be converted on the job to meet the individual requirements of the fuel selected. The design of the grate and heating surface; the scientific size and shape of the combustion chamber; the serpentine fire travel; the properly proportioned waterways, and the balanced system of air intake and damper control, all unite to deliver a heating service eminently satisfactory because of maximum heating results from minimum fuel consumption.

The sensitive all-inclosed, all-metal damper regulator (furnished as standard equipment on the steam boiler) opens and closes the drafts automatically. Other equipment comprises a Bourdon-tube retard steam gauge; a gauge glass; tri-cocks; and firing tools. On the water boiler, a water temperature regulator, an altitude gauge, and a thermometer, are provided. Years of experience have demonstrated these accessories to be the best of their kind.

The boilers are shipped knocked-down, facilitating transportation to the job, and are easily and quickly assembled to form a perfect, dependable operating unit.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED CRIMSON FLAME BOILERS

Achievement . . .

is the aim — not
just a “job”

THE metal used in the National Crimson Flame is subjected to rigid analysis to assure conformation to the stringent National standards. Each section is tested on special machines, under pressure more than four times as great as the boiler will ordinarily be called upon to carry in actual operation. All machining is done to narrow limits, with permitted tolerances unbelievably small—a point that explains the ease with which National Boilers may be assembled on the job.

The grate mechanism is of the convenient three-position type; locking at normal, permitting restricted motion, or—if desired—the dumping of the fire. The grate is made to the full size of the fire-box; air space is proportioned to give uniform distribution over the entire surface, and the bar bottoms have adequate cooling surface to guard against burn-outs.


The pride of the National Radiator Corporation in its products, and its integrity in all dealings, are the user's best guarantees of complete satisfaction. To this integrity is added the accumulated knowledge and experience of the six long-established companies that formed the corporation, which make National Products the latest and best in heating equipment.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CRIMSON FLAME BOILERS

Sizes and Ratings

For Steam, Vapor and Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Size Inches | Height Feet |
| S-17 | 350 | 175 | 1.52 | 106 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| S-20 | 500 | 275 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| S-21 | 550 | 300 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 35 |
| S-23 | 775 | 375 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Size Inches | Height Feet |
| W-17 | 600 | 285 | 1.52 | 106 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| W-20 | 850 | 455 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| W-21 | 925 | 495 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 35 |
| W-23 | 1300 | 620 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |


Indirect External Water Heater Tapping: One 1½ inch tapping located in left hand side of dome section.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CRIMSON FLAME BOILERS

Fire and Ash Pit Door Dimensions

| Boiler Number | Dimensions—Inches | |
|---------------|-------------------|--------------|
| | Fire Door | Ash Pit Door |
| 17 | 9 x 10¾ | 9½ x 13 |
| 20 | 9 x 11 | 9 x 13 |
| 21 | 9 x 11 | 9 x 13 |
| 23 | 8½ x 13 | 9 x 13 |

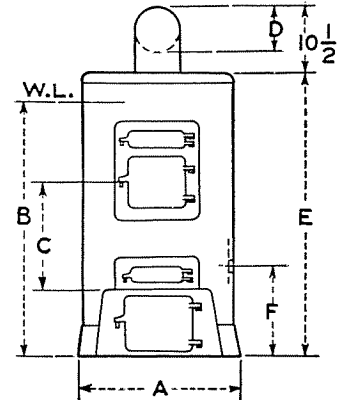

Crimson Flame

Steam and Water Dimensions

Steam

| Boiler Number | A | B | C | D | E | F |
|---------------|------|------|-----|----|------|------|
| S-17 | 25¾" | 41½" | 18" | 7" | 47⅝" | 14¼" |
| S-20 | 30¾" | 45" | 20" | 8" | 52¾" | 14½" |
| S-21 | 30¾" | 50" | 20" | 8" | 57¾" | 14½" |
| S-23 | 33¾" | 45" | 20" | 8" | 52¾" | 14½" |


Water

| | | | | | | |
|------|------|-------|-----|----|------|------|
| W-17 | 25¾" | ----- | 18" | 7" | 43½" | 14¼" |
| W-20 | 30¾" | ----- | 20" | 8" | 46½" | 14½" |
| W-21 | 30¾" | ----- | 20" | 8" | 51½" | 14½" |
| W-23 | 33¾" | ----- | 20" | 8" | 46½" | 14½" |

Measurements are subject to slight variations in assembly.
Dimension "B" is height of water line.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

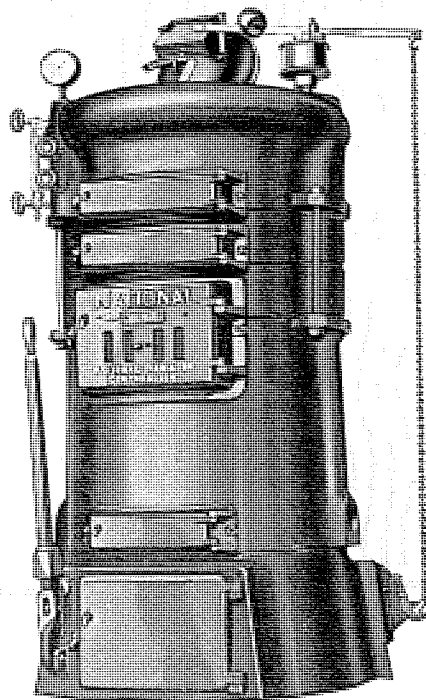

National No. S-23-5

THIS boiler makes a powerful appeal to all seeking a business-like efficient heating unit, free of frills, but full of "go." A total of eighteen sizes, covering 6 grate diameters, provide for an extremely wide variety of applications. The boilers are bonded to heat from 175 to 925 square feet of steam radiation, and 285 to 1530 feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Tributes . . .

Engineering approval
Popular acceptance


NATIONAL Round Boilers are designed to perform efficiently with all types of fuel; domestic sizes of anthracite and bituminous coal, oil, gas, and coke. They can be converted on the job to meet the individual requirements of the fuel selected. The design of the grate and heating surface; the scientific size and shape of the combustion chamber; the serpentine fire travel; the properly proportioned waterways, and the balanced system of air intake and damper control, all unite to deliver a heating service eminently satisfactory because of maximum heating results from minimum fuel consumption.

The sensitive inclosed, all-metal damper regulator (furnished as standard equipment on the steam boiler) opens and closes the drafts automatically. Other equipment comprises a Bourdon-tube retard steam gauge; a gauge glass; tri-cocks; and firing tools. Years of experience have proven these accessories to be the best of their kind. Accessories for the water boiler are furnished on order.

The boilers are shipped knocked-down, facilitating transportation to the job, and are easily and quickly assembled to form a perfect, dependable operating unit.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

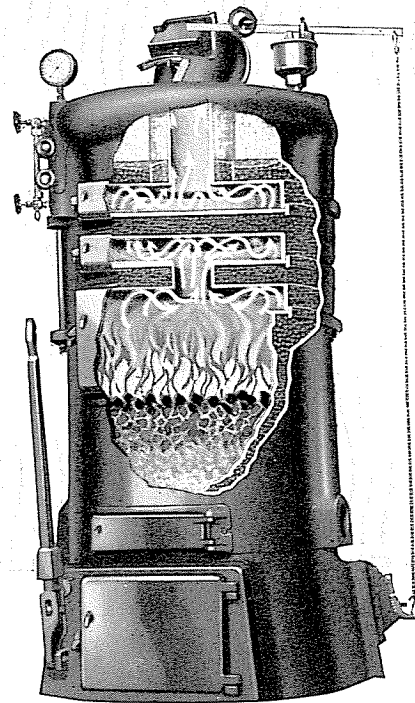

National No. S-23-5 Interior View

THE National Round Boiler is noted for its generous sized firepot that holds a charge of fuel sufficient for many hours. The unusual depth provides ample combustion space above the fuel bed for the efficient burning of the gases. The long, zig-zag fire travel, which promotes maximum heat transfer, is graphically shown.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Efficiency . . .

Long fire travel's
a short cut to it

IN National Round Boilers, the flames play against the crown sheet section above the fire-box, then pass through water-surrounded ports, and "mushroom" out over the entire bottom of the section above, in their course to its openings. This continues till the gases, their temperature reduced to a minimum, reach the stack. Though the apparent travel is comparatively short, the zig-zag path of the gases is relatively long. Increased boiler efficiency arises from this factor.

Water legs on each side of the fire-box contribute to rapid water circulation, which means quick pick-up. In the steam boiler, the steam liberating area is large, giving a heavy overload capacity without danger of the water leaving the boiler.

The grate mechanism is of the convenient three-position type; locking at normal, permitting restricted motion, or—if desired—the dumping of the fire. The grate is made to the full size of the fire-box; air space is proportioned to give uniform distribution over the entire surface, and the bar bottoms have adequate cooling surface to guard against burn-outs.




NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED ROUND BOILERS

National . . .

Acceptance—Sectional Design



THIS illustration shows the sectional arrangement of National Round Boilers. The method of producing the serpentine fire travel by means of zig-zag flue openings is graphically illustrated. The sectionalized design of the boiler has several outstanding advantages.


It facilitates handling on the job.

It effectively takes up the expansion and contraction occasioned by the rapid changes in temperature within the boiler.

Then if, through accident, the boiler should be broken, it makes repair merely a matter of procuring and installing one small section—a comparatively inexpensive and simple proposition.

Flat grates are regular equipment on this boiler. Triangular grates will be furnished on special order.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED ROUND BOILERS

Precision . . .

Raises the Standards of Service

THE metal used in National Round Boilers is subjected to rigid analysis to assure conformation to the stringent National standards. Each section is tested on special machines, under pressures more than four times as great as the boiler will ordinarily be called upon to carry in actual operation. All machining is done to narrow limits, with permitted tolerances unbelievably small—a point that explains the ease with which National Boilers may be assembled on the job.

The pride of the National Radiator Corporation in its products, and its integrity in all dealings are the user's best guarantees of complete satisfaction. To this integrity is added the accumulated knowledge and experience of the six long-established companies that formed the corporation, which make National Products the latest and best in heating equipment.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Sizes and Ratings

For Steam and Vapor



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | ‡ Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|----------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| S-17-4 | 350 | 175 | 1.52 | 106 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| S-17-5 | 400 | 195 | 1.52 | 106 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| S-17-6 | 450 | 215 | 1.52 | 106 | 2-2½" | 2-2½" | 8 x 8 | 35 |
| S-20-4 | 500 | 275 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 30 |
| S-20-5 | 550 | 300 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 8 | 35 |
| S-20-6 | 600 | 325 | 2.01 | 159 | 2-2½" | 2-2½" | 8 x 12 | 35 |
| S-23-4 | 775 | 375 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |
| S-23-5 | 825 | 410 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |
| S-23-6 | 875 | 445 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 40 |
| S-26-4 | 950 | 475 | 3.62 | 291 | 2-3" | 2-3" | 8 x 12 | 35 |
| S-26-5 | 1,025 | 525 | 3.62 | 291 | 2-3" | 2-3" | 8 x 12 | 40 |
| S-26-6 | 1,100 | 575 | 3.62 | 291 | 2-3" | 2-3" | 12 x 12 | 40 |
| S-29-4 | 1,200 | 600 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 35 |
| S-29-5 | 1,300 | 675 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 40 |
| S-29-6 | 1,400 | 725 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 45 |
| S-32-4 | 1,500 | 750 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 40 |
| S-32-5 | 1,600 | 850 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 40 |
| S-32-6 | 1,700 | 925 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 45 |


‡ Hard coal capacity to center of fire door based on 52.5 pds. per cu. ft.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Fire and Ash-Pit Door Dimensions

| Boiler Number | Dimensions—Inches | |
|---------------|-------------------|--------------|
| | Fire-Door | Ash-Pit Door |
| 17 | 9 x 10¾" | 9½ x 13 |
| 20 | 9 x 11 | 9 x 13 |
| 23 | 8⅞ x 13 | 9 x 13 |
| 26 | 9 x 13 | 9 x 15 |
| 29 | 9⅞ x 15 | 9 x 15 |
| 32 | 10 x 15 | 9 x 15 |

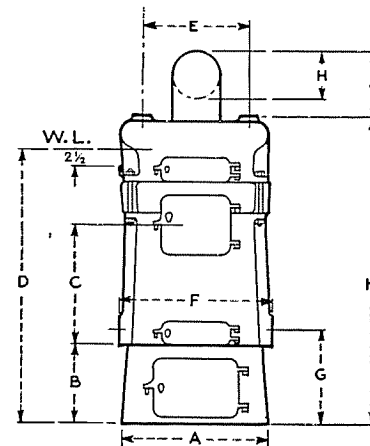

Indirect External Water Heater Tapping: One—1½ inch tapping located in left hand side of dome section, 2½ inches below water line.

Steam Dimensions

| Boiler Number | A | B | C | D | E | F | G | H | J | K |
|---------------|------|------|------|------|------|------|------|-----|-----|------|
| S-17-4 | 22" | 12" | 18" | 41½" | 16¼" | 23¼" | 14¼" | 7" | 10" | 46½" |
| S-17-5 | 22" | 12" | 18" | 46" | 16¼" | 23¼" | 14¼" | 7" | 10" | 51" |
| S-17-6 | 22" | 12" | 18" | 50½" | 16¼" | 23¼" | 14¼" | 7" | 10" | 55½" |
| S-20-4 | 28¼" | 12" | 20" | 45" | 19¼" | 26¼" | 14½" | 8" | 10" | 51½" |
| S-20-5 | 28¼" | 12" | 20" | 50" | 19¼" | 26¼" | 14½" | 8" | 10" | 56½" |
| S-20-6 | 28¼" | 12" | 20" | 55" | 19¼" | 26¼" | 14½" | 8" | 10" | 61½" |
| S-23-4 | 31¾" | 12½" | 20" | 45" | 22¼" | 29" | 14½" | 8" | 10" | 51½" |
| S-23-5 | 31¾" | 12½" | 20" | 50" | 22¼" | 29" | 14½" | 8" | 10" | 56½" |
| S-23-6 | 31¾" | 12½" | 20" | 55" | 22¼" | 29" | 14½" | 8" | 10" | 61½" |
| S-26-4 | 34¼" | 12½" | 20" | 45" | 24¾" | 32¾" | 15" | 10" | 12" | 51½" |
| S-26-5 | 34¼" | 12½" | 20" | 50" | 24¾" | 32¾" | 15" | 10" | 12" | 56½" |
| S-26-6 | 34¼" | 12½" | 20" | 55" | 24¾" | 32¾" | 15" | 10" | 12" | 61½" |
| S-29-4 | 37¼" | 12½" | 21¼" | 46" | 26¾" | 35¾" | 15½" | 10" | 12" | 52½" |
| S-29-5 | 37¼" | 12½" | 21¼" | 51" | 26¾" | 35¾" | 15½" | 10" | 12" | 57½" |
| S-29-6 | 37¼" | 12½" | 21¼" | 56" | 26¾" | 35¾" | 15½" | 10" | 12" | 62½" |
| S-32-4 | 40¾" | 12½" | 21¼" | 46" | 26¾" | 39¾" | 15½" | 10" | 12" | 52½" |
| S-32-5 | 40¾" | 12½" | 21¼" | 51" | 26¾" | 39¾" | 15½" | 10" | 12" | 57½" |
| S-32-6 | 40¾" | 12½" | 21¼" | 56" | 26¾" | 39¾" | 15½" | 10" | 12" | 62½" |

Flat grates regularly furnished.


When triangular grates are used add 2¼ inches to measurements B, D, G and K. Dimension "D" is height of water line.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Sizes and Ratings

For Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | † Fuel Capacity Pds. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | |
|---------------|---------------------------------|---------------------------------------|--------------------|----------------------|-----------------------------|----------------------------|-------------|-------------|
| | | | | | | | Area Inches | Height Feet |
| W-17-4 | 600 | 285 | 1.52 | 106 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| W-17-5 | 675 | 320 | 1.52 | 106 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| W-17-6 | 750 | 355 | 1.52 | 106 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 35 |
| W-20-4 | 850 | 455 | 2.01 | 159 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 30 |
| W-20-5 | 925 | 495 | 2.01 | 159 | 2-2 1/2" | 2-2 1/2" | 8 x 8 | 35 |
| W-20-6 | 1,000 | 535 | 2.01 | 159 | 2-2 1/2" | 2-2 1/2" | 8 x 12 | 35 |
| W-23-4 | 1,300 | 620 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |
| W-23-5 | 1,375 | 675 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 35 |
| W-23-6 | 1,450 | 730 | 2.67 | 213 | 2-3" | 2-3" | 8 x 12 | 40 |
| W-26-4 | 1,575 | 785 | 3.62 | 291 | 2-3" | 2-3" | 8 x 12 | 35 |
| W-26-5 | 1,700 | 865 | 3.62 | 291 | 2-3" | 2-3" | 8 x 12 | 40 |
| W-26-6 | 1,825 | 945 | 3.62 | 291 | 2-3" | 2-3" | 12 x 12 | 40 |
| W-29-4 | 1,975 | 990 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 35 |
| W-29-5 | 2,150 | 1,115 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 40 |
| W-29-6 | 2,325 | 1,195 | 4.35 | 349 | 2-4" | 2-4" | 12 x 12 | 45 |
| W-32-4 | 2,475 | 1,240 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 40 |
| W-32-5 | 2,650 | 1,400 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 40 |
| W-32-6 | 2,825 | 1,530 | 5.41 | 399 | 2-4" | 2-4" | 12 x 12 | 45 |


† Hard coal capacity to center of fire door based on 52.5 pds. per cu. ft.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED ROUND BOILERS

Fire and Ash Pit Door Dimensions

| Boiler Number | Dimensions—Inches | |
|---------------|-------------------|--------------|
| | Fire Door | Ash Pit Door |
| 17 | 9 x 10 3/4 | 9 1/2 x 13 |
| 20 | 9 x 11 | 9 x 13 |
| 23 | 8 7/8 x 13 | 9 x 13 |
| 26 | 9 x 13 | 9 x 15 |
| 29 | 9 7/8 x 15 | 9 x 15 |
| 32 | 10 x 15 | 9 x 15 |

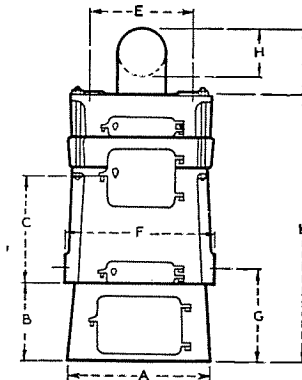

Hot Water Dimensions

| Boiler Number | A | B | C | E | F | G | H | J | K |
|---------------|---------|---------|---------|---------|---------|---------|-----|-----|---------|
| W-17-4 | 22" | 12" | 18" | 16 1/8" | 23 1/4" | 14 1/4" | 7" | 10" | 42 3/4" |
| W-17-5 | 22" | 12" | 18" | 16 1/8" | 23 1/4" | 14 1/4" | 7" | 10" | 46 3/4" |
| W-17-6 | 22" | 12" | 18" | 16 1/8" | 23 1/4" | 14 1/4" | 7" | 10" | 51 3/4" |
| W-20-4 | 28 1/2" | 12" | 20" | 19 1/4" | 26 1/2" | 14 1/2" | 8" | 10" | 46 3/4" |
| W-20-5 | 28 1/2" | 12" | 20" | 19 1/4" | 26 1/2" | 14 1/2" | 8" | 10" | 51 3/4" |
| W-20-6 | 28 1/2" | 12" | 20" | 19 1/4" | 26 1/2" | 14 1/2" | 8" | 10" | 56 3/4" |
| W-23-4 | 31 3/8" | 12 1/4" | 20" | 22 1/4" | 29" | 14 1/2" | 8" | 10" | 45 3/4" |
| W-23-5 | 31 3/8" | 12 1/4" | 20" | 22 1/4" | 29" | 14 1/2" | 8" | 10" | 50 3/4" |
| W-23-6 | 31 3/8" | 12 1/4" | 20" | 22 1/4" | 29" | 14 1/2" | 8" | 10" | 55 3/4" |
| W-26-4 | 34 1/2" | 12 1/4" | 20" | 24 3/4" | 32 3/4" | 15" | 10" | 12" | 45 3/4" |
| W-26-5 | 34 1/2" | 12 1/4" | 20" | 24 3/4" | 32 3/4" | 15" | 10" | 12" | 50 3/4" |
| W-26-6 | 34 1/2" | 12 1/4" | 20" | 24 3/4" | 32 3/4" | 15" | 10" | 12" | 55 3/4" |
| W-29-4 | 37 1/2" | 12 1/4" | 21 1/4" | 26 3/4" | 35 3/4" | 15 1/2" | 10" | 12" | 46 3/4" |
| W-29-5 | 37 1/2" | 12 1/4" | 21 1/4" | 26 3/4" | 35 3/4" | 15 1/2" | 10" | 12" | 51 3/4" |
| W-29-6 | 37 1/2" | 12 1/4" | 21 1/4" | 26 3/4" | 35 3/4" | 15 1/2" | 10" | 12" | 56 3/4" |
| W-32-4 | 40 3/8" | 12 1/2" | 21 1/4" | 26 3/4" | 39 3/4" | 15 1/2" | 10" | 12" | 46 3/4" |
| W-32-5 | 40 3/8" | 12 1/2" | 21 1/4" | 26 3/4" | 39 3/4" | 15 1/2" | 10" | 12" | 51 3/4" |
| W-32-6 | 40 3/8" | 12 1/2" | 21 1/4" | 26 3/4" | 39 3/4" | 15 1/2" | 10" | 12" | 56 3/4" |

Flat grates regularly furnished.

When triangular grates are used add 2 1/4 inches to measurements B, G, and K.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS



National Contento No. 6-W

IN any small home or small building where space, expense, or the absence of a basement prevents locating the boiler in the basement, Contento finds its field. Compact and attractive, economical to install and to operate, it efficiently burns hard coal, soft coal, or coke, brings a maximum of comfort, with a minimum of bother.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS

Contento . . .

**Brings contentment
to the Home**

THE Contento Water Boiler brings to the old house, now heated with stoves; the small house, where a large heating plant is not justified; and to the house without a basement, the opportunity to have economical, desirable radiator heat, at a small investment, and at a small operating expense.


Thousands of users heartily endorse Contento, for it has given them 'cleanliness, convenience, and comfort in their home heating. From every standpoint, Contento is a fit companion of the other renowned units in the National Line.

While the price is surprisingly low, the units are designed and built with the same attention to detail found in all National manufacturing operations. Large production, and exceptional plant efficiency, make the reasonable price possible.

Firing tools are furnished on the Contento Water Boiler, but no trimmings are provided. If they are desired, full descriptions may be found in the accessory section.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS

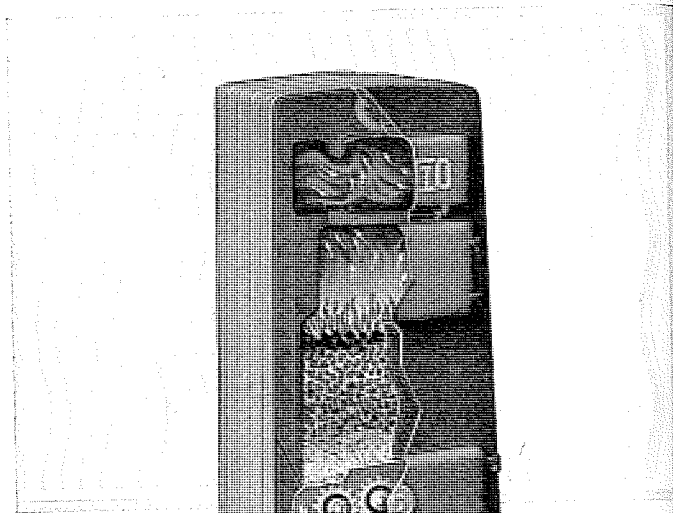

National Contento No. 6-W Interior View

THE flames in Contento are not permitted to progress unhampered to the stack, carrying with them valuable heat units. They must travel a long path, past the water filled sections, and give up their heat to warm the home.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS

Duplicating . . .

large boiler standards
in smaller boiler sizes

CONTENTO is a small unit—but retains in detail the features that make the larger National Boilers outstandingly efficient.

The flames rise, playing against wings on the side water legs, and against the crown sheet at the top. Together, these provide a large amount of “prime,” or direct, heating surface. The flames then pass through ports between the sections, into the two side flues, progress—through passages entirely surrounded by water—to the front of the boiler, then to the back through the central flue. Fire travel is thus one and one-half times the length of the boiler—an adequate distance to permit a maximum of the heat in the gases to be absorbed by the water, and so transmitted to the radiators.


The fire-box is deep, and of sufficient capacity to permit heavy fuel charges. This not only makes the fuel burn more efficiently, but decreases the amount of attention required. Grates are geared together so one shaking cleans the entire fire. The ash pan is removable.

Made to the same rigid standards as the large boilers, Contento has, within its field, the same praiseworthy ability to provide a constant flow of healthful warmth, the same capacity to assure complete and permanent satisfaction.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS

Sizes and Ratings For Hot Water



THE square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Sq. Ft. | * Bonded Direct C.I. Radiation Sq. Ft. | ** Radiating Value Sq. Ft. | Grate Area Sq. Ft. | Fuel Capacity Pounds | Chimney | |
|---------------|--------------------------|--|----------------------------|--------------------|----------------------|-------------|-------------|
| | | | | | | Area Inches | Height Feet |
| 4-W | 400 | 225 | 50 | .90 | 70 | 8 x 8 | 25 |
| 5-W | 535 | 305 | 60 | 1.22 | 90 | 8 x 8 | 25 |
| 6-W | 670 | 385 | 70 | 1.54 | 115 | 8 x 8 | 30 |
| 7-W | 825 | 465 | 80 | 1.86 | 140 | 8 x 8 | 30 |
| 8-W | 990 | 545 | 90 | 2.18 | 165 | 8 x 8 | 35 |

*Square feet of direct cast iron radiation boiler will carry when installed on same floor level with radiators. When installed in basement reduce the bonded load 20% to allow for piping.

**Radiating value in square feet of radiation of boiler, tank and piping.


Tappings: 2-2" outlets and 2-2" inlets located in rear of back section.

These boilers are shipped assembled in one piece.

Ash pan and firing tools are furnished with each boiler.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED CONTENTO BOILERS

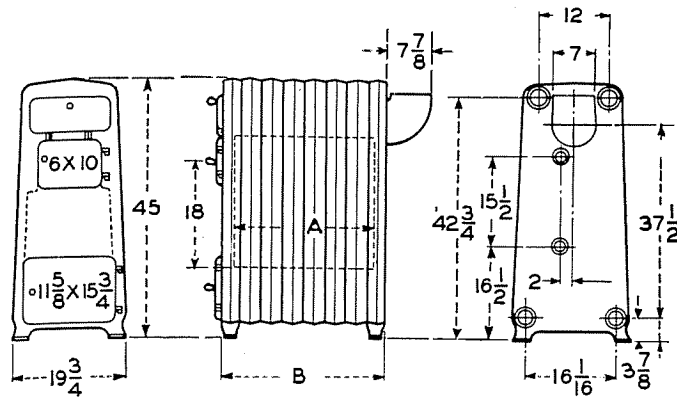


Water Dimensions

| Boiler Number | A | B |
|---------------|-----------|-----------|
| 4-W | 10 1/4" | 13 1/4" |
| 5-W | 13 13/16" | 16 13/16" |
| 6-W | 17 3/8" | 20 3/8" |
| 7-W | 20 15/16" | 23 15/16" |
| 8-W | 24 1/2" | 27 1/2" |

Measurements are subject to slight variations in assembly.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

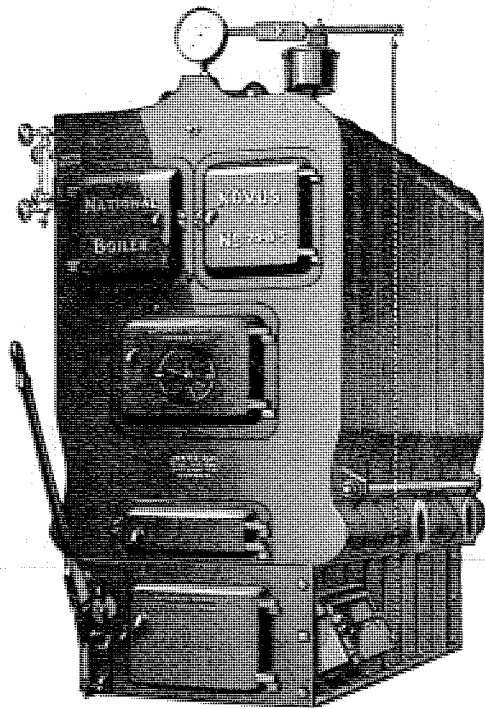

National No. 20-8-S

THIS boiler enjoys an enviable reputation for service, honestly earned in many years of dependable heating performance. It is made in four sizes, and is bonded to heat from 480 to 840 square feet of steam radiation, and from 790 to 1390 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

Universally . . .

used—
universally advocated

STANDARD for almost twenty years, the Novus Boiler has served in all sorts of heating applications all over the country. Invariably the judgment rendered on its performance is the same—unqualifiedly and enthusiastically favorable.


The Novus Boiler is easy to tend; economical on fuel; staunch and dependable. Its pick-up is quick and effective—a valuable feature.

Properly located cleaning doors make it easy to remove any accumulation. Their presence makes it difficult to overlook this simple but extremely important task. Soot is a highly objectionable insulator, which may reduce efficiency as much as 25%.

A skimmer tapping is provided, which will effectively clear the boiler of oil, that deadly enemy of efficiency. Draining the boiler from the bottom will not do this. The oil clings to the sides of the sections, floating again when the boiler is refilled.

Standard equipment on the steam boilers includes an all-metal, all-inclosed sensitive damper regulator, that opens and closes the drafts to keep the pressure uniform; a retard steam gauge, with non-glare dial and water seal; an A. S. M. E. standard pop safety valve; a gauge glass, tri-cocks, and firing tools. No accessories other than firing tools are regularly furnished with Novus Water Boilers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

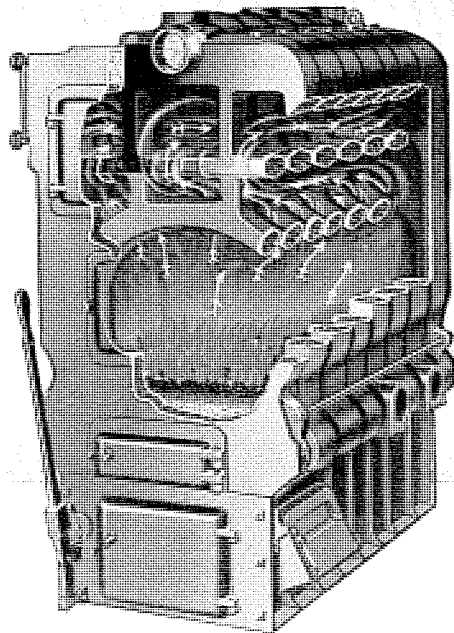

National No. 20-8-S Interior View

A DOUBLE set of three flue-ways are formed by numerous water tubes, around which the flames swirl in their long forward and back travel. This feature naturally produces high efficiency in coal burning, and also admirably fits the unit for economically burning oil.

Complete data and dimensions are given on pages 62 and 63.

The Crown . . . of Service and Superiority


IN the crown sheet of the Novus Boiler is found a feature that contributes largely to its superiority; it is the large area of overhanging direct fire surface.

In all cases this overhanging surface is arched across the boiler. In the 48 series, the overhang forms an integral part of the crown sheet. In the other series this overhang is in the form of an arched rib, joined to the crown sheet at its top, and to the water legs at its ends.

A large portion of the water in the boiler is thus brought into the area of greatest temperature, absorbing a large quantity of heat units before the hot gases enter the flues. After the gases have entered, they pass forward through flue-ways, entirely surrounded by water, and then back through another set of flues to the stack. All along their path their heat is being rapidly absorbed, so that stack temperatures and heat loss are reduced to a minimum.

Efficient combustion is promoted by the progressive increase in combustion area, permitting the gases to expand naturally. This feature, combined with the large amount of prime heating surface, and the long fire-travel, is responsible for the success of the Novus Boiler in oil and gas-burning operations as well as in the field of coal-burning.

NATIONAL BONDED NOVUS SECTIONAL BOILERS



Series No. 20—Sizes and Ratings

For Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|--------------------------|
| | | | | | | Area Inches | Height Feet | |
| 20-5-S | 900 | 480 | 3.12 | 2-3" | 2-3" | 8 x 12 | 35 | 28 |
| 20-6-S | 1,100 | 600 | 3.91 | 2-3" | 2-3" | 8 x 12 | 35 | 32 |
| 20-7-S | 1,300 | 720 | 4.70 | 3-3" | 4-3" | 8 x 12 | 35 | 36 |
| 20-8-S | 1,500 | 840 | 5.49 | 3-3" | 4-3" | 8 x 12 | 40 | 40 |


Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|--------------------------|
| | | | | | | Area Inches | Height Feet | |
| 5-20-W | 1,500 | 790 | 3.12 | 2-3" | 2-3" | 8 x 12 | 35 | 28 |
| 6-20-W | 1,850 | 990 | 3.91 | 2-3" | 2-3" | 8 x 12 | 35 | 32 |
| 7-20-W | 2,200 | 1,190 | 4.70 | 3-3" | 4-3" | 8 x 12 | 35 | 36 |
| 8-20-W | 2,550 | 1,390 | 5.49 | 3-3" | 4-3" | 8 x 12 | 40 | 40 |

†Square feet of exterior boiler surface.
 Approximately 36 pounds of insulation per section required to provide boiler covering 1½ inches thick.
 100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

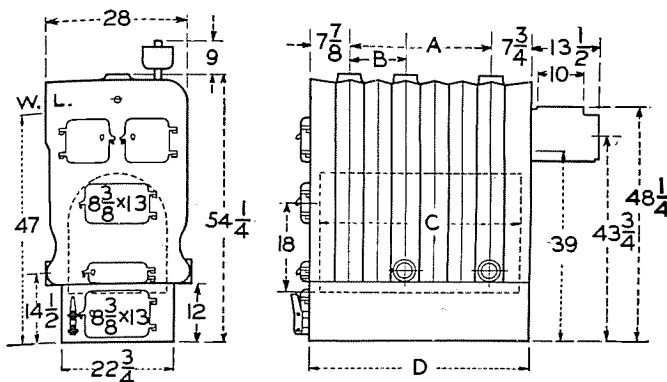

Series No. 20—Steam and Water Dimensions

| Boiler Numbers | | A | B | C | D |
|----------------|--------|-----|------|-----|-----|
| 20-5-S | 5-20-W | 11¾ | | 23½ | 27¾ |
| 20-6-S | 6-20-W | 17⅝ | | 29 | 33½ |
| 20-7-S | 7-20-W | 23½ | 11¾ | 34⅞ | 39½ |
| 20-8-S | 8-20-W | 29⅞ | 17⅞ | 40¾ | 45 |

Measurements are subject to slight variations in assembly.
 Ashpit and foundation measurements are shown on page 88.
 Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it 5½ inches.
 Return Inlet Tappings: One on each side of intermediate supply outlet Section "R".
 Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1½ inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.


Standard Assembly of Boiler Sections

F—Front; I—Intermediate Plain; T°—Intermediate Supply Outlet, no Return Inlets; R°—Intermediate Supply Outlet, 2 Return Inlets; B—Back, no Return Inlets.

| Boiler Numbers | | Arrangement of Sections | | | | | | | | Shaking Grates |
|----------------|--------|-------------------------|----|---|----|----|----|----|---|----------------|
| | | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | |
| 20-5-S | 20-W-5 | F | T° | I | R° | B | | | | 4 |
| 20-6-S | 20-W-6 | F | T° | I | I | R° | B | | | 5 |
| 20-7-S | 20-W-7 | F | T° | I | R° | I | R° | B | | 6 |
| 20-8-S | 20-W-8 | F | T° | I | I | R° | I | R° | B | 7 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

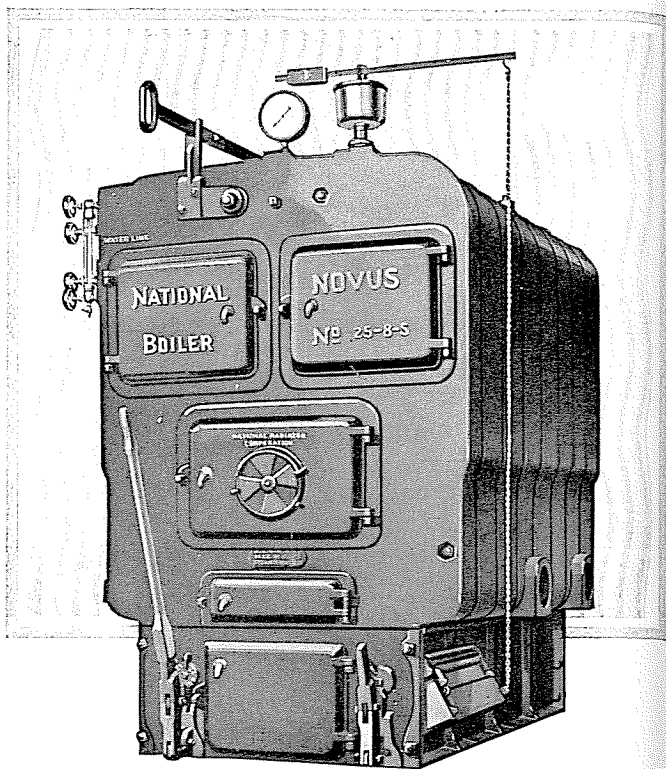


National No. 25-8-S

IN thousands of installations throughout the country this boiler has demonstrated its dependability and efficiency. Due to the scientific proportioning of its combustion chamber, and the arrangement of the heating surface, this boiler will economically burn all types of fuel.

This boiler is made in five sizes, and is bonded to heat from 700 to 1400 feet of steam radiation, and 1150 to 2310 feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

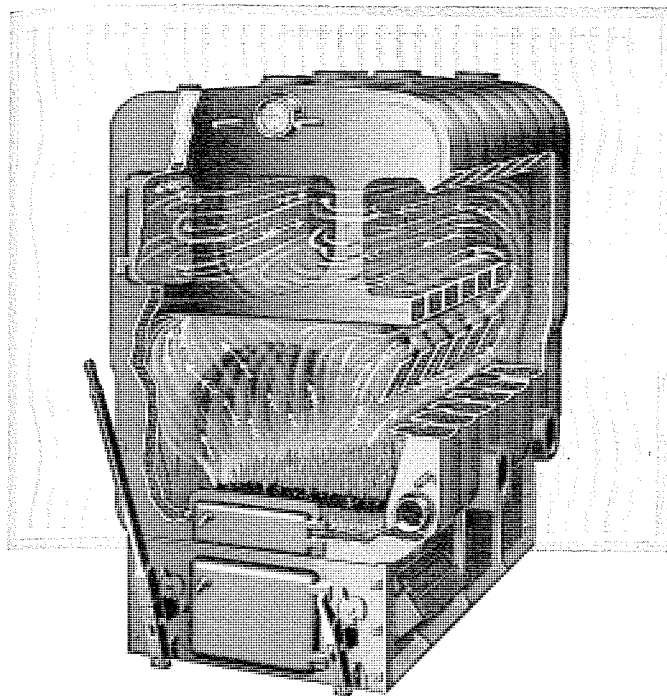


National No. 25-8-S Interior View

A FIRE travel two and one half times the length of the boiler gives to this unit outstanding heating qualities and high efficiency. The flames pass through and over the arched crown sheet to the rear of the boiler, where they are drawn up into the two side flues, through which they pass to the front of the boiler. Here the two streams of burning gases unite, and progress to the rear of the boiler, and out, through the central flue.

Complete data and dimensions on pages 66 and 67.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS



Series No. 25 Sizes and Ratings

For Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 25-5-S | 1,475 | 700 | 4.78 | 2-4" | 2-4" | 12 x 12 | 30 | 39 |
| 25-6-S | 1,800 | 875 | 5.95 | 2-4" | 2-4" | 12 x 12 | 35 | 45 |
| 25-7-S | 2,125 | 1,050 | 7.12 | 3-4" | 4-4" | 12 x 12 | 35 | 51 |
| 25-8-S | 2,450 | 1,225 | 8.29 | 3-4" | 4-4" | 12 x 12 | 40 | 57 |
| 25-9-S | 2,775 | 1,400 | 9.46 | 3-4" | 4-4" | 12 x 16 | 45 | 63 |

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 5-25-W | 2,400 | 1,150 | 4.78 | 2-4" | 2-4" | 12 x 12 | 30 | 39 |
| 6-25-W | 2,900 | 1,440 | 5.95 | 2-4" | 2-4" | 12 x 12 | 35 | 45 |
| 7-25-W | 3,500 | 1,730 | 7.12 | 3-4" | 4-4" | 12 x 12 | 35 | 51 |
| 8-25-W | 4,000 | 2,020 | 8.29 | 3-4" | 4-4" | 12 x 12 | 40 | 57 |
| 9-25-W | 4,500 | 2,310 | 9.46 | 3-4" | 4-4" | 12 x 16 | 45 | 63 |


† Square feet of exterior boiler surface. Approximately 48 pounds of insulation per section required to provide boiler covering 1½ inches thick.

Return Inlet Tappings: One on each side of next-to-back section "RU". Additional inlets on each side of intermediate outlet section "R" in 7, 8, and 9 section boilers.

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1½ inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

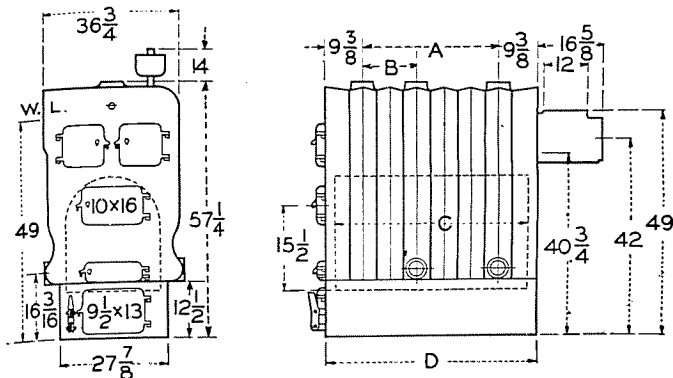

Series No. 25—Steam and Water Dimensions

| Boiler Numbers | | A | B | C | D |
|----------------|--------|---------|---------|---------|---------|
| 25-5-S | 5-25-W | 13 3/4" | ----- | 28 1/8" | 33 1/4" |
| 25-6-S | 6-25-W | 20 5/8" | ----- | 35" | 40 7/8" |
| 25-7-S | 7-25-W | 27 1/2" | 13 3/4" | 41 7/8" | 47" |
| 25-8-S | 8-25-W | 34 3/8" | 13 3/4" | 48 3/4" | 53 7/8" |
| 25-9-S | 9-25-W | 41 1/4" | 20 5/8" | 55 5/8" | 60 3/4" |

Measurements are subject to slight variations in assembly. Ashpit and foundation measurements are shown on page 88.

Standard Assembly of Boiler Sections

F—Front; I—Intermediate Plain; T°—Intermediate supply outlet, no return inlets; R°—Intermediate supply outlet, and 2 return inlets; RU°—Half uptake next to back, supply outlet and 2 return inlets; B—Back, no returns.

Arrangement of Sections


| Boiler Numbers | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | Shaking Grates | | |
|----------------|--------|---|----|---|-----|-----|-----|-----|-----|----------------|------|---|
| | | | | | | | | | | Front | Back | |
| 25-5-S | 5-25-W | F | T° | I | RU° | B | | | | 2 | 2 | |
| 25-6-S | 6-25-W | F | T° | I | I | RU° | B | | | 3 | 2 | |
| 25-7-S | 7-25-W | F | T° | I | R° | I | RU° | B | | 3 | 3 | |
| 25-8-S | 8-25-W | F | T° | I | R° | I | I | RU° | B | 4 | 3 | |
| 25-9-S | 9-25-W | F | T° | I | I | R° | I | I | RU° | B | 4 | 4 |

Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it 6 7/8 inches.

All grate bars are interchangeable

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

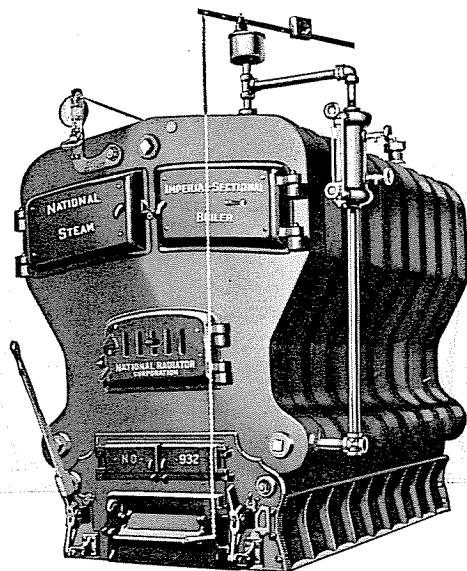

National No. S-932

AS the Utica Imperial Sectional Boiler, this unit built up an enviable reputation. Now, improved and refined, it is winning new laurels.

It is made in five sizes, and is bonded to heat from 1200 to 2400 square feet of steam radiation, and from 1980 to 3960 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

Companions . . .

In Achievement
and Performance

THE 32 and 42 Series, National Imperial Sectional Boilers, were the hard coal companions of the renowned Utica Imperial Super-Smokeless Boiler. (Now the National Super-Smokeless Boiler).

By outstanding performance they demonstrated their dependability, proved their efficiency, and won the right to be included in the famous National Sectional Line of boilers.


These boilers were introduced more than 20 years ago. The first installations demonstrated the soundness of their design, and subsequent improvements have continuously kept them in an advanced position.

This position has been maintained by strict adherence to rigid manufacturing standards. Each batch of metal is subjected to careful analysis. All machining is done to small limits, under constant careful supervision. Sections are tested on special machines under hydrostatic pressures more than four times as great as the boilers will ordinarily be called upon to carry in actual service.

Design — manufacture — performance — these things unite to make National Imperial-Sectional Boilers companions in achievement.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

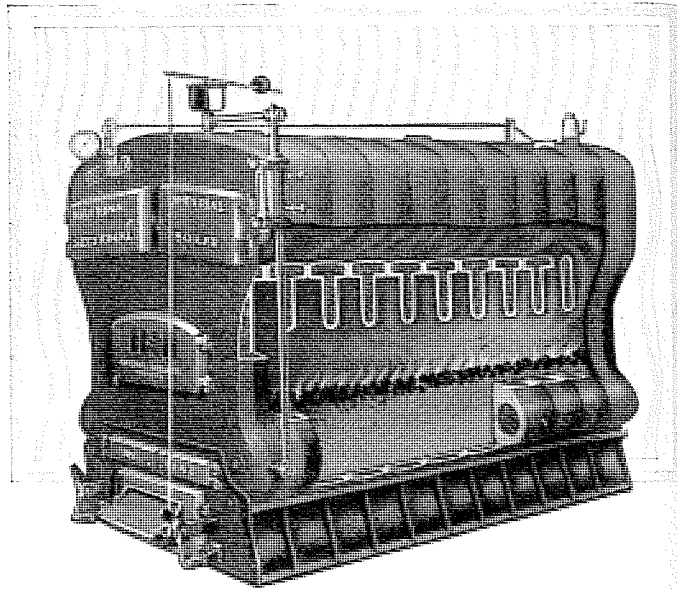

National No. S-1142 Interior View


THE burning gases travel twice the length of the boiler in a swirling, rotative manner, scouring the sides of the flue ways, and producing a high rate of heat transfer. The arched ribs, integral with the crown sheet, provide an abundance of prime heating surface.

The internal construction of the 32 series Imperial Sectional Boiler is practically identical with the 42 series illustrated above, the only difference being in the smaller grate widths.

Complete Data and Dimensions, 32 series, on pages 72-73 and 74-75; 42 series, pages 72-73 and 76-77.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

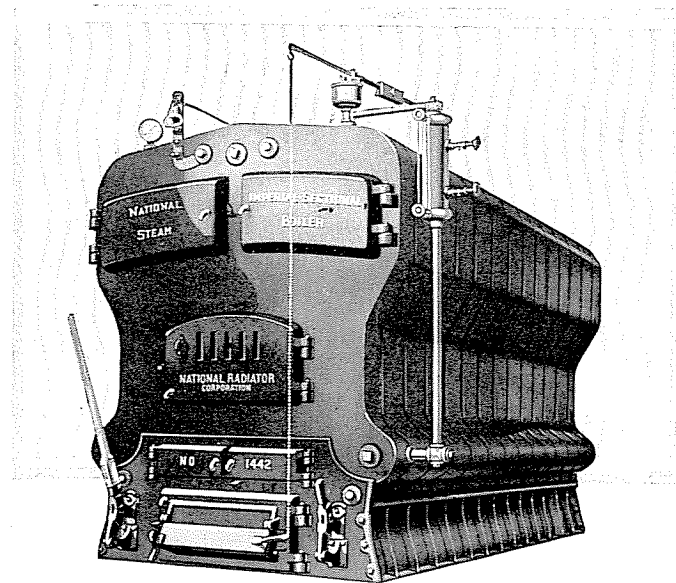


National No. S-1442

IN schools, apartments, hospitals and similar applications, this boiler—under the name of the Utica Imperial Sectional Boiler—has won and retained an outstanding reputation. Because of the interior construction it is ideally adapted for oil burning.

It is made in eleven sizes, and is bonded to heat 2200 to 6700 square feet of steam radiation, and from 3625 to 11000 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)



Series No. 32 and 42
Sizes and Ratings
For Steam and Vapor

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam Series No. 32

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| S-532 | 2,900 | 1,200 | 7.32 | 2-5" | 2-4" | 14 x 14 | 40 | 42 |
| S-632 | 3,600 | 1,500 | 9.10 | 2-5" | 2-4" | 15 x 15 | 40 | 51 |
| S-732 | 4,300 | 1,800 | 10.87 | 2-5" | 2-4" | 16 x 16 | 40 | 60 |
| S-832 | 5,000 | 2,100 | 12.65 | 2-5" | 2-4" | 16 x 16 | 50 | 69 |
| S-932 | 5,700 | 2,400 | 14.42 | 3-5" | 2-4" | 18 x 18 | 50 | 78 |

Steam Series No. 42

| | | | | | | | | |
|--------|--------|-------|--------|------|------|---------|----|-----|
| S-642 | 5,200 | 2,200 | 12.03 | 2-5" | 2-4" | 16 x 16 | 50 | 56 |
| S-742 | 6,200 | 2,700 | 14.38 | 2-5" | 2-4" | 18 x 18 | 50 | 66 |
| S-842 | 7,200 | 3,200 | 16.73 | 3-5" | 2-4" | 18 x 18 | 55 | 76 |
| S-942 | 8,200 | 3,700 | 19.08 | 3-5" | 2-4" | 20 x 20 | 55 | 86 |
| S-1042 | 9,200 | 4,200 | 21.43 | 3-5" | 2-4" | 20 x 20 | 60 | 96 |
| S-1142 | 10,200 | 4,700 | 23.77 | 3-5" | 2-4" | 21 x 21 | 60 | 106 |
| S-1242 | 11,200 | 5,100 | 26.12† | 4-5" | 2-4" | 22 x 22 | 65 | 116 |
| S-1342 | 12,200 | 5,500 | 28.47† | 4-5" | 2-4" | 22 x 22 | 70 | 126 |
| S-1442 | 13,000 | 5,900 | 30.82† | 4-5" | 2-4" | 23 x 23 | 75 | 136 |
| S-1542 | 13,800 | 6,300 | 33.17† | 4-5" | 2-4" | 23 x 23 | 75 | 146 |
| S-1642 | 14,600 | 6,700 | 35.52† | 4-5" | 2-4" | 24 x 24 | 80 | 156 |

† Maximum grate area that can be furnished. Unless otherwise ordered the S-1242 is shipped with 9 grate bars having a grate area of 21.43 square feet, the S-1342, S-1442 and S-1542 with 10 grate bars having a grate area of 23.77 square feet, and the S-1642 with 11 grate bars having a grate area of 26.12 square feet.

‡ Square feet of exterior boiler surface.


Series No. 32 requires approximately 60 pounds and Series No. 42 approximately 67 pounds of insulation per section to provide boiler covering 1½ inches thick.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

Series No. 32 and 42
Sizes and Ratings
For Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.



Water Series No. 32

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| W-532 | 4,650 | 1,980 | 7.32 | 2-5" | 2-4" 2-5" | 14 x 14 | 40 | 42 |
| W-632 | 5,800 | 2,475 | 9.10 | 2-5" | 2-4" 2-5" | 15 x 15 | 40 | 51 |
| W-732 | 6,950 | 2,970 | 10.87 | 2-5" | 2-4" 2-5" | 16 x 16 | 40 | 60 |
| W-832 | 8,100 | 3,465 | 12.65 | 2-5" | 2-4" 2-5" | 16 x 16 | 50 | 69 |
| W-932 | 9,250 | 3,960 | 14.42 | 3-5" | 2-4" 2-5" | 18 x 18 | 50 | 78 |

Water Series No. 42

| | | | | | | | | |
|--------|--------|--------|--------|------|-----------|---------|----|-----|
| W-642 | 8,300 | 3,625 | 12.03 | 2-5" | 2-4" 2-5" | 16 x 16 | 50 | 56 |
| W-742 | 9,900 | 4,450 | 14.38 | 2-5" | 2-4" 2-5" | 18 x 18 | 50 | 66 |
| W-842 | 11,500 | 5,275 | 16.73 | 3-5" | 2-4" 2-5" | 18 x 18 | 55 | 76 |
| W-942 | 13,100 | 6,100 | 19.08 | 3-5" | 2-4" 2-5" | 20 x 20 | 55 | 86 |
| W-1042 | 14,700 | 6,925 | 21.43 | 3-5" | 2-4" 2-5" | 20 x 20 | 60 | 96 |
| W-1142 | 16,300 | 7,750 | 23.77 | 3-5" | 2-4" 2-5" | 21 x 21 | 60 | 106 |
| W-1242 | 17,900 | 8,400 | 26.12† | 4-5" | 2-4" 4-5" | 22 x 22 | 65 | 116 |
| W-1342 | 19,500 | 9,050 | 28.47† | 4-5" | 2-4" 4-5" | 22 x 22 | 70 | 126 |
| W-1442 | 20,800 | 9,700 | 30.82† | 4-5" | 2-4" 4-5" | 23 x 23 | 75 | 136 |
| W-1542 | 22,100 | 10,350 | 33.17† | 4-5" | 2-4" 4-5" | 23 x 23 | 75 | 146 |
| W-1642 | 23,400 | 11,000 | 35.52† | 4-5" | 2-4" 4-5" | 24 x 24 | 80 | 156 |


† Maximum grate area that can be furnished. Unless otherwise ordered the W-1242 is shipped with 9 grate bars having a grate area of 21.43 sq. ft., the W-1342, W-1442 and W-1542 with 10 grate bars having a grate area of 23.77 sq. ft. and the W-1642 with 11 grate bars having a grate area of 26.12 sq. ft.

‡ Square feet of exterior boiler surface.

Series No. 32 requires approximately 60 pounds and Series No. 42 approximately 67 pounds of insulation per section to provide boiler covering 1½ inches thick.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

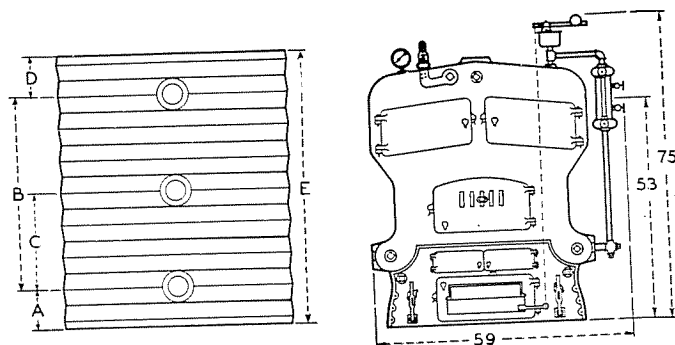

Series No. 32 Dimensions
Steam and Water

| Boiler Number | A | B | C | D | E | F | G | H |
|---------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| 532 | 10 $\frac{3}{8}$ " | 16 $\frac{1}{2}$ " | .. | 10 $\frac{3}{8}$ " | 37 $\frac{1}{4}$ " | 32 $\frac{1}{2}$ " | 38 $\frac{1}{4}$ " | 10 $\frac{1}{2}$ " |
| 632 | 10 $\frac{3}{8}$ " | 24 $\frac{3}{4}$ " | .. | 10 $\frac{3}{8}$ " | 45 $\frac{1}{2}$ " | 40 $\frac{3}{4}$ " | 46 $\frac{1}{2}$ " | 10 $\frac{1}{2}$ " |
| 732 | 10 $\frac{3}{8}$ " | 33" | .. | 10 $\frac{3}{8}$ " | 53 $\frac{3}{4}$ " | 49" | 54 $\frac{3}{4}$ " | 10 $\frac{1}{2}$ " |
| 832 | 10 $\frac{3}{8}$ " | 41 $\frac{1}{4}$ " | .. | 10 $\frac{3}{8}$ " | 62" | 57 $\frac{1}{4}$ " | 63" | 10 $\frac{1}{2}$ " |
| 932 | 10 $\frac{3}{8}$ " | 49 $\frac{1}{2}$ " | 24 $\frac{3}{4}$ " | 10 $\frac{3}{8}$ " | 70 $\frac{1}{4}$ " | 65 $\frac{1}{2}$ " | 71 $\frac{1}{4}$ " | 10 $\frac{1}{2}$ " |

Measurements subject to slight variations in assembly.

Ashpit and foundation measurements are shown on page 89.

Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections page 75. Distance from center of one section to center of section next to it 8 $\frac{1}{4}$ inches.


Steam Return Inlet Tappings: Two 4" in rear of back section "B". Side return inlets on steam boilers are only furnished on special order.

Water Return Inlet Tappings: Two 4" in rear of back section "B". Additional 5" return inlets on each side of intermediate supply outlet section "LR".

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1 $\frac{1}{2}$ inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

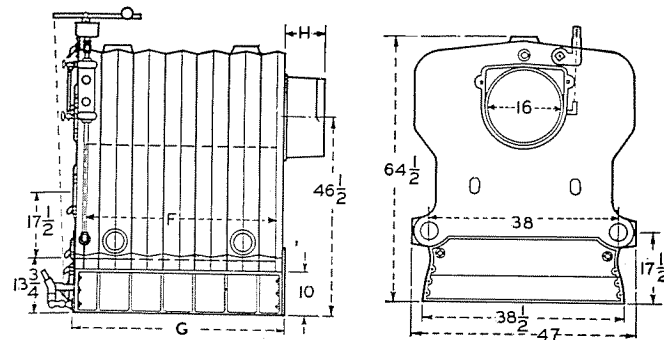

Series No. 32 Steam and Water
Standard Assembly of Boiler Sections

F—Front; L—Low Crown Intermediate, Plain; LT°—Low Crown Intermediate, supply outlet, no return inlet; LR°—Low Crown Intermediate, supply outlet, 2 return inlets (1 on each side); UT°—Low Crown Intermediate, Half Uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangements of Sections
Steam

| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | Shaking Grates | |
|---------------|---|-----|---|-----|-----|-----|-----|-----|---|----------------|-------|
| | | | | | | | | | | Left | Right |
| S-532 | F | LT° | L | UT° | B | | | | | 2 | 2 |
| S-632 | F | LT° | L | L | UT° | B | | | | 3 | 2 |
| S-732 | F | LT° | L | L | L | UT° | B | | | 3 | 3 |
| S-832 | F | LT° | L | L | L | L | UT° | B | | 4 | 3 |
| S-932 | F | LT° | L | L | LT° | L | L | UT° | B | 4 | 4 |

Water

| | | | | | | | | | | | |
|-------|---|-----|---|-----|-----|-----|-----|-----|---|---|---|
| W-532 | F | LR° | L | UT° | B | | | | | 2 | 2 |
| W-632 | F | LR° | L | L | UT° | B | | | | 3 | 2 |
| W-732 | F | LR° | L | L | L | UT° | B | | | 3 | 3 |
| W-832 | F | LR° | L | L | L | L | UT° | B | | 4 | 3 |
| W-932 | F | LR° | L | L | LT° | L | L | UT° | B | 4 | 4 |


(°) after key letter indicates section has supply outlet tapping.

Center to center distance between sections is 8 $\frac{1}{4}$ ".

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

Series No. 42
Steam and Water

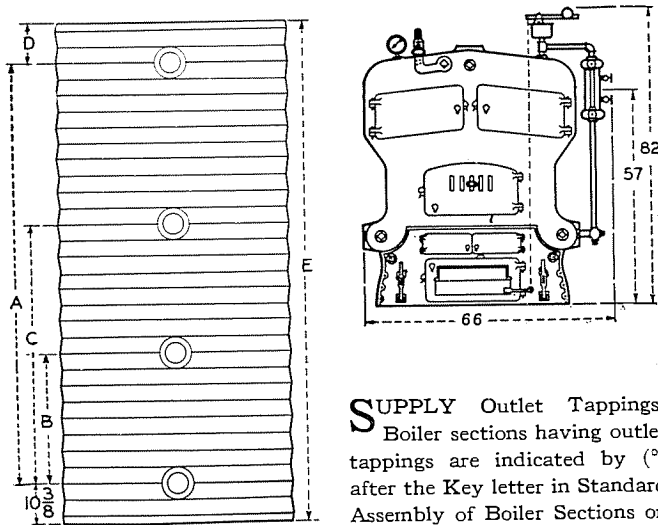

SUPPLY Outlet Tappings:
Boiler sections having outlet
tappings are indicated by (°)
after the Key letter in Standard
Assembly of Boiler Sections on
pages 78-79. Distance from cen-

ter of one section to center of section next to it is $8\frac{1}{4}$ inches.


Steam Inlet Tappings: Two 4" in rear of back section "B". Side return inlets on steam boilers are only furnished on special order.

Water Return Inlet Tappings: Two 4" in rear of back section "B". Additional 5" return tappings on both sides of each intermediate supply outlet section "LR".

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional $1\frac{1}{2}$ inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

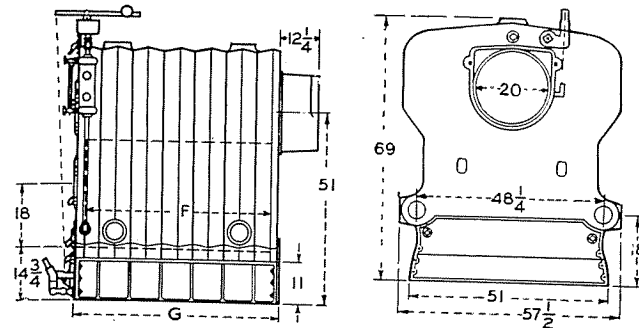

Series No. 42
Steam and Water Dimensions

| Boiler Number | A | B | C | D | E | F | G |
|---------------|-------------------|-------------------|-------------------|-------------------|--------------------|-------------------|--------------------|
| 642 | $24\frac{3}{4}$ " | | | $10\frac{3}{8}$ " | $45\frac{1}{2}$ " | $40\frac{3}{4}$ " | 47 " |
| 742 | 33 " | | | $10\frac{3}{8}$ " | $53\frac{3}{4}$ " | 49 " | $55\frac{1}{4}$ " |
| 842 | $41\frac{1}{4}$ " | $16\frac{1}{2}$ " | | $10\frac{3}{8}$ " | 62 " | $57\frac{1}{4}$ " | $63\frac{1}{2}$ " |
| 942 | $49\frac{1}{2}$ " | $24\frac{3}{4}$ " | | $10\frac{3}{8}$ " | $70\frac{1}{4}$ " | $65\frac{1}{2}$ " | $71\frac{3}{4}$ " |
| 1042 | $57\frac{3}{4}$ " | 33 " | | $10\frac{3}{8}$ " | $78\frac{1}{2}$ " | $73\frac{3}{4}$ " | 80 " |
| 1142 | 66 " | $41\frac{1}{4}$ " | | $10\frac{3}{8}$ " | $86\frac{3}{4}$ " | 82 " | $88\frac{1}{4}$ " |
| 1242 | $74\frac{1}{4}$ " | $24\frac{3}{4}$ " | $49\frac{1}{2}$ " | $10\frac{3}{8}$ " | 95 " | $73\frac{3}{4}$ " | $96\frac{1}{2}$ " |
| 1342 | $82\frac{1}{2}$ " | $24\frac{3}{4}$ " | $49\frac{1}{2}$ " | $10\frac{3}{8}$ " | $103\frac{1}{4}$ " | 82 " | $104\frac{3}{4}$ " |
| 1442 | $82\frac{1}{2}$ " | $24\frac{3}{4}$ " | $49\frac{1}{2}$ " | $18\frac{3}{8}$ " | $111\frac{1}{2}$ " | 82 " | 113 " |
| 1542 | $90\frac{3}{4}$ " | $24\frac{3}{4}$ " | $49\frac{1}{2}$ " | $18\frac{3}{8}$ " | $119\frac{3}{4}$ " | 82 " | $121\frac{1}{4}$ " |
| 1642 | 99 " | 33 " | $57\frac{3}{4}$ " | $18\frac{3}{8}$ " | 128 " | $90\frac{1}{4}$ " | $129\frac{1}{2}$ " |

Measurements subject to slight variations in assembly.
Ashpit and foundation measurements are given on page 89.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

Series No. 42
Standard Assembly of Boiler Sections

F—Front; XT°—Low crown intermediate, crossover flue next to front, supply outlet, no return inlet; L—Low crown intermediate, plain; LT°—Low crown intermediate, supply outlet, no return inlet; H—High crown intermediate, plain; K—Bridge-wall; UT°—Low crown intermediate, half uptake, supply outlet, no return inlet; W—Low crown intermediate, full uptake, plain; WT°—Low crown intermediate, full uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangement of Sections
Steam Boilers

| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | Shaking Grates | |
|---------------|---|-----|---|---|-----|---|-----|---|-----|----|-----|----|----|----|----|----|----------------|-------|
| | | | | | | | | | | | | | | | | | Left | Right |
| S-642 | F | LT° | L | L | UT° | B | UT° | B | UT° | B | WT° | B | | | | | 3 | 2 |
| S-742 | F | LT° | L | L | L | L | L | L | L | L | L | L | | | | | 3 | 3 |
| S-842 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 4 | 4 |
| S-942 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 4 | 4 |
| S-1042 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 5 | 4 |
| S-1142 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 5 | 4 |
| S-1242 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| S-1342 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| S-1442 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| S-1542 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| S-1642 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 5 |

(°) after key letter indicates section has supply outlet tapping.
Center to center distance between sections is 8¼ inches.

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS
(Utica Design)

Series No. 42
Standard Assembly of Boiler Sections


F—Front; XT°—Low crown intermediate, crossover flue next to front, supply outlet, no return inlet; L—Low crown intermediate, plain; LR°—Low crown intermediate, supply outlet, 2 return inlets, (1 on each side); H—High crown intermediate, plain; K—Bridge-wall; UT°—Low crown intermediate, half uptake, supply outlet, no return inlet; W—Low crown intermediate, full uptake, plain; WT°—Low crown intermediate, full uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangement of Sections
Water Boilers

| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | Shaking Grates | |
|---------------|---|-----|---|---|-----|---|-----|---|-----|----|-----|----|----|----|----|----|----------------|-------|
| | | | | | | | | | | | | | | | | | Left | Right |
| W-642 | F | LR° | L | L | UT° | B | UT° | B | UT° | B | WT° | B | | | | | 3 | 2 |
| W-742 | F | LR° | L | L | L | L | L | L | L | L | L | L | | | | | 3 | 3 |
| W-842 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 4 | 4 |
| W-942 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 4 | 4 |
| W-1042 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 5 | 4 |
| W-1142 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 5 | 4 |
| W-1242 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 5 | 4 |
| W-1342 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| W-1442 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| W-1542 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 4 |
| W-1642 | F | XT° | L | L | L | L | L | L | L | L | L | L | | | | | 6 | 5 |

(°) after key letter indicates section has supply outlet tapping.
Center to center distance between sections is 8¼ inches.

NATIONAL BONDED NOVUS SECTIONAL BOILERS

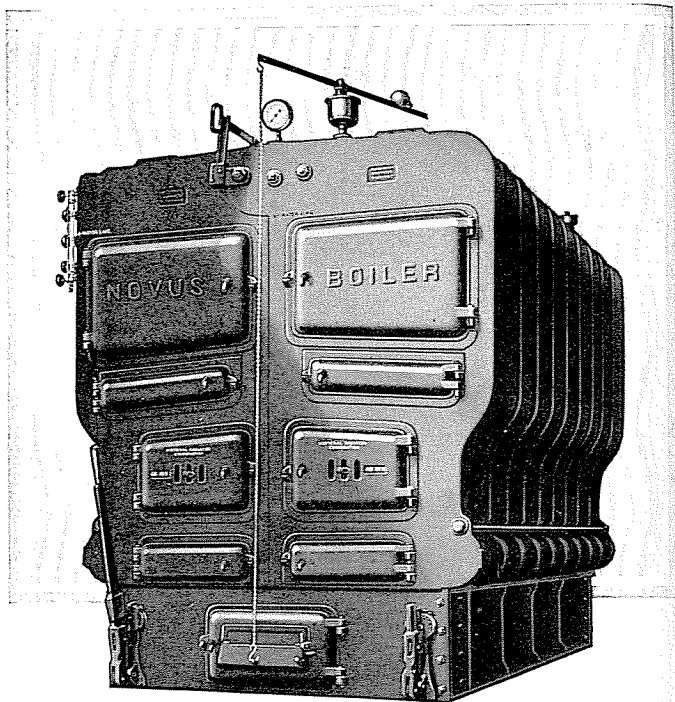

National—No. 48-10-S

THIS substantially constructed heating unit was particularly designed for heavy duty service. It has long been a favorite for schools, hospitals, large apartments and similar structures, where a boiler must have reserve capacity to meet quickly and efficiently sudden demands for heat.


This boiler is made in 6 sizes, and is bonded to heat 3500 to 7000 square feet of steam radiation, and 5750 to 11,500 square feet of hot water radiation.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

United . . .


for service
divided for portability



National Series
No. 48 partially assembled


THE Series 48 National Novus Boiler is made in twin sections, to facilitate handling and assembly. The half sections can be easily carried through the ordinary basement door. Due to this feature, this boiler is widely used to replace broken or worn-out single unit boilers, installed before the building was constructed.

The half sections, because of their relatively low weight, simplify the erection of the boiler. The illustration at the right shows the recommended method of yoking together the two halves of the boiler, to connect with the return main.

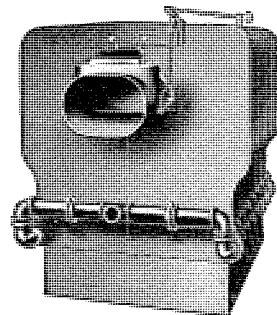

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

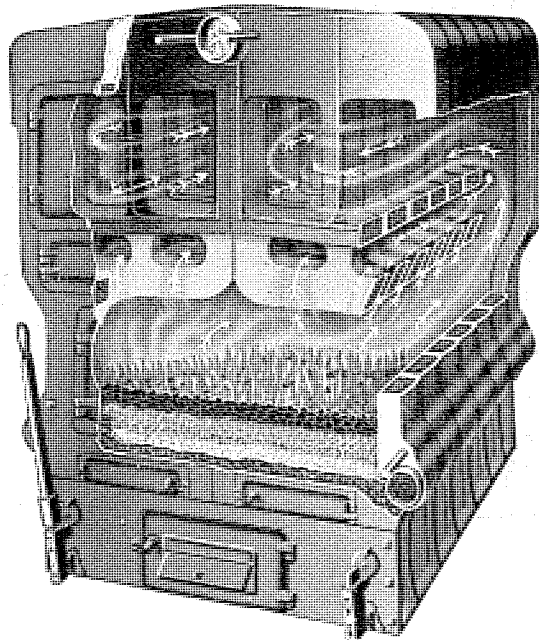

National No. 48-8-S Interior View

A SERIES of ports in the overhanging arch increase the prime heating surface and provide a pathway for the hot gases as they are drawn to the rear of the boiler. From there they are drawn up into the two outer flue-ways, swirl and eddy to the front of the boiler, and then travel back through two central flue-ways. All these flue-ways are easily accessible through large doors, which facilitate cleaning, and permit the boiler to be run at high efficiency at all times.

Complete data and dimensions on pages 84 and 85.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

Many Sizes . . .

But One Rigid
Manufacturing Standard

FROM the smallest 20-series, to the largest 48, each Novus boiler is made in strict conformity to a high and unchanging manufacturing standard. This care makes Novus Boilers easy to assemble on the job into steam-and-water heating units, permanently tight, and that will be dependable and effective.


All metal used in these boilers is carefully tested in metallurgical laboratories to insure uniformity. The Seacoal finish, used on all castings, gives a uniform, smooth surface, free from flaws and defacements. Finishing and machining is done to narrow limits, and unbelievably small tolerances are permitted. Doors are ground to a fit on their frames, to prevent infiltration of air that might cool the fire, or short-circuit the draft.

Sections are tested on special machines, under hydrostatic pressures more than four times as great as the boilers will ordinarily be called upon to carry in actual service.

These things explain the long-continued popularity of Novus Boilers—their outstanding successes in all sorts of applications—their sterling and dependable performance under the most difficult conditions. The very name of Novus is a guarantee of happy satisfaction.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS



Series No. 48—

Sizes and Ratings

For Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers, "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 48-6-S | 7,500 | 3,500 | 17.13 | 2-6" | 2-4" | 20 x 20 | 60 | 110 |
| 48-7-S | 9,000 | 4,200 | 20.68 | 2-6" | 2-4" | 20 x 24 | 65 | 125 |
| 48-8-S | 10,500 | 4,900 | 24.23 | 3-6" | 2-4" | 24 x 24 | 70 | 139 |
| 48-9-S | 12,000 | 5,600 | 27.78 | 3-6" | 2-4" | 24 x 28 | 75 | 153 |
| 48-10-S | 13,500 | 6,300 | 31.33 | 3-6" | 2-4" | 24 x 28 | 75 | 167 |
| 48-11-S | 15,000 | 7,000 | 34.88 | 4-6" | 2-4" | 28 x 28 | 80 | 182 |

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 6-48-W | 12,100 | 5,750 | 17.13 | 2-6" | 2-6" | 20 x 20 | 60 | 110 |
| 7-48-W | 14,500 | 6,900 | 20.68 | 2-6" | 2-6" | 20 x 24 | 65 | 125 |
| 8-48-W | 17,000 | 8,050 | 24.23 | 3-6" | 2-6" | 24 x 24 | 70 | 139 |
| 9-48-W | 19,300 | 9,200 | 27.78 | 3-6" | 2-6" | 24 x 28 | 75 | 153 |
| 10-48-W | 21,700 | 10,350 | 31.33 | 3-6" | 2-6" | 24 x 28 | 75 | 167 |
| 11-48-W | 24,100 | 11,500 | 34.88 | 4-6" | 2-6" | 28 x 28 | 80 | 182 |

† Square feet of exterior boiler surface. Approximately 114 pounds of insulation per section required to provide boiler covering $1\frac{1}{2}$ inches thick.

*In addition to the inlets listed above there are two 4" on the back section which must be yoked together.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED NOVUS SECTIONAL BOILERS

Measurements subject to slight variations in assembly. Clear width of fire box 48 inches; maximum width $49\frac{1}{4}$ inches. Side tappings on center diagram are return inlet tappings in section "R" of water boilers only. Oval smoke collar is equivalent to 20 inch round, top or rear outlet. Asphalt and foundation measurements are shown on page 88.

| Boiler Numbers | A | | B | | C | | D | | Fire Box Length |
|----------------|---------------------|--|---------------------|--|-------------|--|-------------|--|----------------------|
| | Area Inches | | Height Feet | | Area Inches | | Height Feet | | |
| 48-6-S | 59 $1\frac{1}{8}$ " | | 31 $1\frac{1}{2}$ " | | | | | | 50 $3\frac{1}{4}$ " |
| 48-7-S | 69 $5\frac{8}$ " | | 42" | | | | | | 61 $1\frac{1}{4}$ " |
| 48-8-S | 80 $1\frac{8}$ " | | 52 $1\frac{1}{2}$ " | | | | | | 71 $3\frac{1}{4}$ " |
| 48-9-S | 90 $5\frac{8}$ " | | 63" | | | | | | 82 $1\frac{1}{4}$ " |
| 48-10-S | 101 $1\frac{8}$ " | | 73 $1\frac{1}{2}$ " | | | | | | 92 $3\frac{1}{4}$ " |
| 48-11-S | 111 $5\frac{8}$ " | | 84" | | | | | | 103 $1\frac{1}{4}$ " |

Series No. 48—Steam and Water Dimensions

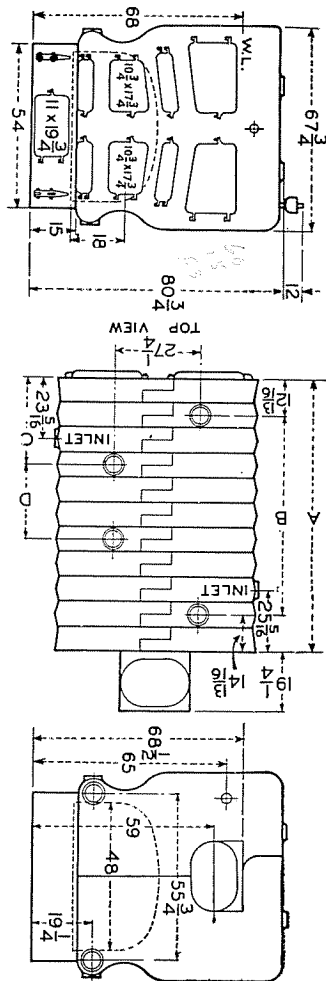

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Series No. 48

Standard Assembly of Boiler Sections

LF—Left front; RF—Right front; I—Intermediate plain; T°—Intermediate supply outlet, no return inlets; TU°—Left next to back half uptake, supply outlet, no return inlets; IU—Right next to back half uptake, plain; LB—Left back, 1 return inlet; RB—Right back, 1 return inlet.

Arrangement of Sections—Steam Boilers

| Arrangement of Sections Left Half | | | Arrangement of Sections Right Half | | |
|-----------------------------------|------------------|------------|------------------------------------|------------------|------------|
| No. Back Grates | No. Front Grates | Boiler No. | No. Back Grates | No. Front Grates | Boiler No. |
| 1 | 1 | 48-6 | 1 | 1 | 48-6 |
| 2 | 3 | 48-7 | 2 | 3 | 48-7 |
| 3 | 4 | 48-8 | 3 | 4 | 48-8 |
| 4 | 4 | 48-9 | 4 | 4 | 48-9 |
| 5 | 5 | 48-10 | 5 | 5 | 48-10 |
| 1 | 1 | 48-11 | 1 | 1 | 48-11 |

Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it is 10½ inches.

Return Inlet Tappings: One 4" in rear of right back section "RB" and one 4" in rear of left back section "LB" which must be yoked together.

Complete dimensions and center to center distance between tappings are shown on page 85.

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1½ inch tappings located on outside of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

Series No. 48

Standard Assembly of Boiler Sections

LF—Left front; RF—Right front; I—Intermediate plain; T°—Intermediate supply outlet, no return inlets; R—Intermediate, no supply outlet, 1 return inlet on right or left side (section Reversible); TU°—Left next to back half uptake, supply outlet, no return inlet; IU—Right next to back half uptake, plain; LB—Left back, 1 return inlet; RB—Right back, 1 return inlet.

Arrangement of Sections—Water Boilers

| Arrangement of Sections Left Half | | | Arrangement of Sections Right Half | | |
|-----------------------------------|------------------|------------|------------------------------------|------------------|------------|
| No. Back Grates | No. Front Grates | Boiler No. | No. Back Grates | No. Front Grates | Boiler No. |
| 1 | 1 | 48-6 | 1 | 1 | 48-6 |
| 2 | 3 | 48-7 | 2 | 3 | 48-7 |
| 3 | 4 | 48-8 | 3 | 4 | 48-8 |
| 4 | 4 | 48-9 | 4 | 4 | 48-9 |
| 5 | 5 | 48-10 | 5 | 5 | 48-10 |
| 1 | 1 | 48-11 | 1 | 1 | 48-11 |


Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections. Distance from center of one section to center of section next to it is 10½ inches.

Return Inlet Tappings: One 4" in rear of right back section "RB" and one 4" in rear of left back section "LB" which must be yoked together. One additional return tapping on side of intermediate section "R."

Complete dimensions and center to center distance between tappings are shown on page 85.

NATIONAL BONDED NOVUS SECTIONAL BOILERS

Series No. 20, 25 and 48 Foundation and Pitting Dimensions

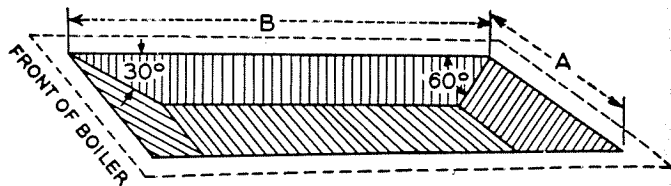

WARPED and burned grate bars are in practically all cases due to the accumulation of ashes under grates. As a safety factor it is recommended that an ash pit similar to the above sketch be constructed. When basement floor is not yet laid, surround pit with foundation 10 to 12 inches wide. Complete dimensions are given below. A—width of ashpit. B—length of ashpit.

Series No. 20 Novus Sectional Boilers

| Boiler Numbers | | A | B | Depth of Pit |
|----------------|--------|-----|--------------------|--------------|
| 20-5-S | 5-20-W | 17" | 25" | 10" |
| 20-6-S | 6-20-W | 17" | 30 $\frac{3}{4}$ " | 10" |
| 20-7-S | 7-20-W | 17" | 36 $\frac{1}{2}$ " | 10" |
| 20-8-S | 8-20-W | 17" | 42 $\frac{1}{4}$ " | 10" |

Series No. 25 Novus Sectional Boilers

| | | | | |
|--------|--------|--------------------|--------------------|-----|
| 25-5-S | 5-25-W | 22 $\frac{1}{2}$ " | 30" | 10" |
| 25-6-S | 6-25-W | 22 $\frac{1}{2}$ " | 36 $\frac{3}{4}$ " | 10" |
| 25-7-S | 7-25-W | 22 $\frac{1}{2}$ " | 43 $\frac{3}{4}$ " | 10" |
| 25-8-S | 8-25-W | 22 $\frac{1}{2}$ " | 50 $\frac{1}{2}$ " | 10" |
| 25-9-S | 9-25-W | 22 $\frac{1}{2}$ " | 57 $\frac{1}{2}$ " | 10" |


Series No. 48 Novus Sectional Boilers

| | | | | |
|---------|---------|-----|--------------------|-----|
| 48-6-S | 6-48-W | 45" | 52 $\frac{1}{2}$ " | 12" |
| 48-7-S | 7-48-W | 45" | 63" | 12" |
| 48-8-S | 8-48-W | 45" | 73 $\frac{1}{2}$ " | 12" |
| 48-9-S | 9-48-W | 45" | 84" | 12" |
| 48-10-S | 10-48-W | 45" | 94 $\frac{1}{2}$ " | 12" |
| 48-11-S | 11-48-W | 45" | 105" | 12" |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED IMPERIAL SECTIONAL BOILERS (Utica Design)

Series No. 32 and 42 Foundation and Pitting Dimensions

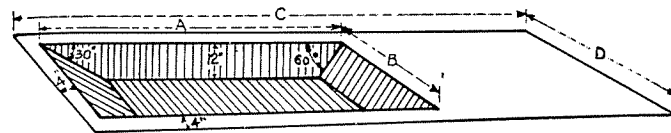

| Boiler Number | Measurements of Pit Under Ash Pit (In Inches) | | Dimensions of Foundation (In Inches) | |
|---------------|---|---|--------------------------------------|---|
| | A | B | C | D |

Series No. 32 National Imperial Sectional Boiler

| | | | | |
|-----|--------------------|--------------------|--------------------|--------------------|
| 532 | 34" | 33 $\frac{1}{2}$ " | 43 | 41 $\frac{1}{2}$ " |
| 632 | 42 $\frac{1}{4}$ " | 33 $\frac{1}{2}$ " | 51 $\frac{1}{4}$ " | 41 $\frac{1}{2}$ " |
| 732 | 50 $\frac{1}{2}$ " | 33 $\frac{1}{2}$ " | 59 $\frac{1}{2}$ " | 41 $\frac{1}{2}$ " |
| 832 | 58 $\frac{3}{4}$ " | 33 $\frac{1}{2}$ " | 67 $\frac{3}{4}$ " | 41 $\frac{1}{2}$ " |
| 932 | 67" | 33 $\frac{1}{2}$ " | 76" | 41 $\frac{1}{2}$ " |


Series No. 42 National Imperial Sectional Boiler

| | | | | |
|------|--------------------|----|---------------------|----|
| 642 | 42 $\frac{1}{4}$ " | 46 | 51 $\frac{1}{4}$ " | 54 |
| 742 | 50 $\frac{1}{2}$ " | 46 | 59 $\frac{1}{2}$ " | 54 |
| 842 | 58 $\frac{3}{4}$ " | 46 | 67 $\frac{3}{4}$ " | 54 |
| 942 | 67" | 46 | 76" | 54 |
| 1042 | 75 $\frac{1}{4}$ " | 46 | 84 $\frac{1}{4}$ " | 54 |
| 1142 | 83 $\frac{1}{2}$ " | 46 | 92 $\frac{1}{2}$ " | 54 |
| 1242 | 75 $\frac{1}{4}$ " | 46 | 100 $\frac{3}{4}$ " | 54 |
| 1342 | 83 $\frac{1}{2}$ " | 46 | 109" | 54 |
| 1442 | 83 $\frac{1}{2}$ " | 46 | 117 $\frac{1}{4}$ " | 54 |
| 1542 | 83 $\frac{1}{2}$ " | 46 | 125 $\frac{1}{2}$ " | 54 |
| 1642 | 91 $\frac{3}{4}$ " | 46 | 133 $\frac{3}{4}$ " | 54 |

When basement floor is not yet laid, surround pit with foundation 10 to 12 inches wide.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

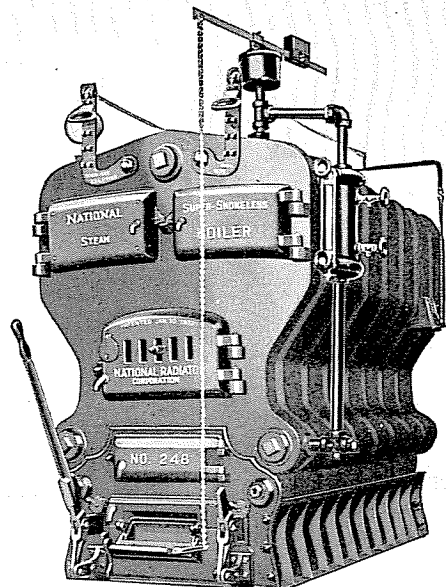

National No. S-248

THE sterling worth and outstanding performance of the large National Super-Smokeless Boilers are matters of common knowledge. Many, however, do not know that this boiler is also made in a small grate width, thus bringing to large residences, small apartments, and similar applications the array of advantages that have made the Super-Smokeless renowned.

The Series No. 24 is made in five sizes, and is bonded to heat from 750 to 1750 square feet of steam radiation and from 1250 to 2850 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

The Standard . . .

By which all other Smokeless
Boilers are Judged


THE National Super-Smokeless Boiler was designed to meet the need for a boiler which would efficiently burn low grades of fuel and that could be easily fired. It was introduced in 1916 as the *Utica Imperial Super-Smokeless Boiler*. It quickly won the endorsement of architects, engineers, trade, and users. With the improvements made by National, it is today the leader in the smokeless boiler field.

So simple and fool-proof is the boiler that even an inexperienced fireman can handle it with excellent results. The coal is fed on the front of the grate, which acts as a gas producer and retort. The volatile matter (often containing as high as 32% of the total heat units in the coal) is then drawn toward the rear of the boiler, to be combined with the secondary air, and completely consumed.

The large amount of prime heating surface, the progressive increase in volume of the combustion area, and the long, rotative swirling travel of the incandescent gases, all contribute to the boiler's outstanding efficiency in burning low grades of fuel—and are of equal value when oil is used as fuel. Ratings and data on the National Super-Smokeless for this type of service are given in detail on pages 165 and 166.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

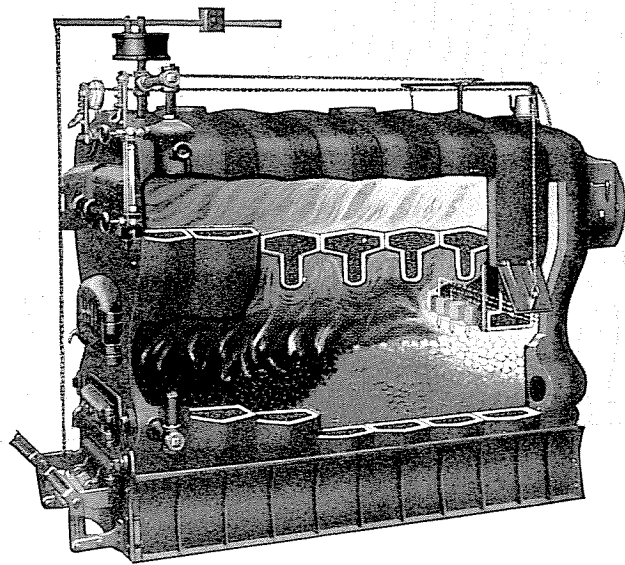

National No. S-248 Interior View

THIS view graphically shows the long, swirling, rotative gas travel that cleans the flues, speeds heat transfer, and boosts efficiency. Note the **PATENTED** baffle section, where the pre-heated secondary air is introduced that causes complete combustion of all the gases.

Complete data and dimensions on pages 96 and 98.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Saves . . .


its cost—
bans a nuisance

WHEN the National Super-Smokeless Boiler is used, all objectionable smoke is burned, and so a nuisance is abated. But in addition there is an outstanding saving in fuel cost. In the ordinary boiler, which operates at an efficiency of less than 60%, the smoke carries with it up the stack a large number of unconsumed heat units. The National Super-Smokeless Boiler utilizes a large proportion of these units which the ordinary boiler wastes, resulting in a startling increase in efficiency. An increase of only 10% in the efficiency, at this range, saves about 15 tons out of every one hundred fired. For if a boiler is called on to deliver all the heat contained in 60 tons of coal, at an efficiency of 60%, 100 tons must be burned to provide it. At 70% efficiency only 6/7 as much coal—or about 85 tons—need be used. This makes the saving 15 tons.

Accessories furnished with the National Super-Smokeless Boiler are of proved dependability. For the steam boiler there is furnished an all-metal, all-inclosed damper regulator, sensitive and husky; a Bourdon tube-type retard gauge, with water seal and non-glare dial; a gauge glass; tri-cocks; an A. S. M. E. pop safety valve; and firing tools. The water boiler is not furnished with accessories, except fire tools.

NATIONAL **MADE-TO-MEASURE** HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

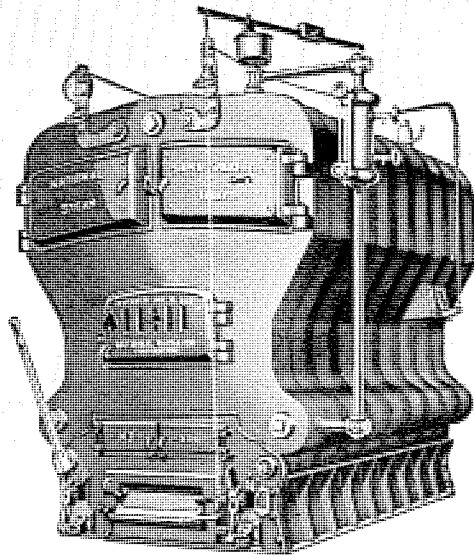

National No. S-339

THE superior design of the Utica Imperial Super-Smokeless Boiler was quickly recognized when the boiler was first introduced more than fourteen years ago, and the Super-Smokeless soon became the standard of all smokeless boilers. It has maintained this leadership because of fuel economy, ease of firing, and dependability.

The Series 33 is made in six sizes, and is bonded to heat from 1300 to 3050 square feet of steam radiation, and from 2150 to 5025 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Distinguished . . .
for, and by, its
swirling scarlet flame


BECAUSE of the exclusive design of the National Super-Smokeless Boiler, the gases are induced to travel in a rapid, swirling rotative manner. The nominal travel is twice the length of the boiler, but because of the rotative travel, the fire travel is actually much longer. The hot gases in their course constantly rub against the walls of the flue ways, resulting in a high rate of heat absorption. This constant rubbing has another effect, also; the swirling gases "scour" the walls of the flues, keeping them clean.

This last feature is highly important, as soot is a highly objectionable insulator. Neglect in cleaning it out of ordinary boilers frequently decreases efficiency as much as 25%. In the Super-Smokeless Boiler, the dependence on the human element is minimized, as the boiler practically cleans itself.

The swirling scarlet flame that spins through the flues of the National Super-Smokeless is a sight that impresses everyone who sees it. It implies a promise of efficiency that the boiler in practice, abundantly fulfills. For it, and by it, the National Super-Smokeless Boiler is distinguished.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

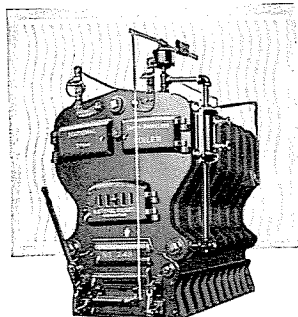

Series No. 24
Sizes and Ratings

For
Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| S-245 | 1,600 | 750 | 5.00 | 1-4" | 2-3" | 12 x 12 | 40 | 34 |
| S-246 | 2,000 | 1,000 | 6.25 | 2-4" | 2-3" | 13 x 13 | 40 | 42 |
| S-247 | 2,400 | 1,250 | 7.50 | 2-4" | 2-3" | 13 x 13 | 45 | 50 |
| S-248 | 2,800 | 1,500 | 8.75 | 2-4" | 2-3" | 14 x 14 | 50 | 58 |
| S-249 | 3,200 | 1,750 | 10.00 | 3-4" | 2-3" | 14 x 14 | 55 | 64 |

Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets No. and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| W-245 | 2,600 | 1,250 | 5.00 | 1-4" | 2-3" 2-4" | 12 x 12 | 40 | 34 |
| W-246 | 3,250 | 1,650 | 6.25 | 2-4" | 2-3" 2-4" | 13 x 13 | 40 | 42 |
| W-247 | 3,900 | 2,050 | 7.50 | 2-4" | 2-3" 2-4" | 13 x 13 | 45 | 50 |
| W-248 | 4,550 | 2,450 | 8.75 | 2-4" | 2-3" 2-4" | 14 x 14 | 50 | 58 |
| W-249 | 5,200 | 2,850 | 10.00 | 3-4" | 2-3" 2-4" | 14 x 14 | 55 | 64 |

† Square feet of exterior boiler surface. Approximately 50 pounds of insulation per section required to provide boiler covering 1½ inches thick. 100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Series No. 33
Sizes and Ratings

For
Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

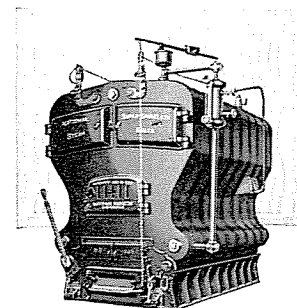

Steam

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| S-335 | 2,900 | 1,300 | 7.32 | 1-5" | 2-4" | 14 x 14 | 40 | 42 |
| S-336 | 3,600 | 1,650 | 9.10 | 2-5" | 2-4" | 15 x 15 | 40 | 51 |
| S-337 | 4,300 | 2,000 | 10.87 | 2-5" | 2-4" | 16 x 16 | 40 | 60 |
| S-338 | 5,000 | 2,350 | 12.65 | 2-5" | 2-4" | 16 x 16 | 50 | 69 |
| S-339 | 5,700 | 2,700 | 14.42 | 3-5" | 2-4" | 18 x 18 | 50 | 78 |
| S-3310 | 6,400 | 3,050 | 16.20 | 3-5" | 2-4" | 18 x 18 | 55 | 87 |


Water

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets No. and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| W-335 | 4,650 | 2,150 | 7.32 | 1-5" | 2-4" 2-5" | 14 x 14 | 40 | 42 |
| W-336 | 5,800 | 2,725 | 9.10 | 2-5" | 2-4" 2-5" | 15 x 15 | 40 | 51 |
| W-337 | 6,950 | 3,300 | 10.87 | 2-5" | 2-4" 2-5" | 16 x 16 | 40 | 60 |
| W-338 | 8,100 | 3,875 | 12.65 | 2-5" | 2-4" 2-5" | 16 x 16 | 50 | 69 |
| W-339 | 9,250 | 4,450 | 14.42 | 3-5" | 2-4" 2-5" | 18 x 18 | 50 | 78 |
| W-3310 | 10,400 | 5,025 | 16.20 | 3-5" | 2-4" 2-5" | 18 x 18 | 55 | 87 |

† Square feet of exterior boiler surface. Approximately 60 pounds of insulation per section required to provide boiler covering 1½ inches thick. 100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

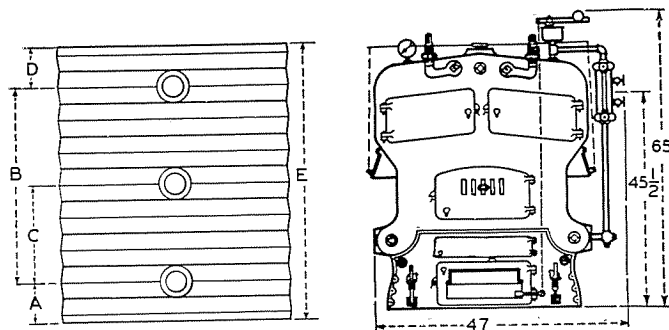

Series No. 24
Steam and Water Dimensions

| Boiler Number | A | B | C | D | E | F | G | H |
|---------------|---------|---------|---------|---------|---------|---------|---------|--------|
| 245 | 18 5/8" | | | 18 5/8" | 37 1/4" | 32 1/2" | 38 1/4" | 9 1/2" |
| 246 | 10 3/8" | 16 1/2" | | 18 5/8" | 45 1/2" | 40 3/4" | 46 1/2" | 9 1/2" |
| 247 | 10 3/8" | 24 3/4" | | 18 5/8" | 53 3/4" | 49" | 54 3/4" | 9 1/2" |
| 248 | 10 3/8" | 33" | | 18 5/8" | 62" | 57 1/4" | 63" | 9 1/2" |
| 249 | 10 3/8" | 41 1/4" | 24 3/4" | 18 5/8" | 70 1/4" | 65 1/2" | 71 1/4" | 9 1/2" |

Measurements are subject to slight variations in assembly.

Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter in Standard Assembly of Boiler Sections on page 99. Distance from center of one section to center of section next to it is 8 1/4 inches.


Steam Return Inlet Tappings: Two 3" in rear of back section "B". Side return inlets on steam boilers are only furnished on special order.

Water Return Inlet Tappings: Two 3" in rear of back section "B". Additional 4" return tappings on each side of intermediate section "LR".

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1 1/2 inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

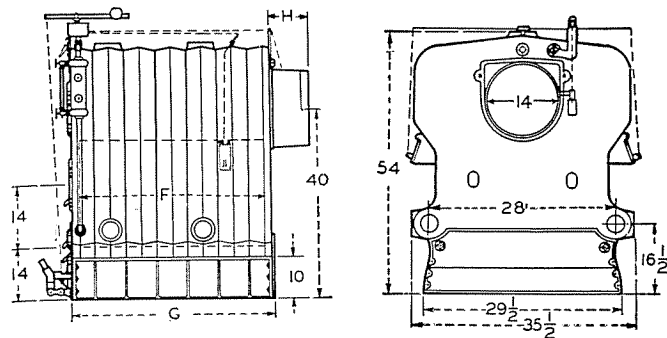

Series No. 24
Standard Assembly of Boiler Sections

F—Front; L—Low crown intermediate, plain; LT°—Low crown intermediate, supply outlet, no return inlet; LR°—Low crown intermediate, supply outlet, 2 return inlets (1 on each side); AU—Baffle, air gates, half-uptake, plain; B—Back, 2 return inlets on rear.

Arrangement of Sections
Steam Boilers

| Boiler Number | Shaking Grates | | | | | | | | | | |
|---------------|----------------|-----|-----|-----|-----|-----|-----|----|---|------|-------|
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | Left | Right |
| S-245 | F | L | LT° | AU | B | | | | | 2 | 2 |
| S-246 | F | LT° | L | LT° | AU | B | | | | 3 | 2 |
| S-247 | F | LT° | L | L | LT° | AU | B | | | 3 | 3 |
| S-248 | F | LT° | L | L | L | LT° | AU | B | | 4 | 3 |
| S-249 | F | LT° | L | L | LT° | L | LT° | AU | B | 4 | 4 |

Water Boilers


| | | | | | | | | | | | |
|-------|---|-----|-----|-----|-----|-----|-----|----|---|---|---|
| W-245 | F | L | LR° | AU | B | | | | | 2 | 2 |
| W-246 | F | LT° | L | LR° | AU | B | | | | 3 | 2 |
| W-247 | F | LT° | L | L | LR° | AU | B | | | 3 | 3 |
| W-248 | F | LT° | L | L | L | LR° | AU | B | | 4 | 3 |
| W-249 | F | LT° | L | L | LT° | L | LR° | AU | B | 4 | 4 |

(°) after key letter indicates section has supply outlet tapping.

Center to center distance between sections is 8 1/4 inches.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

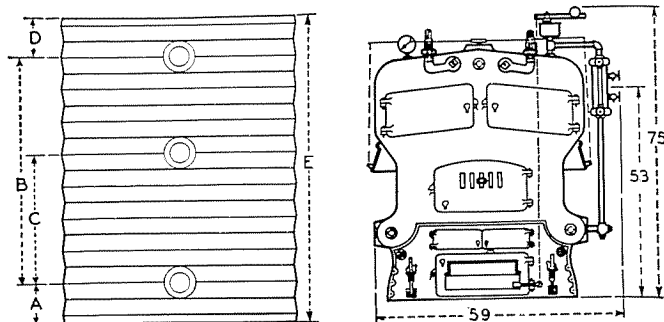

Series No. 33

Steam and Water Dimensions

| Boiler Number | A | B | C | D | E | F | G | H |
|---------------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|----------------------------------|
| 335 | 18 ⁵ / ₈ " | | | 18 ⁵ / ₈ " | 37 ¹ / ₄ " | 32 ¹ / ₂ " | 38 ¹ / ₄ " | 10 ¹ / ₂ " |
| 336 | 10 ³ / ₈ " | 16 ¹ / ₂ " | | 18 ³ / ₈ " | 45 ¹ / ₂ " | 40 ³ / ₄ " | 46 ¹ / ₂ " | 10 ¹ / ₂ " |
| 337 | 10 ³ / ₈ " | 24 ³ / ₄ " | | 18 ³ / ₈ " | 53 ³ / ₄ " | 49 | 54 ³ / ₄ " | 10 ¹ / ₂ " |
| 338 | 10 ³ / ₈ " | 24 ³ / ₄ " | | 26 ⁷ / ₈ " | 62 | 57 ¹ / ₄ " | 63 | 10 ¹ / ₂ " |
| 339 | 10 ³ / ₈ " | 49 ¹ / ₂ " | 24 ³ / ₄ " | 10 ³ / ₈ " | 70 ¹ / ₄ " | 65 ¹ / ₂ " | 71 ¹ / ₄ " | 10 ¹ / ₂ " |
| 3310 | 10 ³ / ₈ " | 57 ³ / ₄ " | 24 ³ / ₄ " | 10 ³ / ₈ " | 78 ¹ / ₂ " | 73 ³ / ₄ " | 79 ¹ / ₂ " | 10 ¹ / ₂ " |

Measurements subject to slight variations in assembly.

Ashpit and foundation measurements are shown on page 122.


Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letters, in Standard Assembly of Boiler Sections on page 101. Distance from center of one section to center of section next to it is 8¹/₄ inches.

Steam Return Inlet Tappings: Two 4" in rear of back section "B". Side return inlets on steam boilers are only furnished on special order.

Water Return Inlet Tappings: Two 4" in rear of back section "B". Additional 5" return inlets on each side of intermediate supply outlet section "HR".

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1¹/₂ inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

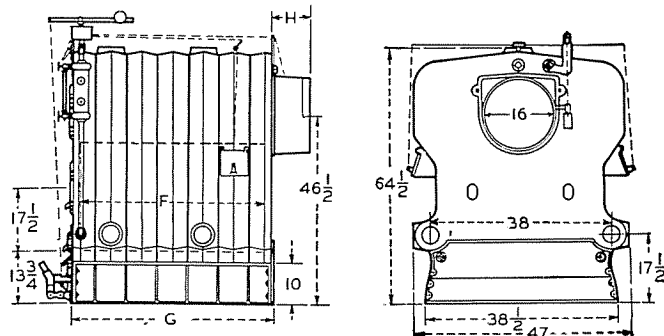

Series No. 33

Standard Assembly of Boiler Sections

F—Front; L—Low Crown intermediate, plain; LT[°]—Low Crown intermediate, supply outlet, no return inlet; H—High crown intermediate, plain; HT[°]—High crown intermediate, supply outlet, no return inlet; HR[°]—High crown intermediate, supply outlet, 2 return inlets (1 on each side); A—Baffle, air gates, plain; AU—Baffle, air gates, half uptake, plain; WT[°]—Low crown intermediate, full uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangement of Sections
Steam Boilers


| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | Shaking Grates | |
|---------------|---|-----------------|-----------------|-----------------|-----------------|----|----|-----------------|-----------------|----|----------------|-------|
| | | | | | | | | | | | Left | Right |
| S-335 | F | L | HT [°] | AU | B | | | | | | | |
| S-336 | F | LT [°] | L | HT [°] | AU | B | | | | | 2 | 2 |
| S-337 | F | LT [°] | L | L | HT [°] | AU | B | | | | 3 | 3 |
| S-338 | F | LT [°] | L | L | HT [°] | H | AU | B | | | 4 | 3 |
| S-339 | F | LT [°] | L | L | HT [°] | H | A | WT [°] | B | | 4 | 4 |
| S-3310 | F | LT [°] | L | L | HT [°] | H | H | A | WT [°] | B | 5 | 4 |

Water Boilers

| | | | | | | | | | | | | |
|--------|---|-----------------|-----------------|-----------------|-----------------|----|----|-----------------|-----------------|---|---|---|
| W-335 | F | L | HR [°] | AU | B | | | | | | 2 | 2 |
| W-336 | F | LT [°] | L | HR [°] | AU | B | | | | | 3 | 2 |
| W-337 | F | LT [°] | L | L | HR [°] | AU | B | | | | 3 | 3 |
| W-338 | F | LT [°] | L | L | HR [°] | H | AU | B | | | 4 | 3 |
| W-339 | F | LT [°] | L | L | HR [°] | H | A | WT [°] | B | | 4 | 4 |
| W-3310 | F | LT [°] | L | L | HR [°] | H | H | A | WT [°] | B | 5 | 4 |

(°) after key letter indicates section has supply outlet tapping. Center to center distance between sections is 8¹/₄ inches.

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

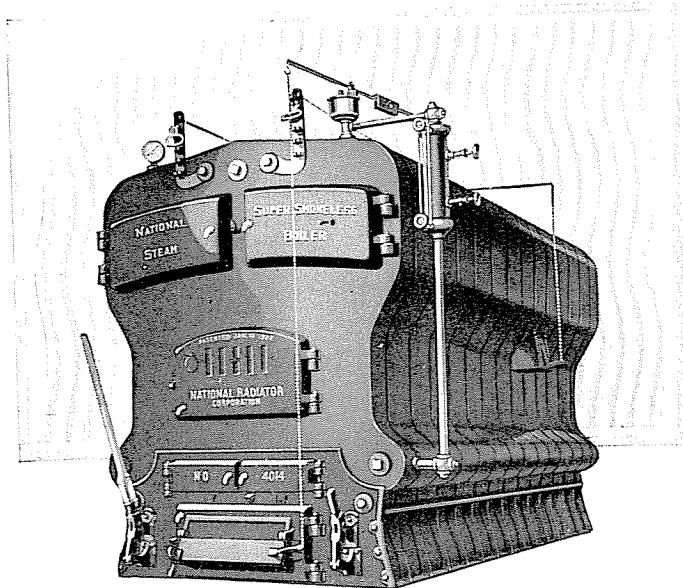

National No. S-4014

THE popularity of the National Super-Smokeless is easily apparent even to those unfamiliar with its outstanding qualities, when they learn of its ability to pay for itself through savings. By totally consuming the fuel, it effects economies that soon cancel its cost.

The Series 40 is made in nineteen sizes, and is bonded to heat from 2300 to 10,700 square feet of steam radiation and from 3795 to 17,655 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Primary . . .

reasons for
secondary air


THE oxygen contained in 14 pounds of air is required to properly consume one pound of coal. However, only seven pounds of this air can be obtained and properly utilized through the fuel bed. Increasing the amount, by increasing the draft, merely makes the coal burn faster, and does not increase the amount of air available to each pound of coal.

The necessary additional seven pounds must be furnished *over* the fuel bed, and in a certain, scientifically developed manner, or it will defeat its own purpose.

The air must be pre-heated. This is accomplished in the National Super-Smokeless by passing it through the patented baffle section which is exposed to the hot flames. The air must be mixed intimately with the hot gases. This is accomplished by delivering it in fine, high velocity jets, distributed across the whole width of the fire box. The additional oxygen in the pre-heated air causes the gases to burn at exceedingly high temperatures. This combustion takes place in the secondary combustion chamber, where there is a large amount of overhanging direct fire surface to absorb the intense heat.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS

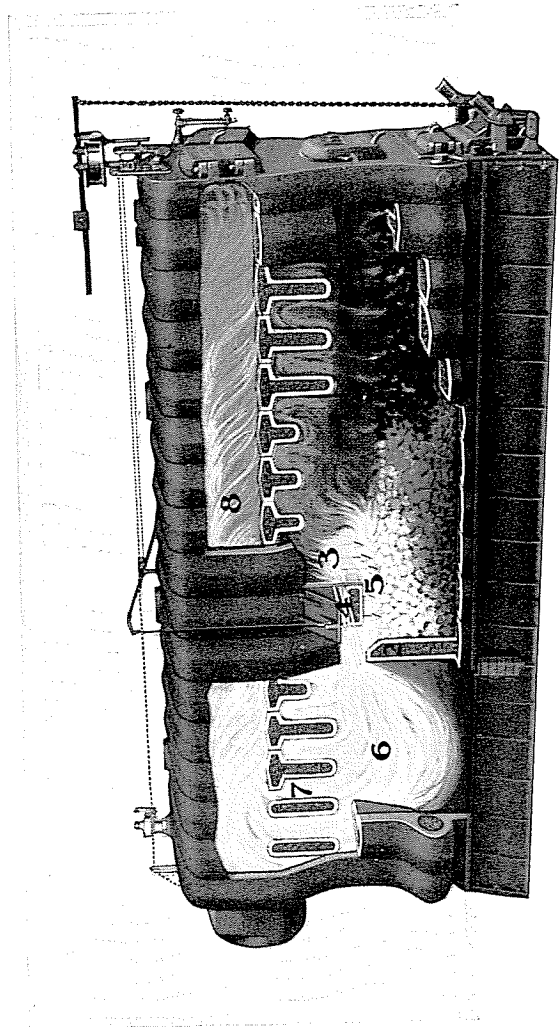

National No. S-4017 Interior View

Two-stage combustion eliminates smoke, boosts efficiency, in burning any kind of fuel. The internal construction of the 33 series Super-Smokeless boiler is practically identical with the 40 series illustrated above, the only difference being the smaller grate width. Complete data and dimensions, No. 33 series on pages 97 and 100; No. 40 Series, pages 108-9 and 111.

NATIONAL BONDED SUPER-SMOKELESS BOILERS

(Utica Design)

Efficiency . . .

and its how
and why

(Figures refer to corresponding figures on interior view of coal-burning boiler on page 104.)

1. *The Primary Combustion Chamber*, into the front of which the fresh coal is supplied, and in which the rich, oily volatile gases are distilled from the green fuel.
2. *Bridgewall Section* which is furnished in boilers having 13 or more sections. This section backs up the fuel bed in long boilers.
3. *Hot Blast Duct* which, for each pound of coal burned, supplies to the volatile gases seven pounds of pre-heated air in fine jets.
4. *Water Curtain or Baffle* which protects the hot blast duct, insures its long life, and properly checks the gases in their passage from primary to secondary combustion chamber.



NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)

Figures refer to corresponding figures on interior view of coal burning boiler on page 104.

5. *The Gases* here pass from the Primary into the Secondary combustion chamber, and at this point the additional oxygen essential to complete combustion is supplied.

6. *The Secondary Combustion Chamber* in which the combustion of the gases is completed. In this chamber a gas temperature is obtained higher than has hitherto been possible in any similar type of boiler.

7. *Overhanging Fire Surface* extending downward into the hottest part of the combustion zone—extremely valuable heating surface which helps to boost efficiency.

8. *Rotative Gas Travel*—Note carefully the long, forward-and-back, swirling travel of the hot gases—an *exclusive* SUPER-SMOKELESS feature. This scouring effect results in bringing a much larger portion of the gases in contact with the flueway surfaces than is possible in the straight direct gas travel of the ordinary boiler. The result is greater heat transfer to the water, a reduction in stack loss, and higher efficiency.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)

Standards . . . of workmanship reflected in performance

THE uniformly dependable, trouble-free service rendered by the National Super-Smokeless Boiler is explained in a phrase—"Controlled Manufacturing Processes."


Control that starts with the raw material, when each cast of metal is thoroughly analyzed; that continues through the entire process of manufacture. Control that rigidly rejects any section showing flaws or defects, or failing to pass the rigorous test, where a hydrostatic pressure four times that for which the boiler is designed is applied. Control that applies to every machining and finishing process, holding the tolerance to the smallest fraction of an inch.

Control that extends even to the selection and inspection of the fittings, assuring that each and all will function dependably and accurately.

The careful workmanship of the Super-Smokeless Boiler is reflected in the ease with which it can be set up on the job to form a steam and water tight, permanently effective, unit; is reflected in the economical, efficient service which has made its performance noteworthy wherever it has been used.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)

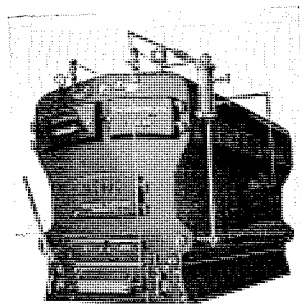

Series No. 40— Sizes and Ratings For Steam and Vapor


THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| S-406 | 5,200 | 2,300 | 12.03 | 2-5" | 2-4" | 16 x 16 | 50 | 56 |
| S-407 | 6,200 | 2,800 | 14.38 | 3-5" | 2-4" | 18 x 18 | 50 | 66 |
| S-408 | 7,200 | 3,300 | 16.73 | 3-5" | 2-4" | 18 x 18 | 55 | 76 |
| S-409 | 8,200 | 3,800 | 19.08 | 3-5" | 2-4" | 20 x 20 | 55 | 86 |
| S-4010 | 9,200 | 4,300 | 21.43 | 3-5" | 2-4" | 20 x 20 | 60 | 96 |
| S-4011 | 10,200 | 4,800 | 23.77 | 3-5" | 2-4" | 21 x 21 | 60 | 106 |
| S-4012 | 11,200 | 5,300 | 21.43 | 4-5" | 2-4" | 22 x 22 | 65 | 116 |
| S-4013 | 12,200 | 5,800 | 21.43 | 4-5" | 2-4" | 22 x 22 | 70 | 126 |
| S-4014 | 13,000 | 6,300 | 23.77 | 4-5" | 2-4" | 23 x 23 | 75 | 136 |
| S-4015 | 13,800 | 6,800 | 23.77 | 4-5" | 2-4" | 23 x 23 | 75 | 146 |
| S-4016 | 14,600 | 7,300 | 23.77 | 4-5" | 2-4" | 24 x 24 | 80 | 156 |
| S-4017 | 15,400 | 7,800 | 23.77 | 4-5" | 2-4" | 24 x 24 | 80 | 166 |
| S-4018 | 16,200 | 8,300 | 23.77 | 4-5" | 2-4" | 25 x 25 | 80 | 176 |
| S-4019 | 17,000 | 8,700 | 23.77 | 5-5" | 2-4" | 25 x 25 | 85 | 186 |
| S-4020 | 17,600 | 9,100 | 23.77 | 5-5" | 2-4" | 25 x 25 | 90 | 196 |
| S-4021 | 18,200 | 9,500 | 23.77 | 5-5" | 2-4" | 25 x 25 | 100 | 206 |
| S-4022 | 18,800 | 9,900 | 23.77 | 6-5" | 2-4" | 26 x 26 | 100 | 216 |
| S-4023 | 19,400 | 10,300 | 23.77 | 6-5" | 2-4" | 27 x 27 | 100 | 226 |
| S-4024 | 20,000 | 10,700 | 23.77 | 6-5" | 2-4" | 27 x 27 | 100 | 236 |

† Square feet of exterior boiler surface.
Approximately 67 pounds of insulation per section required to provide boiler covering 1½ inches thick.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)



Series No. 40— Sizes and Ratings For Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.


| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets No. and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|--------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| W-406 | 8,300 | 3,795 | 12.03 | 2-5" | 2-4" | 16 x 16 | 50 | 56 |
| W-407 | 9,900 | 4,620 | 14.38 | 3-5" | 2-4" | 18 x 18 | 50 | 66 |
| W-408 | 11,500 | 5,445 | 16.73 | 3-5" | 2-4" | 18 x 18 | 55 | 76 |
| W-409 | 13,100 | 6,270 | 19.08 | 3-5" | 2-4" | 20 x 20 | 55 | 86 |
| W-4010 | 14,700 | 7,095 | 21.43 | 3-5" | 2-4" | 20 x 20 | 60 | 96 |
| W-4011 | 16,300 | 7,920 | 23.77 | 3-5" | 2-4" | 21 x 21 | 60 | 106 |
| W-4012 | 17,900 | 8,745 | 21.43 | 4-5" | 2-4" | 22 x 22 | 65 | 116 |
| W-4013 | 19,500 | 9,570 | 21.43 | 4-5" | 2-4" | 22 x 22 | 70 | 126 |
| W-4014 | 20,800 | 10,395 | 23.77 | 4-5" | 2-4" | 23 x 23 | 75 | 136 |
| W-4015 | 22,100 | 11,220 | 23.77 | 4-5" | 2-4" | 23 x 23 | 75 | 146 |
| W-4016 | 23,400 | 12,045 | 23.77 | 4-5" | 2-4" | 24 x 24 | 80 | 156 |
| W-4017 | 24,700 | 12,870 | 23.77 | 4-5" | 2-4" | 24 x 24 | 80 | 166 |
| W-4018 | 26,000 | 13,695 | 23.77 | 4-5" | 2-4" | 25 x 25 | 80 | 176 |
| W-4019 | 27,300 | 14,520 | 23.77 | 5-5" | 2-4" | 25 x 25 | 85 | 186 |
| W-4020 | 28,200 | 15,015 | 23.77 | 5-5" | 2-4" | 25 x 25 | 90 | 196 |
| W-4021 | 29,200 | 15,675 | 23.77 | 5-5" | 2-4" | 25 x 25 | 100 | 206 |
| W-4022 | 30,200 | 16,335 | 23.77 | 6-5" | 2-4" | 26 x 26 | 100 | 216 |
| W-4023 | 31,200 | 16,995 | 23.77 | 6-5" | 2-4" | 27 x 27 | 100 | 226 |
| W-4024 | 32,200 | 17,655 | 23.77 | 6-5" | 2-4" | 27 x 27 | 100 | 236 |

† Square feet of exterior boiler surface.
Approximately 67 pounds of insulation per section required to provide boiler covering 1½ inches thick.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)

Series No. 40—Steam and Water Dimensions

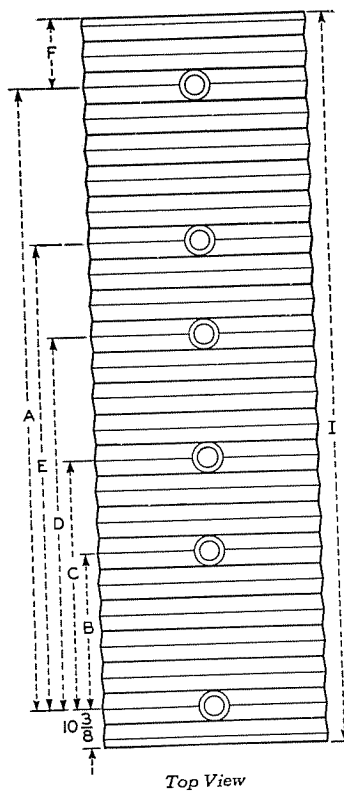

Top View

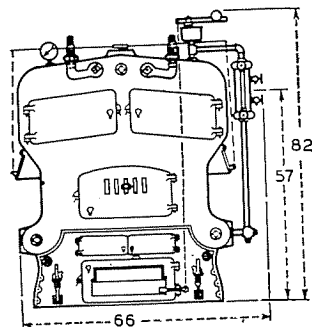

Supply Outlet Tappings: Boiler sections having outlet tappings are indicated by (°) after key letter, in Standard Assembly of Boiler Sections shown on page 112. Distance from center of one section to center of section next to it is 8 1/4 inches.


Steam Return Inlet Tappings: Two 4" in rear of back section "B". Side return inlets on steam boilers are only furnished on special order.

Water Return Inlet Tappings: Two 4" in rear of back section "B". Additional 5" return inlets on both sides of each intermediate supply section "HR" and "LR."

Indirect External Water Heater Tapping: One 2 inch tapping located in rear of back boiler section. Bosses for additional 1 1/2 inch tappings located on both sides of all intermediate sections on line with lower gauge cock tapping can be furnished. See current trade price sheet for charge for additional tappings.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS (Utica Design)

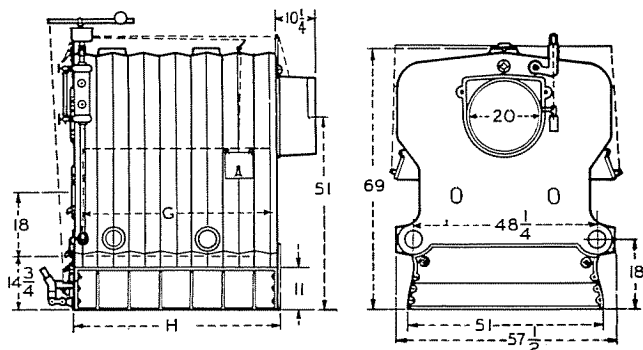

Series No. 40 Steam and Water Dimensions


| Boiler Number | A | B | C | D | E | F | G | H | I |
|---------------|---------|--------|--------|-----|---------|--------|--------|---------|---------|
| 406 | 24 3/4 | ... | ... | ... | ... | 10 3/8 | 40 3/4 | 47 | 45 1/2 |
| 407 | 33 | 16 1/2 | ... | ... | ... | 10 3/8 | 49 | 55 1/4 | 53 3/4 |
| 408 | 41 1/4 | 16 1/2 | ... | ... | ... | 10 3/8 | 57 1/4 | 63 1/2 | 62 |
| 409 | 49 1/2 | 24 3/4 | ... | ... | ... | 10 3/8 | 65 1/2 | 71 3/4 | 70 1/4 |
| 4010 | 57 3/4 | 33 | ... | ... | ... | 10 3/8 | 73 3/4 | 80 | 78 1/2 |
| 4011 | 57 3/4 | 33 | ... | ... | ... | 18 5/8 | 82 | 88 1/4 | 86 3/4 |
| 4012 | 74 1/4 | 33 | 57 3/4 | ... | ... | 10 3/8 | 73 3/4 | 96 1/2 | 95 |
| 4013 | 74 1/4 | 33 | 57 3/4 | ... | ... | 18 5/8 | 73 3/4 | 104 3/4 | 103 1/4 |
| 4014 | 82 1/2 | 41 1/4 | 66 | ... | ... | 18 5/8 | 82 | 113 | 111 1/2 |
| 4015 | 90 3/4 | 41 1/4 | 66 | ... | ... | 18 5/8 | 82 | 121 1/4 | 119 3/4 |
| 4016 | 99 | 41 1/4 | 66 | ... | ... | 18 5/8 | 82 | 129 1/2 | 128 |
| 4017 | 107 1/4 | 41 1/4 | 66 | ... | ... | 18 5/8 | 82 | 137 3/4 | 136 1/4 |
| 4018 | 115 1/2 | 41 1/4 | 66 | ... | ... | 18 5/8 | 82 | 146 | 144 1/2 |
| 4019 | 123 3/4 | 41 1/4 | 66 | 99 | ... | 18 5/8 | 82 | 154 1/4 | 152 3/4 |
| 4020 | 132 | 41 1/4 | 66 | 99 | ... | 18 5/8 | 82 | 162 1/2 | 161 |
| 4021 | 140 1/4 | 41 1/4 | 66 | 99 | ... | 18 5/8 | 82 | 170 3/4 | 169 1/4 |
| 4022 | 148 1/2 | 41 1/4 | 66 | 99 | 123 3/4 | 18 5/8 | 82 | 179 | 177 1/2 |
| 4023 | 156 3/4 | 41 1/4 | 66 | 99 | 123 3/4 | 18 5/8 | 82 | 187 1/4 | 185 3/4 |
| 4024 | 165 | 41 1/4 | 66 | 99 | 123 3/4 | 18 5/8 | 82 | 195 1/2 | 194 |

Measurements subject to slight variations in assembly.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Multiple . . .
advantages — combined
in a single unit

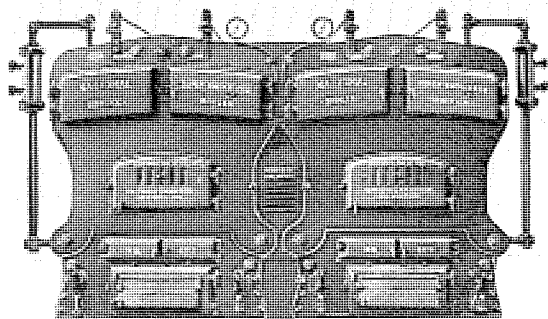

NATIONAL SUPER-SMOKELESS DUPLEX BOILER—FRONT VIEW
A flexible and responsible unit, particularly responsive to varying loads. The water line is exceptionally low.

THEORETICALLY, the size of a boiler could be increased indefinitely; actually, too great a size brings disadvantages. For large installations, therefore, the National Super-Smokeless Duplex Boiler is recommended.

The Duplex requires a smaller stack than would a single boiler with the same capacity. It is more econom-


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

ical; in mild weather one unit can be operated at its peak efficiency, the other standing idle, instead of operating a large single unit at inefficient fractional loads.

The Duplex has advantages over two detached boilers, also, as it saves space, and insulation.

All of the valuable features of the single unit Super-

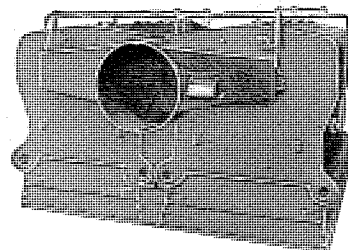


NATIONAL SUPER-SMOKELESS DUPLEX BOILER—REAR VIEW
The above illustration shows the single outlet smoke box which is standard equipment on all Duplex Boilers. Individual smoke boxes for each unit in the Duplex will be furnished on order.

Smokeless are retained. Provision is made for individual control of the secondary air intakes from the front of the boiler.

Like the Super-Smokeless, the Duplex will burn any kind of fuel efficiently, and is particularly well adapted for oil and gas burning because of the large prime heating surface, the progressive increase in combustion area, and the long rotative fire travel.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

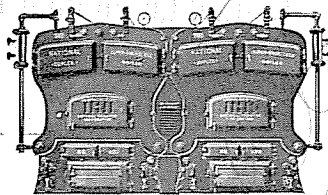

Duplex Series No. 82
Sizes and Ratings
For Steam and Vapor

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| S-827 | 13,200 | 6,300 | 28.76 | 6-5" | 4-4" | 23 x 23 | 60 | 90 |
| S-828 | 15,200 | 7,300 | 33.46 | 6-5" | 4-4" | 24 x 24 | 65 | 104 |
| S-829 | 17,200 | 8,300 | 38.16 | 6-5" | 4-4" | 25 x 25 | 65 | 118 |
| S-8210 | 19,200 | 9,300 | 42.86 | 6-5" | 4-4" | 26 x 26 | 70 | 132 |
| S-8211 | 21,200 | 10,300 | 47.54 | 6-5" | 4-4" | 27 x 27 | 70 | 146 |
| S-8212 | 23,200 | 11,300 | 42.86 | 8-5" | 4-4" | 28 x 28 | 75 | 160 |
| S-8213 | 25,200 | 12,300 | 42.86 | 8-5" | 4-4" | 29 x 29 | 80 | 174 |
| S-8214 | 26,800 | 13,300 | 47.54 | 8-5" | 4-4" | 29 x 29 | 85 | 188 |
| S-8215 | 28,400 | 14,300 | 47.54 | 8-5" | 4-4" | 30 x 30 | 85 | 202 |
| S-8216 | 30,000 | 15,300 | 47.54 | 8-5" | 4-4" | 31 x 31 | 90 | 216 |
| S-8217 | 31,600 | 16,300 | 47.54 | 8-5" | 4-4" | 32 x 32 | 90 | 230 |
| S-8218 | 33,200 | 17,300 | 47.54 | 8-5" | 4-4" | 32 x 32 | 90 | 244 |

† Square feet of exterior boiler surface.


Approximately 94 pounds of insulation per section required to provide boiler covering 1½ inches thick.

100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.

Headers are not furnished with Super-Smokeless Duplex Boilers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)



Duplex Series No. 82
Sizes and Ratings
For Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| W-827 | 21,100 | 10,400 | 28.76 | 6-5" | 4-4" 2-5" | 23 x 23 | 60 | 90 |
| W-828 | 24,300 | 12,050 | 33.46 | 6-5" | 4-4" 2-5" | 24 x 24 | 65 | 104 |
| W-829 | 27,500 | 13,700 | 38.16 | 6-5" | 4-4" 2-5" | 25 x 25 | 65 | 118 |
| W-8210 | 30,700 | 15,350 | 42.86 | 6-5" | 4-4" 2-5" | 26 x 26 | 70 | 132 |
| W-8211 | 33,900 | 17,000 | 47.54 | 6-5" | 4-4" 2-5" | 27 x 27 | 70 | 146 |
| W-8212 | 37,100 | 18,650 | 42.86 | 8-5" | 4-4" 4-5" | 28 x 28 | 75 | 160 |
| W-8213 | 40,300 | 20,300 | 42.86 | 8-5" | 4-4" 4-5" | 29 x 29 | 80 | 174 |
| W-8214 | 42,900 | 21,950 | 47.54 | 8-5" | 4-4" 4-5" | 29 x 29 | 85 | 188 |
| W-8215 | 45,500 | 23,600 | 47.54 | 8-5" | 4-4" 4-5" | 30 x 30 | 85 | 202 |
| W-8216 | 48,100 | 25,250 | 47.54 | 8-5" | 4-4" 4-5" | 31 x 31 | 90 | 216 |
| W-8217 | 50,700 | 26,900 | 47.54 | 8-5" | 4-4" 4-5" | 32 x 32 | 90 | 230 |
| W-8218 | 53,300 | 28,550 | 47.54 | 8-5" | 4-4" 4-5" | 32 x 32 | 90 | 244 |

† Square feet of exterior boiler surface.



Approximately 94 pounds of insulation per section required to provide boiler covering 1½ inches thick.

100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.

Headers are not furnished with Super-Smokeless Duplex Boilers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

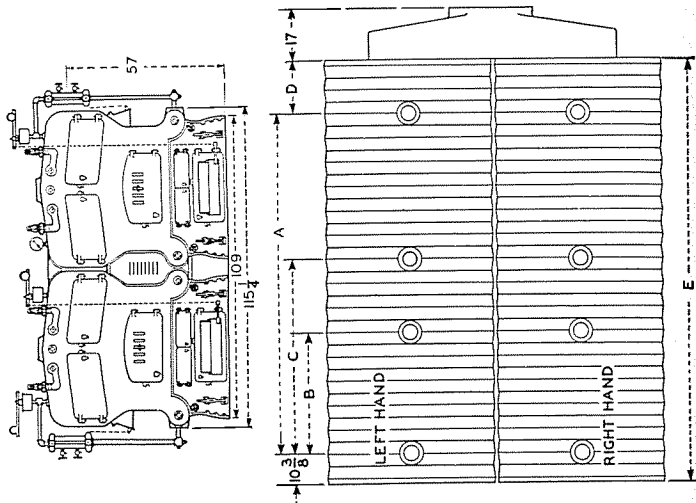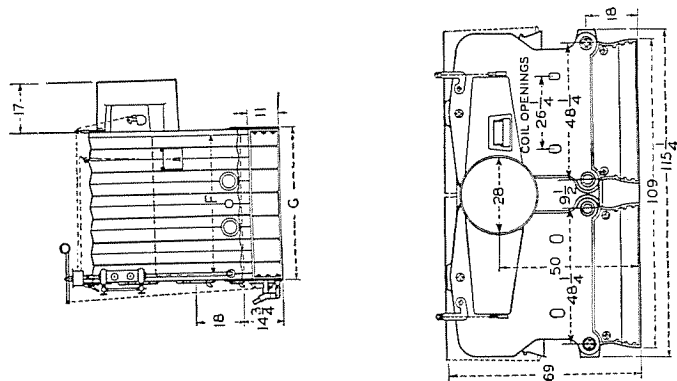

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Series No. 82—Steam and Water Dimensions

| Boiler Number | A | B | C | D | E | F | G |
|---------------|---------------------|--------------------|--------------------|--------------------|---------------------|--------------------|---------------------|
| 827 | 33" | 16 $\frac{1}{2}$ " | | 10 $\frac{3}{8}$ " | 53 $\frac{3}{4}$ " | 49" | 55 $\frac{1}{4}$ " |
| 828 | 41 $\frac{1}{4}$ " | 16 $\frac{1}{2}$ " | | 10 $\frac{3}{8}$ " | 62" | 57 $\frac{1}{4}$ " | 63 $\frac{1}{2}$ " |
| 829 | 49 $\frac{1}{2}$ " | 24 $\frac{3}{4}$ " | | 10 $\frac{3}{8}$ " | 70 $\frac{1}{4}$ " | 65 $\frac{1}{2}$ " | 71 $\frac{3}{4}$ " |
| 8210 | 57 $\frac{3}{4}$ " | 33" | | 10 $\frac{3}{8}$ " | 78 $\frac{1}{2}$ " | 73 $\frac{3}{4}$ " | 80" |
| 8211 | 66" | 33" | | 18 $\frac{5}{8}$ " | 86 $\frac{3}{4}$ " | 82" | 88 $\frac{1}{4}$ " |
| 8212 | 74 $\frac{1}{4}$ " | 33" | 57 $\frac{3}{4}$ " | 10 $\frac{3}{8}$ " | 95" | 73 $\frac{3}{4}$ " | 96 $\frac{1}{2}$ " |
| 8213 | 74 $\frac{1}{4}$ " | 33" | 57 $\frac{3}{4}$ " | 18 $\frac{5}{8}$ " | 103 $\frac{1}{4}$ " | 73 $\frac{3}{4}$ " | 104 $\frac{3}{4}$ " |
| 8214 | 82 $\frac{1}{2}$ " | 41 $\frac{1}{4}$ " | 66" | 18 $\frac{5}{8}$ " | 111 $\frac{1}{2}$ " | 82" | 113" |
| 8215 | 90 $\frac{3}{4}$ " | 41 $\frac{1}{4}$ " | 66" | 18 $\frac{5}{8}$ " | 119 $\frac{3}{4}$ " | 82" | 121 $\frac{1}{4}$ " |
| 8216 | 99" | 41 $\frac{1}{4}$ " | 66" | 18 $\frac{5}{8}$ " | 128" | 82" | 129 $\frac{1}{2}$ " |
| 8217 | 107 $\frac{1}{4}$ " | 41 $\frac{1}{4}$ " | 66" | 18 $\frac{5}{8}$ " | 136 $\frac{1}{4}$ " | 82" | 137 $\frac{3}{4}$ " |
| 8218 | 115 $\frac{1}{2}$ " | 41 $\frac{1}{4}$ " | 66" | 18 $\frac{5}{8}$ " | 144 $\frac{1}{2}$ " | 82" | 146" |

Measurements subject to slight variations in assembly.
Ashpit and foundation measurements are given on page 123.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Series No. 82
Standard Assembly of Boiler Sections

F—Front; XT°—Low crown intermediate, crossover flue next to front, supply outlet, no return inlet; L—Low crown intermediate, plain; H—High crown intermediate, plain; HT°—High crown intermediate, supply outlet, no return inlet; A—Baffle, air gates, plain; K—Bridgewall; UT°—Low crown intermediate, half-uptake, supply outlet, no return inlet; W—Low crown intermediate, full-uptake, plain; WT°—Low crown intermediate, full-uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangement of Sections—Steam Boilers

| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 |
|---------------|------------|-------|-------|-----|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| S-827 | Left Half | F XT° | L HT° | HT° | A | UT° | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B |
| S-828 | Right Half | F XT° | L HT° | HT° | A | UT° | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-829 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8210 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8211 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8212 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8213 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8214 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8215 | Left Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8216 | Right Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8217 | Left Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| S-8218 | Right Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Series No. 82
Standard Assembly of Boiler Sections


F—Front; XT°—Low crown intermediate, crossover flue next to front, supply outlet, no return inlet; L—Low crown intermediate, plain; H—High crown intermediate, supply outlet, no return inlet; A—Baffle, air gates, plain; K—Bridgewall; UT°—Low crown intermediate, half-uptake, supply outlet, no return inlet; W—Low crown intermediate, full-uptake, plain; WT°—Low crown intermediate, full-uptake, supply outlet, no return inlet; B—Back, 2 return inlets on rear.

Arrangement of Sections—Water Boilers

| Boiler Number | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 |
|---------------|------------|-------|-------|-----|---|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| W-827 | Left Half | F XT° | L HT° | HT° | A | UT° | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B | B B |
| W-828 | Right Half | F XT° | L HT° | HT° | A | UT° | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-829 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8210 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8211 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8212 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8213 | Left Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8214 | Right Half | F XT° | L HT° | HT° | H | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8215 | Left Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8216 | Right Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8217 | Left Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |
| W-8218 | Right Half | F XT° | L HT° | HT° | L | HT° | A | A | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° | WT° |

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Foundation and Pitting Dimensions
Series No. 24, 33 and 40

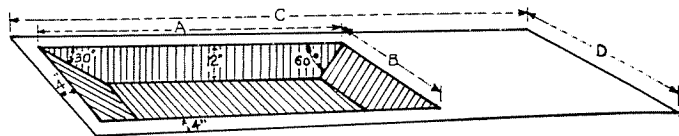

The tables below give all the necessary measurements for pitting the National Super-Smokeless Boiler. Letters refer to corresponding letters on the diagram.


| Boiler Number | Measurements of Pit Under Ash Pit | | Dimensions of Foundation | |
|---|-----------------------------------|--------------------|--------------------------|--------------------|
| | A | B | C | D |
| Series No. 24 National Super-Smokeless Boiler | | | | |
| 245 | 34" | 24" | 43" | 32" |
| 246 | 42 $\frac{1}{4}$ " | 24" | 51 $\frac{1}{4}$ " | 32" |
| 247 | 50 $\frac{1}{2}$ " | 24" | 59 $\frac{1}{2}$ " | 32" |
| 248 | 58 $\frac{3}{4}$ " | 24" | 67 $\frac{3}{4}$ " | 32" |
| 249 | 67" | 24" | 76" | 32" |
| Series No. 33 National Super-Smokeless Boiler | | | | |
| 335 | 34" | 33 $\frac{1}{2}$ " | 43" | 41 $\frac{1}{2}$ " |
| 336 | 42 $\frac{1}{4}$ " | 33 $\frac{1}{2}$ " | 51 $\frac{1}{4}$ " | 41 $\frac{1}{2}$ " |
| 337 | 50 $\frac{1}{2}$ " | 33 $\frac{1}{2}$ " | 59 $\frac{1}{2}$ " | 41 $\frac{1}{2}$ " |
| 338 | 58 $\frac{3}{4}$ " | 33 $\frac{1}{2}$ " | 67 $\frac{3}{4}$ " | 41 $\frac{1}{2}$ " |
| 339 | 67" | 33 $\frac{1}{2}$ " | 76" | 41 $\frac{1}{2}$ " |
| 3310 | 75 $\frac{1}{4}$ " | 33 $\frac{1}{2}$ " | 84 $\frac{1}{4}$ " | 41 $\frac{1}{2}$ " |
| Series No. 40 National Super-Smokeless Boiler | | | | |
| 406 | 42 $\frac{1}{4}$ " | 46" | 51 $\frac{1}{4}$ " | 54" |
| 407 | 50 $\frac{1}{2}$ " | 46" | 59 $\frac{1}{2}$ " | 54" |
| 408 | 58 $\frac{3}{4}$ " | 46" | 67 $\frac{3}{4}$ " | 54" |
| 409 | 67" | 46" | 76" | 54" |
| 4010 | 75 $\frac{1}{4}$ " | 46" | 84 $\frac{1}{4}$ " | 54" |
| 4011 | 83 $\frac{1}{2}$ " | 46" | 92 $\frac{1}{2}$ " | 54" |
| 4012 | 75 $\frac{1}{4}$ " | 46" | 100 $\frac{3}{4}$ " | 54" |
| 4013 | 75 $\frac{1}{4}$ " | 46" | 109" | 54" |
| 4014 | 83 $\frac{1}{2}$ " | 46" | 117 $\frac{1}{4}$ " | 54" |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED SUPER-SMOKELESS BOILERS
(Utica Design)

Foundation and Pitting Dimensions
Series No. 40 National Super-Smokeless Boiler (continued)

| Boiler Number | Measurements of Pit Under Ash Pit | | Dimensions of Foundation | |
|---------------|-----------------------------------|-----|--------------------------|-----|
| | A | B | C | D |
| 4015 | 83 $\frac{1}{2}$ " | 46" | 125 $\frac{1}{2}$ " | 54" |
| 4016 | 83 $\frac{1}{2}$ " | 46" | 133 $\frac{3}{4}$ " | 54" |
| 4017 | 83 $\frac{1}{2}$ " | 46" | 142" | 54" |
| 4018 | 83 $\frac{1}{2}$ " | 46" | 150 $\frac{1}{4}$ " | 54" |
| 4019 | 83 $\frac{1}{2}$ " | 46" | 158 $\frac{1}{2}$ " | 54" |
| 4020 | 83 $\frac{1}{2}$ " | 46" | 166 $\frac{3}{4}$ " | 54" |
| 4021 | 83 $\frac{1}{2}$ " | 46" | 175" | 54" |
| 4022 | 83 $\frac{1}{2}$ " | 46" | 183 $\frac{1}{4}$ " | 54" |
| 4023 | 83 $\frac{1}{2}$ " | 46" | 191 $\frac{1}{2}$ " | 54" |
| 4024 | 83 $\frac{1}{2}$ " | 46" | 199 $\frac{3}{4}$ " | 54" |

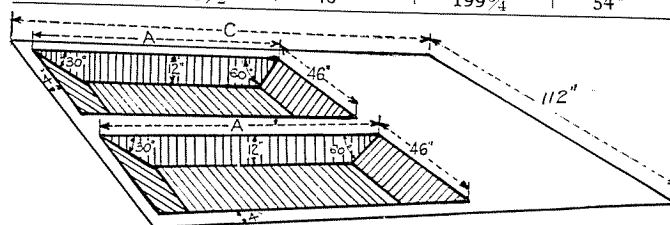


Foundation and Pitting Dimensions
Series No. 82 National Duplex Boiler

| Boiler Number | A | C |
|---------------|--------------------|---------------------|
| 827 | 50 $\frac{1}{2}$ " | 59 $\frac{1}{2}$ " |
| 828 | 58 $\frac{3}{4}$ " | 67 $\frac{3}{4}$ " |
| 829 | 67" | 76" |
| 8210 | 75 $\frac{1}{4}$ " | 84 $\frac{1}{4}$ " |
| 8211 | 83 $\frac{1}{2}$ " | 92 $\frac{1}{2}$ " |
| 8212 | 75 $\frac{1}{4}$ " | 100 $\frac{3}{4}$ " |
| 8213 | 75 $\frac{1}{4}$ " | 109" |
| 8214 | 83 $\frac{1}{2}$ " | 117 $\frac{1}{4}$ " |
| 8215 | 83 $\frac{1}{2}$ " | 125 $\frac{1}{2}$ " |
| 8216 | 83 $\frac{1}{2}$ " | 133 $\frac{3}{4}$ " |
| 8217 | 83 $\frac{1}{2}$ " | 142" |
| 8218 | 83 $\frac{1}{2}$ " | 150 $\frac{1}{4}$ " |

When boiler is erected before basement floor is laid, surround pit with foundation 10 to 12 inches wide.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

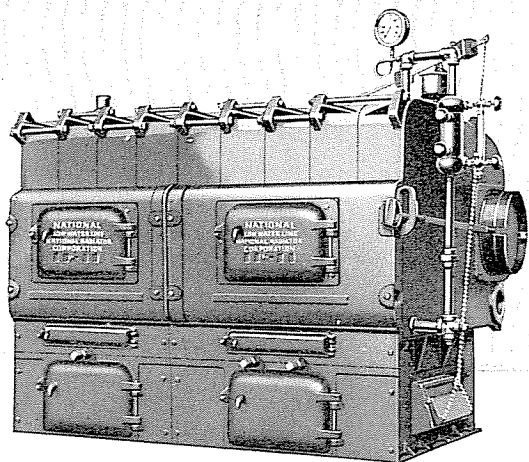

National No. 39-S

NATIONAL Low Water Line Boilers are often the only, and always the best, solution when insufficient head room is the problem. They are particularly well adapted to theatre work, and to buildings where the installation of an ordinary boiler would make an expensive pit necessary.

The Series No. 30 is made in eight sizes, and is bonded to heat from 850 to 2600 square feet of steam radiation, and from 1400 to 4305 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

Digging . . .
into a problem
instead of a floor

NATIONAL Low Water Line Boilers save thousands of dollars in building construction by eliminating necessity for pits and high boiler room ceilings.

In tide water country where deep basements are impractical, and in buildings elsewhere where head room is at a premium, the National Low Water Line Boiler is a welcome solution to a difficult problem. Without any sacrifice of efficiency, it provides ample distance between water line and low point of main that assures proper steam circulation, and guards against the danger of boiler breakage.


One of the common causes of trouble at the ends of steam mains and dry returns is insufficient distance between the normal water line of the boiler and the ends of the main to take care of the inequality in pressure in the heating system. This is particularly true in vapor systems, many of which are designed to operate on a few ounces of pressure. (See page 350).

The grate bars shake in batteries of two or three, so that any portion of the fire can be cleaned without disturbing the rest. Connecting yokes are on the outside at the rear, therefore any grate bar may be removed in case of accident without crawling inside the fire box, or the ash pit.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS

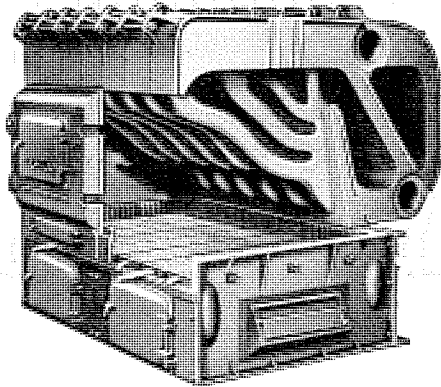

National No. 38-S Interior View

THIS interior view admirably illustrates the reasons for the high efficiency of this outstanding boiler. The maze of water legs provide a large amount of prime heating surface, and at the same time break the water up into small columns, speeding the heat transfer. A special feature is the circulation, which is so controlled that the hottest gases come in contact with the hottest water.

Complete data and dimensions on pages 128 and 129.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS

Efficient . . .

with all fuels,
at all seasons


FIRING the National Low Water Line Boiler is easy, for the coal is thrown on the short way of the grate. Since the maximum distance is only 40 inches in the largest boiler, only about 4 feet of clearance is needed between boiler front, and boiler room wall. Often the design of the boiler room is such that a side feed boiler can be more conveniently fired than an end feed boiler. In this situation, a National Low Water Line Boiler excels.

In mild weather, a portion of the grate can be banked with ashes, and only the remaining portion used. The fuel that is used can thus be fired at the proper depth, and burned at the proper rate, to yield maximum efficiency.

The large proportion of prime heating surface, and its location, and design, makes this boiler a quick steamer, readily and quickly adaptable to varying load demands. The boilers are easily adaptable to oil burning operations. The burner is installed in the base end, usually at the smoke-pipe end of the boiler. Several of the ports between sections at the opposite end of the boiler should be filled with fire clay to force the burning gases back to the burner end of the fire box before they are allowed to pass into the first flue way. Sketches showing the suggested method of installation will be supplied on request.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS (Hard Coal Type)



Series No. 30 Sizes and Ratings For Steam, Vapor and Hot Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|--------------------------|
| | | | | | | Area Inches | Height Feet | |
| Steam | | | | | | | | |
| 35-S | 1,700 | 850 | 5.83 | 2-4" | 2-4" | 12 x 12 | 40 | 42 |
| 36-S | 2,200 | 1,100 | 7.29 | 2-4" | 2-4" | 12 x 12 | 40 | 46 |
| 37-S | 2,700 | 1,350 | 8.75 | 2-4" | 2-4" | 12 x 12 | 40 | 51 |
| 38-S | 3,200 | 1,600 | 10.21 | 2-4" | 2-4" | 12 x 12 | 40 | 56 |
| 39-S | 3,700 | 1,850 | 11.67 | 2-4" | 2-4" | 12 x 16 | 45 | 60 |
| 310-S | 4,200 | 2,100 | 13.13 | 2-4" | 2-4" | 12 x 16 | 45 | 65 |
| 311-S | 4,700 | 2,350 | 14.59 | 2-4" | 2-4" | 12 x 16 | 50 | 68 |
| 312-S | 5,200 | 2,600 | 16.05 | 2-4" | 2-4" | 16 x 16 | 50 | 73 |
| Water | | | | | | | | |
| 35-W | 2,800 | 1,400 | 5.83 | 2-4" | 2-4" | 12 x 12 | 40 | 42 |
| 36-W | 3,600 | 1,815 | 7.29 | 2-4" | 2-4" | 12 x 12 | 40 | 46 |
| 37-W | 4,400 | 2,230 | 8.75 | 2-4" | 2-4" | 12 x 12 | 40 | 51 |
| 38-W | 5,200 | 2,645 | 10.21 | 2-4" | 2-4" | 12 x 12 | 40 | 56 |
| 39-W | 6,000 | 3,060 | 11.67 | 2-4" | 2-4" | 12 x 16 | 45 | 60 |
| 310-W | 6,800 | 3,475 | 13.13 | 2-4" | 2-4" | 12 x 16 | 45 | 65 |
| 311-W | 7,600 | 3,890 | 14.59 | 2-4" | 2-4" | 12 x 16 | 50 | 68 |
| 312-W | 8,400 | 4,305 | 16.05 | 2-4" | 2-4" | 16 x 16 | 50 | 73 |

† Square feet of exterior boiler surface.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL BONDED LOW WATER LINE BOILERS (Hard Coal Type)

Series No. 30 Steam and Water Dimensions

Supply Outlet Tappings: One 4" outlet in right end section and one 4" outlet in left end section. No. 30 Series boilers not furnished with intermediate tapped sections.

Return Inlet Tappings: One 4" inlet in the side of right end section and one 4" inlet in the side of left end section.

Center to center distance between sections is 7 inches.

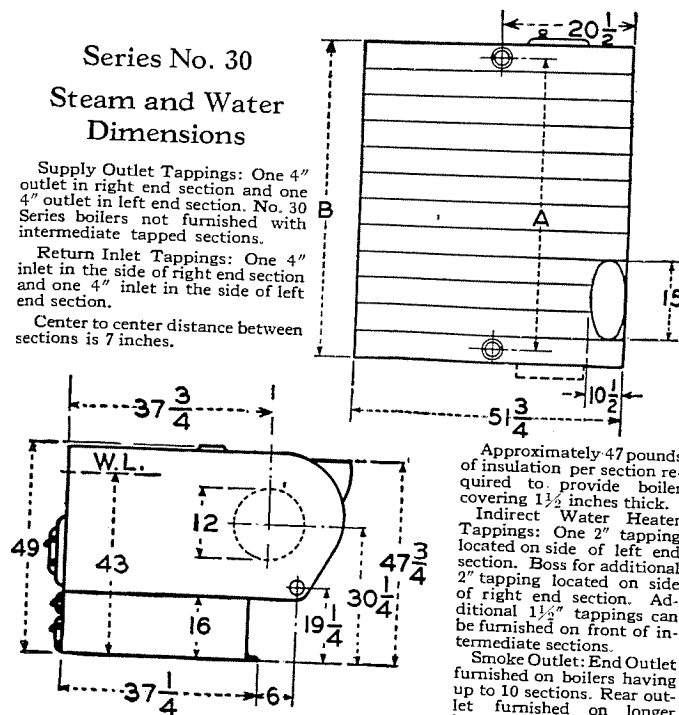

Approximately 47 pounds of insulation per section required to provide boiler covering 1 1/2 inches thick.

Indirect Water Heater Tappings: One 2" tapping located on side of left end section. Boss for additional 2" tapping located on side of right end section. Additional 1 1/2" tappings can be furnished on front of intermediate sections.


Smoke Outlet: End Outlet furnished on boilers having up to 10 sections. Rear outlet furnished on longer boilers.

| Boiler Numbers | | A | B |
|----------------|-------|---------|-----|
| 35-S | 35-W | 28 1/2" | 35" |
| 36-S | 36-W | 35 1/2" | 42" |
| 37-S | 37-W | 42 1/2" | 49" |
| 38-S | 38-W | 49 1/2" | 56" |
| 39-S | 39-W | 56 1/2" | 63" |
| 310-S | 310-W | 63 1/2" | 70" |
| 311-S | 311-W | 70 1/2" | 77" |
| 312-S | 312-W | 77 1/2" | 84" |

Measurements subject to slight variations in assembly. Ashpit and foundation measurements are shown on page 150. Standard assembly of sections is shown on page 148.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

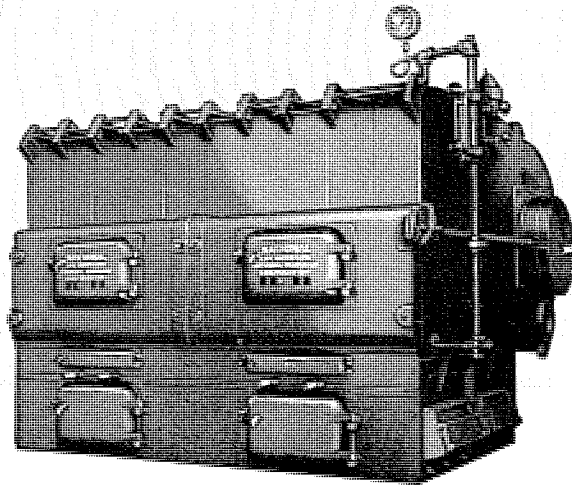

National No. 410-S

THOUSANDS upon thousands of dollars have been saved in construction costs through National Low Water Line Boilers, due to the elimination of refuse gathering pits, and high boiler room ceilings. This unit is a prime favorite in tide water country, and in all buildings where lack of basement head-room is a problem.

The Series 40 illustrated is made in thirteen sizes and is bonded to heat from 1800 to 6600 square feet of steam radiation, and from 2970 to 10,890 square feet of water radiation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

Quality . . .

equipment is the
unfailing standard

IN order that National Low Water Line Boilers may, in the smallest details, live up to the enviable reputation that they have earned and enjoy, the accessories are chosen with the greatest care, after tests that conclusively establish their fitness for the work.

Standard equipment on the National Low Water Line Boilers includes an all-metal, all-inclosed damper regulator, of extreme sensitiveness. An A. S. M. E. standard pop safety valve; a Bourdon-tube type retard steam gauge, with siphon and non-glare dial; a gauge glass; tri-cocks; and firing tools.

No accessories are furnished with the water boiler. If they are desired the following assortment is recommended:


An altitude gauge, to indicate the height of water column; a water temperature regulator, sensitive to small temperature changes, but not affected by pressure variations; a thermometer, of the mercury-well type. See accessory section for full descriptions.

Boilers up to ten sections, in both the 30 and 40 series, are regularly equipped with an end smoke box, as shown on page 130. Boilers having eleven sections or more have a rear smoke box, as illustrated and described on page 140.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS

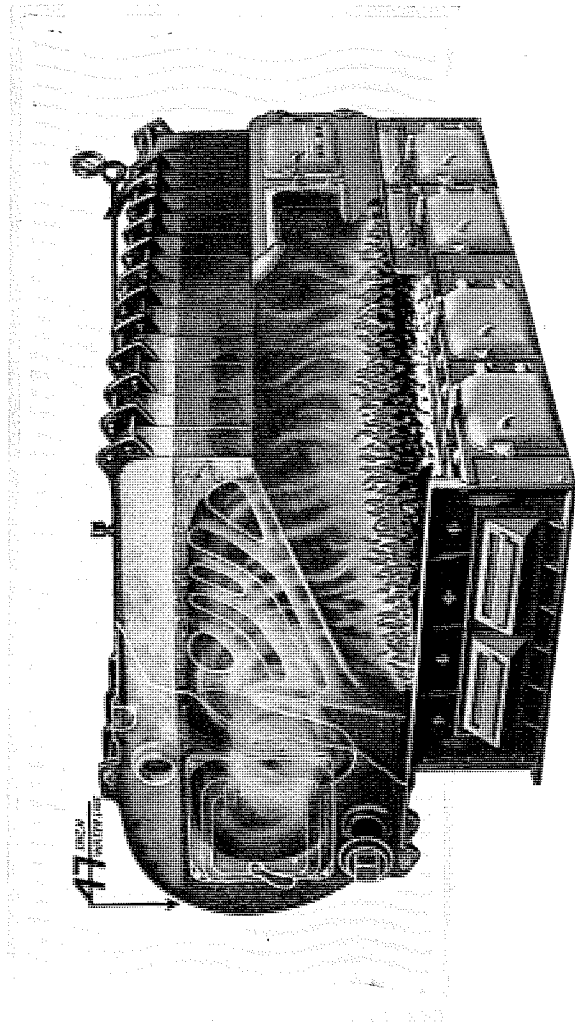

National No. 413-S Interior View
Interior view showing the maze of water legs, which give amazing efficiency.



NATIONAL BONDED LOW WATER LINE BOILERS

Low . . .

water line—
high efficiency

THE ingenious design of the National Low Water Line Boiler permits the placing of water tubes in the fire box where they come in contact with the intense heat of the fire.

The flames completely envelop the tubes; rise to the crown sheet; then pass through section ports to the first flueway, strike the rear wall, swirl, and pass to the end, across the entire length of the boiler, then enter the rear flueway and proceed the entire length of the boiler in the opposite direction before entering the smoke outlet. This unique and efficient path of travel gives the heat of burning gases ample opportunity to be absorbed by the waterways, resulting in effective and economical combustion.


Due to the tube design the water in the boiler is broken up into numerous small columns which are entirely surrounded by fire. For the same reason that a small amount of water in a pan placed over a gas flame can be brought to the boiling point almost instantly, the water in these tubes is quickly brought to a boiling point. The balanced circulation of the water within the boiler prevents priming, maintains a steady water line, and insures the maximum absorption of heat.



NATIONAL BONDED LOW WATER LINE BOILERS

Balanced Circulation

AMAZING ingenuity was displayed in the design of the National Low Water Line Boiler. The relatively cold return water is delivered at the back of the boiler where it absorbs heat from the gases in the last flue-way. It then progresses towards the front. Here it rises through the branching water legs which are exposed to the hottest part of the fire. The ideal in circulation is thus realized; the hottest water is exposed to the hottest part of the fire, and the coldest water is exposed to the cooler gases. This is a direct reversal of the usual procedure, and is made possible by locating the fire travel back of the fire box instead of above it.

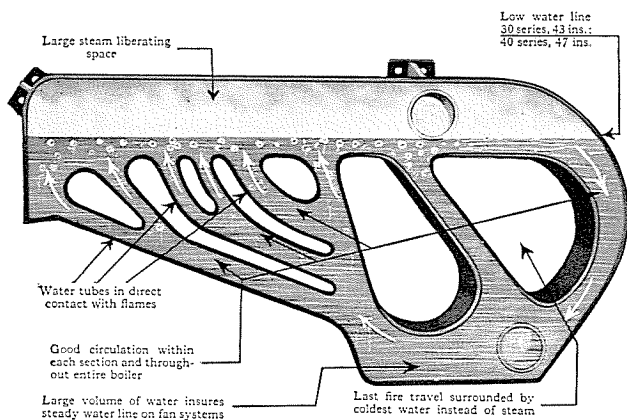

The illustration shows this circulation clearly, and explains how the apparent impossible was accomplished; namely, uniting a low water line with high efficiency operation and balanced circulation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS

Carefree . . .

operation — through
careful construction

WHEN the National Radiator Corporation was formed, the leading products of each of the six great component companies were retained, and combined to form the Corporation's standard line. With the products were inherited ideals of quality that extend to every manufacturing operation. Metallurgical laboratories are maintained, which analyze all metal going into the boilers, and assure its conformation to the highest standards. Each section is tested at a pressure more than four times as great as the boiler ordinarily will be called upon to carry.

All machining and finishing is done to minute limits, with constant and vigilant checks by competent inspectors. Connections are made by crown taper cast iron push nipples, machined to narrow tolerances, so that the assembly of the boilers on the job will be a quick and easy task, and leaks will be permanently barred.

Doors are ground to an accurate fit on their frames, to prevent infiltration of air.


Every careful step in manufacture assures satisfaction, warrants performance, gives the customer something more, and something better, than he expects.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

(Hard Coal Type)

Series No. 40 Sizes and Ratings For Steam and Vapor



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets No. and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|-------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 46-S | 4,100 | 1,800 | 9.79 | 2-5" | 2-5" | 12 x 16 | 45 | 59 |
| 47-S | 4,900 | 2,200 | 11.73 | 2-5" | 2-5" | 12 x 16 | 45 | 65 |
| 48-S | 5,700 | 2,600 | 13.68 | 2-5" | 2-5" | 16 x 16 | 50 | 72 |
| 49-S | 6,500 | 3,000 | 15.62 | 2-5" | 2-5" | 16 x 20 | 55 | 78 |
| 410-S | 7,300 | 3,400 | 17.57 | 2-5" | 2-5" | 16 x 20 | 55 | 85 |
| 411-S | 8,100 | 3,800 | 19.51 | 2-5" | 2-5" | 20 x 20 | 55 | 89 |
| 412-S | 8,900 | 4,200 | 21.45 | 2-5" 1-4" | 2-5" | 20 x 20 | 60 | 96 |
| 413-S | 9,700 | 4,600 | 23.40 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 102 |
| 414-S | 10,500 | 5,000 | 25.34 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 108 |
| 415-S | 11,300 | 5,400 | 27.29 | 2-5" 1-4" | 2-5" | 24 x 28 | 65 | 115 |
| 416-S | 12,100 | 5,800 | 29.23 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 121 |
| 417-S | 12,900 | 6,200 | 31.17 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 128 |
| 418-S | 13,700 | 6,600 | 33.12 | 2-5" 2-4" | 2-5" | 28 x 32 | 70 | 135 |

† Square feet of exterior boiler surface.

Approximately 57 pounds of insulation per section required to provide boiler covering 1½ inches thick.

100 pounds of insulation will cover approximately 15 square feet of boiler surface to a thickness of 1½ inches.

Supply Outlet Tappings: One 5" outlet in right end section and one 5" outlet in left end section. Additional 4" outlets are furnished in intermediate sections in boilers having 12 or more sections. See dimension table on page 139 for location of intermediate sections with outlets.


Return Inlet Tappings: One 5" inlet in right end section and one 5" inlet in left end section.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS

(Hard Coal Type)

Series No. 40 Sizes and Ratings For Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets No. and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|-------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 46-W | 6,600 | 2,970 | 9.79 | 2-5" | 2-5" | 12 x 16 | 45 | 59 |
| 47-W | 7,900 | 3,630 | 11.73 | 2-5" | 2-5" | 12 x 16 | 45 | 65 |
| 48-W | 9,200 | 4,290 | 13.68 | 2-5" | 2-5" | 16 x 16 | 50 | 72 |
| 49-W | 10,500 | 4,950 | 15.62 | 2-5" | 2-5" | 16 x 20 | 55 | 78 |
| 410-W | 11,800 | 5,610 | 17.57 | 2-5" | 2-5" | 16 x 20 | 55 | 85 |
| 411-W | 13,100 | 6,270 | 19.51 | 2-5" | 2-5" | 20 x 20 | 55 | 89 |
| 412-W | 14,400 | 6,930 | 21.45 | 2-5" 1-4" | 2-5" | 20 x 20 | 60 | 96 |
| 413-W | 15,700 | 7,590 | 23.40 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 102 |
| 414-W | 17,000 | 8,250 | 25.34 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 108 |
| 415-W | 18,300 | 8,910 | 27.29 | 2-5" 1-4" | 2-5" | 24 x 28 | 65 | 115 |
| 416-W | 19,600 | 9,570 | 29.23 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 121 |
| 417-W | 20,900 | 10,230 | 31.17 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 128 |
| 418-W | 22,200 | 10,890 | 33.12 | 2-5" 2-4" | 2-5" | 28 x 32 | 70 | 135 |

† Square feet of exterior boiler surface.

Approximately 57 pounds of insulation per section required to provide boiler covering 1½ inches thick.

Supply Outlet Tappings: One 5" outlet in right end section and one 5" outlet in left end section. Additional 4" outlets are furnished in intermediate sections in boilers having 12 or more sections. See dimension table on page 139 for location of intermediate sections with outlets.


Return Inlet Tappings: One 5" inlet in right end section and one 5" inlet in left end section. Intermediate sections are not furnished with inlet tappings but additional inlet tappings can be furnished on end sections when ordered shipped from point of manufacture.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL BONDED LOW WATER LINE BOILERS
(Hard Coal Type)

Series No. 40
Steam and Water
Dimensions

Indirect External Water Heater Tappings: One 2" tapping located on side of left end section. Boss for additional 2" tapping located on side of right end section. Additional 1½" tappings can be furnished on front of intermediate sections.

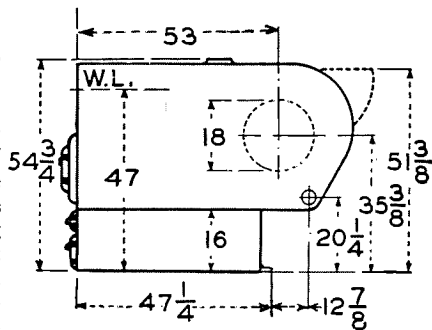

End view, showing dimensions.

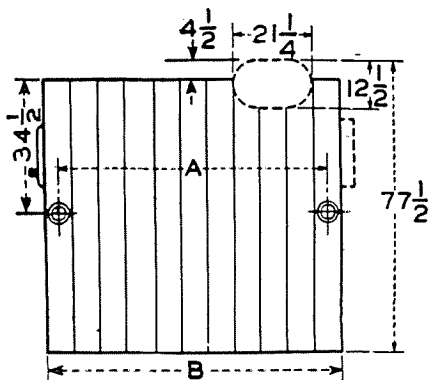

Top view, 6 to 11 section boiler.


| Boiler Number | A | B |
|---------------|---------|-----|
| 46 | 35 1/2" | 42" |
| 47 | 42 1/8" | 49" |
| 48 | 49 1/2" | 56" |
| 49 | 56 1/2" | 63" |
| 410 | 63 1/2" | 70" |
| 411 | 70 1/2" | 77" |

Smoke Outlet: End outlet furnished on boilers up to 10 sections. Rear outlet furnished on boilers having 11 or more sections. See page 140.

Dimensions of boilers having 12 or more sections are shown on opposite page. Standard assembly of sections is shown on page 149.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS
(Hard Coal Type)

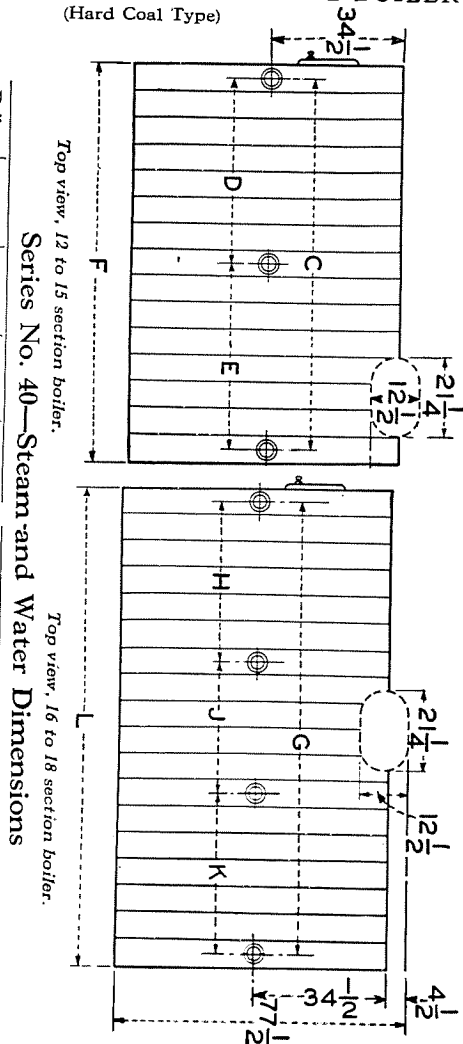

Top view, 12 to 15 section boiler.

Top view, 16 to 18 section boiler.

Series No. 40—Steam and Water Dimensions


| Boiler Number | C | D | E | F | Boiler Number | G | H | J | K | L |
|---------------|---------|---------|---------|------|---------------|----------|---------|-----|---------|------|
| 412 | 77 1/2" | 35 1/4" | 42 1/4" | 84" | 416 | 105 1/2" | 35 1/4" | 35" | 35 1/4" | 112" |
| 413 | 84 1/8" | 42 1/4" | 42 1/4" | 91" | 417 | 112 1/2" | 35 1/4" | 42" | 35 1/4" | 119" |
| 414 | 91 1/2" | 42 1/4" | 49 1/4" | 98" | 418 | 119 1/2" | 42 1/4" | 35" | 42 1/4" | 126" |
| 415 | 98 1/2" | 49 1/4" | 49 1/4" | 105" | | | | | | |

Dimensions subject to slight variations in assembly. Ash pit and foundation measurements are shown on page 150.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS

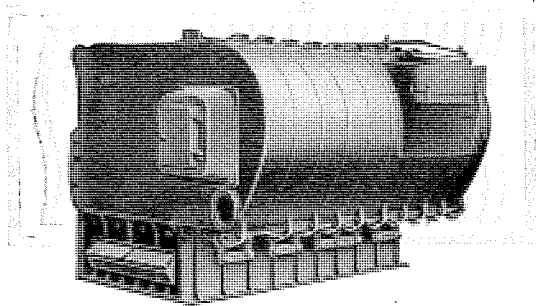

Rear View of National Bonded Low Water Line Boiler Showing Rear Smoke Box.

BOILERS up to ten sections (both Series No. 30 and 40 hard coal and smokeless) are regularly equipped with an end smoke box, as shown on page 130. A rear smoke box can be furnished in boilers having ten sections or less if location of chimney makes it impracticable to use the recommended end smoke box.

Boilers having eleven or more sections are regularly equipped with a rear smoke box as illustrated above. The rear smoke outlet is formed by cutting out a portion of two or three intermediate sections. Since all intermediate sections are the same, these cut-out sections can be located at the right or left end or in the center, whichever best meets local conditions. Excepting in boilers having sixteen or more sections, either end is preferable to the center location.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL BONDED LOW WATER LINE BOILERS

Smokeless . . .

Where Ordinances Demand It

WHILE soft coal at a low rate of combustion may be burned in the Low Water Line Boiler without objectionable smoke, a smokeless low water line boiler has been developed that passes smoke tests when operated at higher rates of combustion.


Specially designed air retorts are placed between the intermediate sections, and supply heated air over the entire length of the fire box. The retorts form a baffle, under which all unconsumed gases must pass, and become thoroughly mixed with the secondary air.

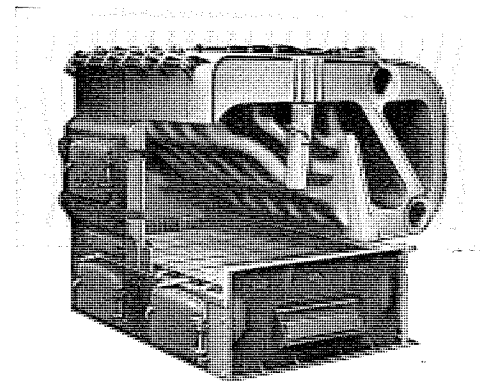

National Low Water Line Smokeless Boilers have passed smoke tests satisfactorily in principal cities throughout the country. All of the outstanding features of the National Low Water Line Hard Coal type are, of course, present.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)

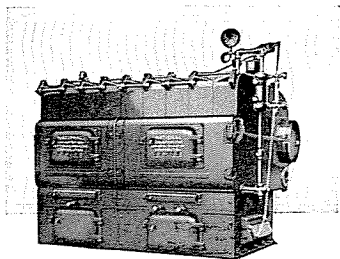

Series No. 30
Sizes and Ratings
For Steam, Vapor and Hot
Water

THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney | | Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|-------------|-------------|--------------------------|
| | | | | | | Area Inches | Height Feet | |
| Steam | | | | | | | | |
| 530-SS | 1,700 | 850 | 5.83 | 2-4" | 2-4" | 12 x 12 | 40 | 42 |
| 630-SS | 2,200 | 1,100 | 7.29 | 2-4" | 2-4" | 12 x 12 | 40 | 46 |
| 730-SS | 2,700 | 1,350 | 8.75 | 2-4" | 2-4" | 12 x 12 | 40 | 51 |
| 830-SS | 3,200 | 1,600 | 10.21 | 2-4" | 2-4" | 12 x 12 | 40 | 56 |
| 930-SS | 3,700 | 1,850 | 11.67 | 2-4" | 2-4" | 12 x 16 | 45 | 60 |
| 1030-SS | 4,200 | 2,100 | 13.13 | 2-4" | 2-4" | 12 x 16 | 45 | 65 |
| 1130-SS | 4,700 | 2,350 | 14.59 | 2-4" | 2-4" | 12 x 16 | 50 | 68 |
| 1230-SS | 5,200 | 2,600 | 16.05 | 2-4" | 2-4" | 16 x 16 | 50 | 73 |

| Water | | | | | | | | |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|----------------------------|---------------------|---------------------|--------------------------|
| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets Number and Size In. | Chimney Area Inches | Chimney Height Feet | Covering Surface Sq. Ft. |
| 530-SW | 2,800 | 1,400 | 5.83 | 2-4" | 2-4" | 12 x 12 | 40 | 42 |
| 630-SW | 3,600 | 1,815 | 7.29 | 2-4" | 2-4" | 12 x 12 | 40 | 46 |
| 730-SW | 4,400 | 2,230 | 8.75 | 2-4" | 2-4" | 12 x 12 | 40 | 51 |
| 830-SW | 5,200 | 2,645 | 10.21 | 2-4" | 2-4" | 12 x 12 | 40 | 56 |
| 930-SW | 6,000 | 3,060 | 11.67 | 2-4" | 2-4" | 12 x 16 | 45 | 60 |
| 1030-SW | 6,800 | 3,475 | 13.13 | 2-4" | 2-4" | 12 x 16 | 45 | 65 |
| 1130-SW | 7,600 | 3,890 | 14.59 | 2-4" | 2-4" | 12 x 16 | 50 | 68 |
| 1230-SW | 8,400 | 4,305 | 16.05 | 2-4" | 2-4" | 16 x 16 | 50 | 73 |

†Square feet of exterior boiler surface.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)

Series No. 30
Steam and Water
Dimensions

Supply Outlet Tappings: One 4" outlet in right end section and one 4" outlet in left end section. No. 30 Series boilers not furnished with intermediate tapped sections.

Return Inlet Tappings: One 4" inlet in the side of right end section and one 4" inlet in the side of left end section.

Center to center distance between sections is 7 inches.

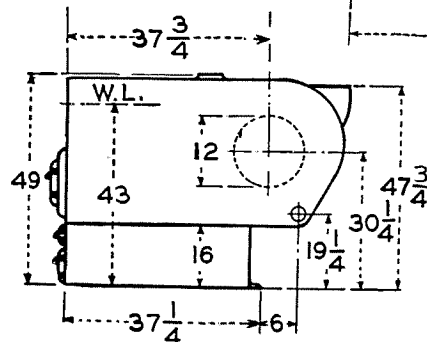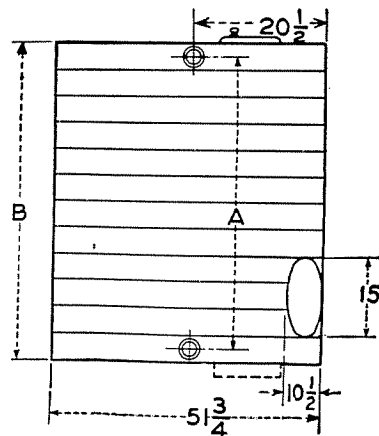

Approximately 47 pounds of insulation per section required to provide boiler covering 1 1/2 inches thick.

Indirect Water Heater Tappings: One 2" tapping located on side of left end section. Boss for additional 2" tapping located on side of right end section. Additional 1 1/2" tappings can be furnished on front of intermediate sections.

Smoke Outlet: End outlet furnished on boilers up to 10 sections. Rear outlet furnished on longer boilers. See page 140.

| Boiler Numbers | | A | B |
|----------------|---------|---------|-----|
| 530-SS | 530-SW | 28 1/2" | 35" |
| 630-SS | 630-SW | 35 1/2" | 42" |
| 730-SS | 730-SW | 42 1/2" | 49" |
| 830-SS | 830-SW | 49 1/2" | 56" |
| 930-SS | 930-SW | 56 1/2" | 63" |
| 1030-SS | 1030-SW | 63 1/2" | 70" |
| 1130-SS | 1130-SW | 70 1/2" | 77" |
| 1230-SS | 1230-SW | 77 1/2" | 84" |


Measurements subject to slight variations in assembly.

Ash pit and foundation measurements are shown on page 150.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)

Series No. 40
Sizes and Ratings
For Steam and Vapor



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers, "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets No. and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|-------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 640-SS | 4,100 | 1,800 | 9.79 | 2-5" | 2-5" | 12 x 16 | 45 | 59 |
| 740-SS | 4,900 | 2,200 | 11.73 | 2-5" | 2-5" | 12 x 16 | 45 | 65 |
| 840-SS | 5,700 | 2,600 | 13.68 | 2-5" | 2-5" | 16 x 16 | 50 | 72 |
| 940-SS | 6,500 | 3,000 | 15.62 | 2-5" | 2-5" | 16 x 20 | 55 | 78 |
| 1040-SS | 7,300 | 3,400 | 17.57 | 2-5" | 2-5" | 16 x 20 | 55 | 85 |
| 1140-SS | 8,100 | 3,800 | 19.51 | 2-5" | 2-5" | 20 x 20 | 55 | 89 |
| 1240-SS | 8,900 | 4,200 | 21.45 | 2-5" 1-4" | 2-5" | 20 x 20 | 60 | 96 |
| 1340-SS | 9,700 | 4,600 | 23.40 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 102 |
| 1440-SS | 10,500 | 5,000 | 25.34 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 108 |
| 1540-SS | 11,300 | 5,400 | 27.29 | 2-5" 1-4" | 2-5" | 24 x 28 | 65 | 115 |
| 1640-SS | 12,100 | 5,800 | 29.23 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 121 |
| 1740-SS | 12,900 | 6,200 | 31.17 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 128 |
| 1840-SS | 13,700 | 6,600 | 33.12 | 2-5" 2-4" | 2-5" | 28 x 32 | 70 | 135 |

† Square feet of exterior boiler surface.

Approximately 57 pounds of insulation per section required to provide boiler covering 1½ inches thick.


Supply Outlet Tappings: One 5" outlet in right end section and one 5" outlet in left end section. Additional 4" outlets are furnished in intermediate sections in boilers having 12 or more sections. See dimension table, page 147, for location of intermediate sections with outlets.

Return Inlet Tappings: One 5" inlet in right end section and one 5" inlet in left end section.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)

Series No. 40
Sizes and Ratings
For Hot Water



THE number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet." For comparison with similarly rated boilers, "Available Output" ratings are also shown.

| Boiler Number | Available Output Rating Sq. Ft. | Bonded Direct C. I. Radiation Sq. Ft. | Grate Area Sq. Ft. | Outlets Number and Size In. | Inlets No. and Size In. | Chimney | | †Covering Surface Sq. Ft. |
|---------------|---------------------------------|---------------------------------------|--------------------|-----------------------------|-------------------------|-------------|-------------|---------------------------|
| | | | | | | Area Inches | Height Feet | |
| 640-SW | 6,600 | 2,970 | 9.79 | 2-5" | 2-5" | 12 x 16 | 45 | 59 |
| 740-SW | 7,900 | 3,630 | 11.73 | 2-5" | 2-5" | 12 x 16 | 45 | 65 |
| 840-SW | 9,200 | 4,290 | 13.68 | 2-5" | 2-5" | 16 x 16 | 50 | 72 |
| 940-SW | 10,500 | 4,950 | 15.62 | 2-5" | 2-5" | 16 x 20 | 55 | 78 |
| 1040-SW | 11,800 | 5,610 | 17.57 | 2-5" | 2-5" | 16 x 20 | 55 | 85 |
| 1140-SW | 13,100 | 6,270 | 19.51 | 2-5" | 2-5" | 20 x 20 | 55 | 89 |
| 1240-SW | 14,400 | 6,930 | 21.45 | 2-5" 1-4" | 2-5" | 20 x 20 | 60 | 96 |
| 1340-SW | 15,700 | 7,590 | 23.40 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 102 |
| 1440-SW | 17,000 | 8,250 | 25.34 | 2-5" 1-4" | 2-5" | 24 x 24 | 65 | 108 |
| 1540-SW | 18,300 | 8,910 | 27.29 | 2-5" 1-4" | 2-5" | 24 x 28 | 65 | 115 |
| 1640-SW | 19,600 | 9,570 | 29.23 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 121 |
| 1740-SW | 20,900 | 10,230 | 31.17 | 2-5" 2-4" | 2-5" | 28 x 28 | 70 | 128 |
| 1840-SW | 22,200 | 10,890 | 33.12 | 2-5" 2-4" | 2-5" | 28 x 32 | 70 | 135 |

† Square feet of exterior boiler surface.

Approximately 57 pounds of insulation per section required to provide boiler covering 1½ inches thick.

Supply Outlet Tappings: One 5" outlet in right end section and one 5" outlet in left end section. Additional 4" outlets are furnished in intermediate sections in boilers having 12 or more sections. See dimension table, page 147, for location of intermediate sections with outlets.


Return Inlet Tappings: One 5" inlet in right end section and one 5" inlet in left end section. Intermediate sections are not furnished with inlets, but additional inlet-tappings can be furnished on end sections when ordered shipped from point of manufacture.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)

Series No. 40—
Steam and Water
Dimensions

Indirect External Water Heater Tappings: One 2" tapping located outside of left end section. Boss for additional 2" tapping located on side of right end section. Additional 1½" tappings can be furnished on front of intermediate sections.

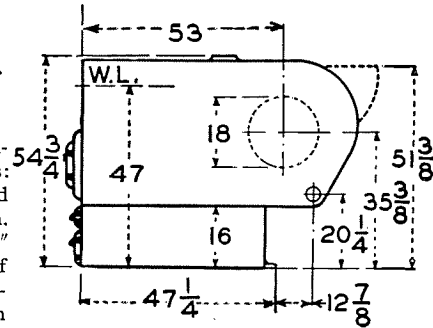

End view, showing dimensions.

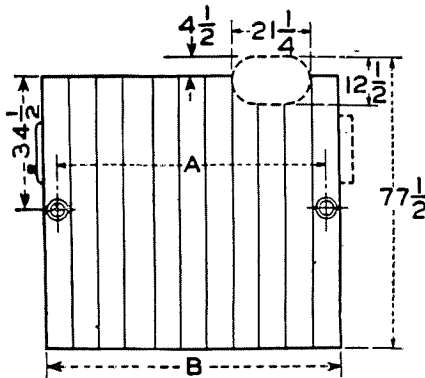

Top view, 6 to 11 section boiler.

| Boiler Number | A | B |
|---------------|------|-----|
| 640 | 35½" | 42" |
| 740 | 42½" | 49" |
| 840 | 49½" | 56" |
| 940 | 56½" | 63" |
| 1040 | 63½" | 70" |
| 1140 | 70½" | 77" |

Smoke Outlet:—End outlet furnished on boilers up to 10 sections. Rear Outlet furnished on boilers having 11 or more sections. See page 140.

Dimensions of boilers having 12 or more sections are shown on page 147.


Standard assembly of sections is shown on page 149.

NATIONAL BONDED LOW WATER LINE BOILERS
(Smokeless Type)


Series No. 40—Steam and Water Dimensions

| Boiler Number | C | D | E | F | Boiler Number | G | H | J | K | L |
|---------------|------|------|------|------|---------------|-------|------|-----|------|------|
| 1240 | 77½" | 35¼" | 42¼" | 84" | 1640 | 105½" | 35¼" | 35" | 35¼" | 112" |
| 1340 | 84½" | 42¼" | 42¼" | 91" | 1740 | 112½" | 35¼" | 42" | 35¼" | 119" |
| 1440 | 91½" | 42¼" | 49¼" | 98" | 1840 | 119½" | 42¼" | 35" | 42¼" | 126" |
| 1540 | 98½" | 49¼" | 49¼" | 105" | | | | | | |

Dimensions subject to slight variations in assembly. Aspire and foundation measurements are shown on page 150.

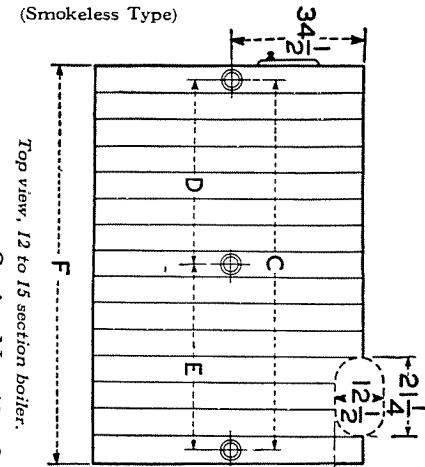

Top view, 12 to 15 section boiler.

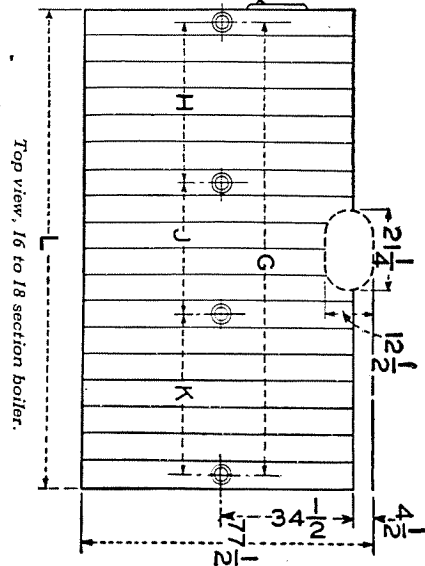

Top view, 16 to 18 section boiler.

NATIONAL BONDED LOW WATER LINE BOILERS

Series No. 30
Hard Coal and Smokeless

Standard Assembly of Boiler Sections

The series No. 30 in either hard coal or smokeless types, can easily be correctly assembled by following this diagram:

LE°—Left end, supply outlet and return inlet; RE°—Right end, supply outlet and return inlet; I—Intermediate plain; W—Full smoke outlet on back, plain.

Arrangement of Sections—Steam and Water Boilers

| 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 | Boiler Numbers | | Grates | | Water Fronts | | | |
|-----|----|----|---|---|---|-----|---|---|---|-----|---|----------------|-----------|--------|---------|--------------|-------|-------|-------|
| | | | | | | | | | | | | Regular | Smokeless | Plain | Shaking | No. 4 | No. 5 | No. 6 | No. 7 |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 35 | 530 | 2 | 2 | 1 | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 36 | 630 | 3 | 2 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 37 | 730 | 4 | 2 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 38 | 830 | 5 | 2 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 39 | 930 | 5 | 3 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 310 | 1030 | 5 | 4 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 311 | 1130 | 7 | 3 | | | | |
| LE° | I | I | I | I | I | LE° | I | I | I | RE° | I | 312 | 1230 | 7 | 4 | | | | |

(°) after key letter indicates section has supply outlet tapping.
Center to center distance between sections is 7 inches.

NATIONAL BONDED LOW WATER LINE BOILERS

Series No. 40
Hard Coal and Smokeless

Standard Assembly of Boiler Sections

The Series No. 40 in either hard coal or smokeless types, can easily be correctly assembled by following this diagram:

LE°—Left end, supply outlet and return inlet; RE°—Right end, supply outlet and return inlet; I—Intermediate plain; T°—Intermediate supply outlet, no return; U—Half smoke outlet on back, plain; W—Full smoke outlet on back, plain.

Arrangement of Sections—Steam and Water Boilers


| 18 | 17 | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 | Boiler Numbers | | Grates | | Water Fronts | | | |
|-----|----|----|----|----|----|----|----|----|---|-----|---|---|---|---|---|---|---|----------------|-----------|--------|---------|--------------|-------|-------|-------|
| | | | | | | | | | | | | | | | | | | Regular | Smokeless | Plain | Shaking | No. 4 | No. 5 | No. 6 | No. 7 |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 46 | 640 | 3 | 2 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 47 | 740 | 4 | 2 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 48 | 840 | 5 | 2 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 49 | 940 | 5 | 3 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 410 | 1040 | 5 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 411 | 1140 | 7 | 3 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 412 | 1240 | 7 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 413 | 1340 | 8 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 414 | 1440 | 9 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 415 | 1540 | 10 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 416 | 1640 | 11 | 4 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 417 | 1740 | 11 | 5 | | | | |
| LE° | I | I | I | I | I | I | I | I | I | LE° | I | I | I | I | I | I | I | 418 | 1840 | 11 | 6 | | | | |

(°) after key letter indicates section has supply outlet tapping.
Center to center distance between tappings is 7 inches.

NATIONAL BONDED LOW WATER LINE BOILERS
(Hard Coal and Smokeless Types)

Foundation and Pitting Dimensions

Series No. 30 and 40

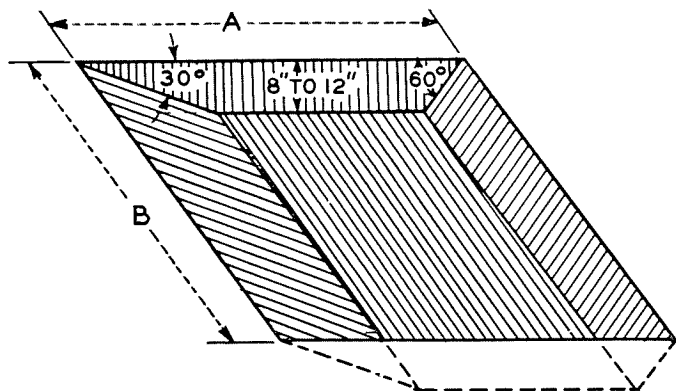

The tables on the opposite page give all the measurements necessary for the proper pitting of all types of National Low Water Line Boilers; Series No. 30, and Series No. 40, Hard Coal and Smokeless Types. Whenever conditions will permit, an ash pit is recommended. Measurements refer to corresponding letters on the diagram. When basement floor is not yet laid, surround pit with a foundation 10 to 12 inches wide.

NATIONAL BONDED LOW WATER LINE BOILERS
(Hard Coal and Smokeless Types)

Series No. 30 and No. 40
Foundation and Pitting Dimensions


Series No. 30

| Boiler Numbers | | A | B |
|----------------|-----------|-----|-----|
| Hard Coal | Smokeless | | |
| 35 | 530 | 30" | 29" |
| 36 | 630 | 30" | 36" |
| 37 | 730 | 30" | 43" |
| 38 | 830 | 30" | 50" |
| 39 | 930 | 30" | 57" |
| 310 | 1030 | 30" | 64" |
| 311 | 1130 | 30" | 71" |
| 312 | 1230 | 30" | 78" |

Series No. 40

| Boiler Numbers | | A | B |
|----------------|-----------|-----|------|
| Hard Coal | Smokeless | | |
| 46 | 640 | 40" | 36" |
| 47 | 740 | 40" | 43" |
| 48 | 840 | 40" | 50" |
| 49 | 940 | 40" | 57" |
| 410 | 1040 | 40" | 64" |
| 411 | 1140 | 40" | 71" |
| 412 | 1240 | 40" | 78" |
| 413 | 1340 | 40" | 85" |
| 414 | 1440 | 40" | 92" |
| 415 | 1540 | 40" | 99" |
| 416 | 1640 | 40" | 106" |
| 417 | 1740 | 40" | 113" |
| 418 | 1840 | 40" | 120" |

NATIONAL HOT WATER SUPPLY BOILERS

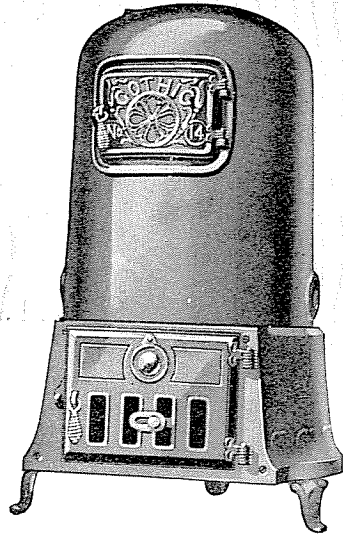

National Gothic Hot Water Supply Boiler

All year round National Hot Water Supply Boilers furnish a constant and unfailing supply of steaming hot water, at small cost, and with little attention. The line provides sizes suitable for applications ranging from small to large homes, and small apartments, with requirements of from 64 to 198 gallons per hour.

Base bottom and legs regularly furnished with No. 10 Gothic, and on special order can be furnished with Numbers 12, 14, and 16 Gothic.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HOT WATER SUPPLY BOILERS

Economy . . .
of operation that
comes from proper design


MODERN standards of living demand hot water the year round. The best, most economical method of supplying it is the utilization of National Hot Water Supply Boilers.

Both winter and summer requirements are satisfied. The generous proportions of the fire pot makes frequent attention unnecessary. The fire pot is entirely surrounded with a jacket of water, which absorbs a large proportion of the heat units in the fuel. The relatively low temperature of this water keeps radiation down so that the temperature of the basement is little affected, in the summer. National Hot Water Supply Boilers are constructed to stand the unusual pressure strains to which this type of service subjects them.

Hot Water Supply Boilers, where practicable, are recommended in preference to installing coils in the fire box of house heating boilers. Such coils absorb heat that may be needed for warming the home; they cool the gases in the fire box, thus interfering with proper combustion and often form a nucleus for clinker, which reduces the efficiency of coil and boiler alike.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HOT WATER SUPPLY BOILERS

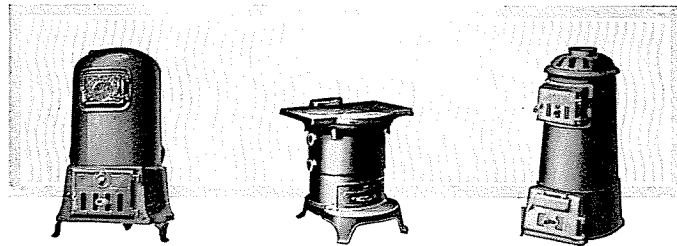

No. 10, 12, 14
and 16 Gothic

No. 5 Laundry

No. 10-N Gothic

National Gothic Hot Water Supply Boilers

Gallons of water each boiler will heat

| Boiler Number | Nominal Diameter Grate Inches | * Tank Capacity Gallons per Hour | Outlets | | Inlets | | Diameter Smoke Collar Inches |
|------------------------|-------------------------------|----------------------------------|---------|-----------------|--------|-----------------|------------------------------|
| | | | No. | Size Inches | No. | Size Inches | |
| <i>National Gothic</i> | | | | | | | |
| 10 | 10 | 64 | 1 | 2 | 2 | 2 | 5 $\frac{1}{8}$ |
| 10-N | 10 | 78 | 1 | 1 $\frac{1}{2}$ | 1 | 1 $\frac{1}{2}$ | 5 |
| 12 | 12 | 111 | 1 | 2 | 2 | 2 | 6 |
| 14 | 14 | 165 | 1 | 2 $\frac{1}{2}$ | 2 | 2 | 6 |
| 16 | 16 | 198 | 1 | 2 $\frac{1}{2}$ | 2 | 2 | 7 |

National Laundry Heater

(Gurney Design)

| | | | | | | | |
|---|----|----|---|---|---|---|---|
| 5 | 12 | 85 | 1 | 1 | 1 | 1 | 6 |
|---|----|----|---|---|---|---|---|

*These capacities based on an 8-hour firing period and a 25 degree temperature rise.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HOT WATER SUPPLY BOILERS

No. 10 National Gothic

| Hours | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|-----------------------|------------------------------|--------|--------|--------|--------|--------|-------|-------|
| Power per Hour—B.T.U. | 21,360 | 17,820 | 15,240 | 13,380 | 11,880 | 10,680 | 9,720 | 8,880 |
| Temp. Rise per Hour | Capacity in Gallons per Hour | | | | | | | |
| 25° | 103 | 86 | 73 | 64 | 57 | 51 | 47 | 43 |
| 50° | 51 | 43 | 36 | 32 | 28 | 26 | 24 | 22 |
| 100° | 26 | 22 | 18 | 16 | 14 | 13 | 12 | 11 |

No. 10-N National Gothic

| Hours | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|-----------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|
| Power per Hour—B.T.U. | 26,040 | 21,720 | 18,600 | 16,260 | 14,460 | 13,020 | 11,820 | 10,860 |
| Temp. Rise per Hour | Capacity in Gallons per Hour | | | | | | | |
| 25° | 125 | 104 | 90 | 78 | 70 | 63 | 57 | 50 |
| 50° | 63 | 52 | 45 | 39 | 35 | 32 | 29 | 25 |
| 100° | 31 | 26 | 23 | 20 | 18 | 16 | 14 | 12 |

No. 12 National Gothic

| Hours | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|-----------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|
| Power per Hour—B.T.U. | 36,720 | 30,600 | 26,220 | 22,980 | 20,400 | 18,360 | 16,680 | 15,300 |
| Temp. Rise per Hour | Capacity in Gallons per Hour | | | | | | | |
| 25° | 176 | 147 | 126 | 111 | 98 | 88 | 80 | 74 |
| 50° | 88 | 74 | 63 | 55 | 49 | 44 | 40 | 37 |
| 100° | 44 | 37 | 31 | 28 | 25 | 22 | 20 | 19 |

No. 14 National Gothic


| Hours | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|-----------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|
| Power per Hour—B.T.U. | 54,840 | 45,720 | 39,180 | 34,260 | 30,480 | 27,420 | 24,900 | 22,860 |
| Temp. Rise per Hour | Capacity in Gallons per Hour | | | | | | | |
| 25° | 264 | 220 | 188 | 165 | 146 | 132 | 120 | 110 |
| 50° | 132 | 110 | 94 | 82 | 73 | 66 | 60 | 55 |
| 100° | 66 | 55 | 47 | 41 | 37 | 33 | 30 | 28 |

No. 16 National Gothic

| Hours | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 |
|-----------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|
| Power per Hour—B.T.U. | 65,640 | 54,720 | 46,860 | 41,040 | 36,480 | 32,820 | 29,820 | 27,300 |
| Temp. Rise per Hour | Capacity in Gallons per Hour | | | | | | | |
| 25° | 316 | 263 | 226 | 198 | 175 | 158 | 144 | 132 |
| 50° | 158 | 132 | 113 | 99 | 87 | 79 | 72 | 66 |
| 100° | 79 | 66 | 56 | 49 | 44 | 39 | 36 | 33 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HOT WATER SUPPLY BOILERS

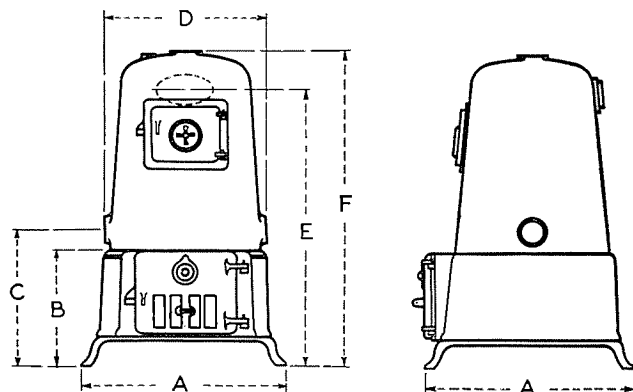

Gothic No. 10, 12, 14 and 16
Dimensions

| Boiler Number | A | B | C | D | E | F |
|---------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| Gothic No. 10 | 18 " | 13 " | 14 $\frac{5}{8}$ " | 14 $\frac{1}{2}$ " | 28 $\frac{1}{2}$ " | 33 $\frac{3}{4}$ " |
| Gothic No. 12 | 21 $\frac{1}{2}$ " | 13 $\frac{3}{4}$ " | 16 " | 16 $\frac{1}{2}$ " | 30 $\frac{3}{8}$ " | 35 $\frac{5}{8}$ " |
| Gothic No. 14 | 24 " | 14 $\frac{3}{4}$ " | 17 $\frac{3}{8}$ " | 19 $\frac{1}{2}$ " | 33 $\frac{1}{8}$ " | 39 $\frac{1}{8}$ " |
| Gothic No. 16 | 25 $\frac{1}{2}$ " | 15 $\frac{3}{4}$ " | 18 $\frac{1}{2}$ " | 21 $\frac{3}{8}$ " | 34 $\frac{3}{4}$ " | 40 $\frac{7}{8}$ " |


National Gothic Hot Water Supply Boilers (No. 10, 12, 14 and 16) are of sturdy construction, capable and efficient. A roomy fire box holds a heavy fuel charge, requiring attention only infrequently. The range of sizes provides for hot water output requiring the heating of 64 to 198 gallons of water per hour.

Regularly tested to 80 pounds hydrostatic pressure for 30 pounds working pressure.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HOT WATER SUPPLY BOILERS


On special order these boilers are tested to 200 pounds hydrostatic pressure for a maximum working pressure of 80 pounds. These special high test boilers are shipped only from New Castle plant. A pressure relief valve should be installed on all jobs.

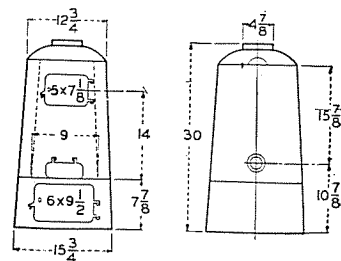

Diameter of smoke collar 5"

National Gothic No. 10-N

Has an unusually deep fire box, and for that reason requires only infrequent attention. Is of sufficient capacity to furnish hot water for homes with two or three baths.

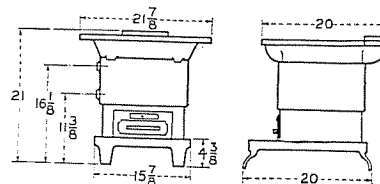

Diameter of smoke collar 6"

National Laundry No. 5


This laundry boiler has sufficient capacity to take care of the hot water requirements in the average home. A wash boiler may, if desired, be placed on the flat top.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Oil Burning . . .

With Efficiency, Economy, and Bonded Results

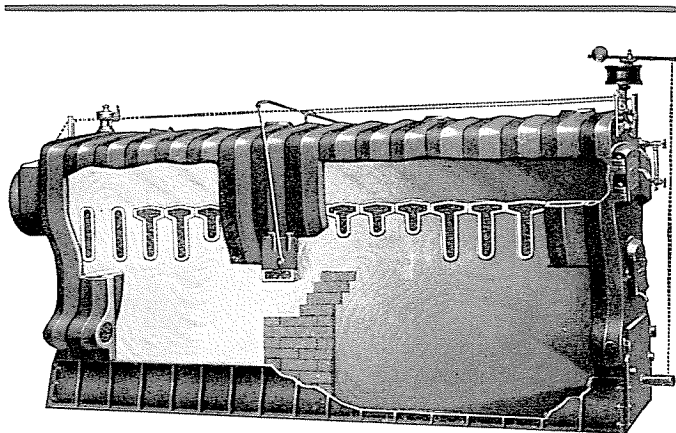

S-04017 National Bonded Super-Smokeless Oil Burning Boiler, showing typical illustration of the application of a "gun" type oil burner. The air baffle section and bridge-wall section may be omitted if the boiler is to be used exclusively for oil burning.

National Bonded Oil Burning Boilers have achieved remarkable success in burning oil. The scientific proportioning of combustion chambers, and the design of fire travels and waterways, were developed after years of careful research, testing and experiment. They combine to set up a balanced condition that ideally fits the boilers for economical operation with rotary, gun, and pot types of oil burners.

Scientifically designed, the heating qualities of National Bonded Oil Burning Boilers are not a matter of speculation. Satisfactory heating qualities are assured.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

National Round Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam Boiler No. | Steam | | Specifications Applying to Both | | | Water | | |
|------------------|---------------------------------------|------------------------------|---------------------------------|-------------|-------------|------------------|---------------------------------------|------------------------------|
| | Bonded Direct C. I. Radiation Sq. Ft. | Height Supply Outlets Inches | Outlets Number and Size Inches | Chimney | | Water Boiler No. | Bonded Direct C. I. Radiation Sq. Ft. | Height Supply Outlets Inches |
| | | | | Area Inches | Height Feet | | | |
| 017-5S | 195 | 51 | 2-2½" | 8 x 8 | 30 | 017-5W | 320 | 46¾ |
| 017-6S | 215 | 55½ | 2-2½" | 8 x 8 | 35 | 017-6W | 355 | 51½ |
| 020-5S | 300 | 56½ | 2-2½" | 8 x 8 | 35 | 020-5W | 495 | 51¾ |
| 020-6S | 325 | 61½ | 2-2½" | 8 x 12 | 35 | 020-6W | 535 | 56¾ |
| 023-5S | 410 | 56½ | 2-3" | 8 x 12 | 35 | 023-5W | 675 | 50¾ |
| 023-6S | 445 | 61½ | 2-3" | 8 x 12 | 40 | 023-6W | 730 | 55¾ |
| 026-5S | 525 | 56½ | 2-3" | 8 x 12 | 35 | 026-5W | 865 | 50¾ |
| 026-6S | 575 | 61½ | 2-3" | 8 x 12 | 40 | 026-6W | 945 | 55¾ |
| 029-5S | 675 | 57½ | 2-4" | 12 x 12 | 35 | 029-5W | 1,115 | 51¾ |
| 029-6S | 725 | 62½ | 2-4" | 12 x 12 | 40 | 029-6W | 1,195 | 56¾ |
| 032-5S | 850 | 57½ | 2-4" | 12 x 12 | 40 | 032-5W | 1,400 | 51¾ |
| 032-6S | 925 | 62½ | 2-4" | 12 x 12 | 40 | 032-6W | 1,530 | 56¾ |

| Series Number | Height of Base | Width of Base | Height to Center Return Inlet | Distance Normal Grate to Crown | Ashpit Door Dimensions | Fire Door Dimensions |
|---------------|----------------|---------------|-------------------------------|--------------------------------|------------------------|----------------------|
| 17 | 12" | 22" | 14¼" | 22½" | 9½" x 13" | 9" x 10¾" |
| 20 | 12" | 28½" | 14½" | 24" | 9" x 13" | 9" x 11" |
| 23 | 12¼" | 31¾" | 14½" | 24½" | 9" x 13" | 8¾" x 13" |
| 26 | 12¼" | 34½" | 15" | 24½" | 9" x 15" | 9" x 13" |
| 29 | 12¼" | 37½" | 15½" | 26¼" | 9" x 15" | 9¾" x 15" |
| 32 | 12½" | 40¾" | 15½" | 26¼" | 9" x 15" | 10" x 15" |

One 1½" tapping in dome section for indirect heater.
Additional dimensions are shown on pages 49 and 51.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Jacketed Square Boilers—Oil Burning Type

Series No. 2, 3 and 4

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Specifications Applying to Both | | | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| | | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | | |
| | | | | Area Inches | Height Feet | | |
| 02-S-5 | 350 | 2-2½" | 16½ | 8 x 8 | 30 | 02-W-5 | 580 |
| 02-S-6 | 460 | 2-2½" | 20¾ | 8 x 8 | 30 | 02-W-6 | 760 |
| 02-S-7 | 570 | 2-2½" | 25 | 8 x 12 | 35 | 02-W-7 | 940 |
| 02-S-8 | 680 | 3-2½" | 29¼ | 8 x 12 | 35 | 02-W-8 | 1,120 |
| 02-S-9 | 790 | 3-2½" | 33½ | 8 x 12 | 35 | 02-W-9 | 1,300 |
| 03-S-5 | 580 | 2-3" | 23⅛ | 8 x 12 | 35 | 03-W-5 | 950 |
| 03-S-6 | 730 | 2-3" | 29 | 8 x 12 | 35 | 03-W-6 | 1,200 |
| 03-S-7 | 880 | 3-3" | 34⅞ | 8 x 12 | 35 | 03-W-7 | 1,450 |
| 03-S-8 | 1,030 | 3-3" | 40¾ | 8 x 12 | 40 | 03-W-8 | 1,700 |
| 04-S-5 | 840 | 2-4" | 28⅞ | 12 x 12 | 30 | 04-W-5 | 1,380 |
| 04-S-6 | 1,050 | 2-4" | 35 | 12 x 12 | 35 | 04-W-6 | 1,730 |
| 04-S-7 | 1,260 | 3-4" | 42⅞ | 12 x 12 | 35 | 04-W-7 | 2,080 |
| 04-S-8 | 1,470 | 3-4" | 49¾ | 12 x 12 | 40 | 04-W-8 | 2,430 |
| 04-S-9 | 1,680 | 3-4" | 56⅞ | 12 x 16 | 45 | 04-W-9 | 2,780 |


NATIONAL BONDED OIL BURNING BOILERS

Jacketed Square Boilers—Oil Burning Type

Series No. 2—Dimensions

Fire Door 9" x 13¼"
Ashpit Door 8" x 11½"


One 1½" tapping on rear of back section for indirect water heater. Additional 1½" tappings are furnished on right or left side of intermediate sections on special order. See pages 20 and 21 for additional dimensions and arrangement of sections.



Series No. 3—Dimensions

Fire Door 8⅜" x 13"
Ashpit Door 8⅜" x 13"


One 2" tapping on rear of back section for indirect water heater. Additional 1½" tappings are furnished on right or left side of intermediate sections on special order. See page 25 for additional dimensions and arrangement of sections.

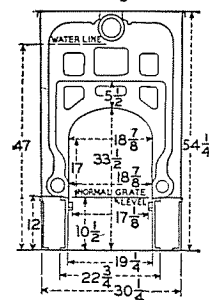

Series No. 4—Dimensions

Fire Door 10" x 16"
Ashpit Door 9½" x 13"

One 2" tapping on rear of back section for indirect water heater. Additional 1½" tappings are furnished on right or left side of intermediate sections on special order. See page 31 for additional dimensions and arrangement of sections.




NATIONAL BONDED OIL BURNING BOILERS

Novus Sectional Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|----------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| Series No. 20 | | | | | | | |
| 020-5-S | 580 | 2-3" | 23 $\frac{1}{8}$ " | 8 x 12 | 35 | 05-20-W | 950 |
| 020-6-S | 730 | 2-3" | 29 | 8 x 12 | 35 | 06-20-W | 1,200 |
| 020-7-S | 880 | 3-3" | 34 $\frac{7}{8}$ " | 8 x 12 | 35 | 07-20-W | 1,450 |
| 020-8-S | 1,030 | 3-3" | 40 $\frac{3}{4}$ " | 8 x 12 | 40 | 08-20-W | 1,700 |
| 020-9-S | 1,180 | 3-3" | 46 $\frac{5}{8}$ " | 8 x 12 | 40 | 09-20-W | 1,950 |
| 020-10-S | 1,330 | 3-3" | 52 $\frac{1}{2}$ " | 8 x 12 | 40 | 010-20-W | 2,200 |

| | | | | | | | |
|----------------------|-------|------|--------------------|---------|----|----------|-------|
| Series No. 25 | | | | | | | |
| 025-5-S | 840 | 2-4" | 28 $\frac{1}{8}$ " | 12 x 12 | 30 | 05-25-W | 1,380 |
| 025-6-S | 1 050 | 2-4" | 35 | 12 x 12 | 35 | 06-25-W | 1,730 |
| 025-7-S | 1,260 | 3-4" | 41 $\frac{7}{8}$ " | 12 x 12 | 35 | 07-25-W | 2,080 |
| 025-8-S | 1,470 | 3-4" | 48 $\frac{3}{4}$ " | 12 x 12 | 40 | 08-25-W | 2,430 |
| 025-9-S | 1,680 | 3-4" | 55 $\frac{5}{8}$ " | 12 x 16 | 45 | 09-25-W | 2,780 |
| 025-10-S | 1,890 | 3-4" | 62 $\frac{1}{2}$ " | 12 x 16 | 45 | 010-25-W | 3,130 |
| 025-11-S | 2,100 | 3-4" | 69 $\frac{3}{8}$ " | 12 x 16 | 45 | 011-25-W | 3,480 |
| 025-12-S | 2,310 | 3-4" | 76 $\frac{1}{4}$ " | 12 x 16 | 50 | 012-25-W | 3,830 |



Series No. 20

Dimensions

Series No. 20 Series No. 25


Fire Door

8 $\frac{3}{8}$ " x 13" 10" x 16"

Ashpit Door

8 $\frac{3}{8}$ " x 13" 9 $\frac{1}{2}$ " x 13"

One 2" tapping on rear of back section for indirect water heater. Additional 1 $\frac{1}{2}$ " tappings are furnished on side of intermediate sections on special order.



Series No. 25

See pages 63 and 67 for additional dimensions and arrangement of sections.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL BONDED OIL BURNING BOILERS

Imperial Sectional Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|----------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| Series No. 32 | | | | | | | |
| S-0532 | 1,400 | 2-5" | 32 $\frac{1}{2}$ " | 14 x 14 | 40 | W-0532 | 2,315 |
| S-0632 | 1,750 | 2-5" | 40 $\frac{3}{4}$ " | 15 x 15 | 40 | W-0632 | 2,895 |
| S-0732 | 2,100 | 2-5" | 49 | 16 x 16 | 40 | W-0732 | 3,475 |
| S-0832 | 2,450 | 2-5" | 57 $\frac{1}{4}$ " | 16 x 16 | 50 | W-0832 | 4,055 |
| S-0932 | 2,800 | 3-5" | 65 $\frac{1}{2}$ " | 18 x 18 | 50 | W-0932 | 4,635 |

| | | | | | | | |
|----------------------|-------|------|--------------------|---------|----|---------|--------|
| Series No. 42 | | | | | | | |
| S-0642 | 2,500 | 2-5" | 40 $\frac{3}{4}$ " | 16 x 16 | 50 | W-0642 | 4,100 |
| S-0742 | 3,100 | 2-5" | 49 | 18 x 18 | 50 | W-0742 | 5,100 |
| S-0842 | 3,700 | 3-5" | 57 $\frac{1}{4}$ " | 18 x 18 | 55 | W-0842 | 6,100 |
| S-0942 | 4,300 | 3-5" | 65 $\frac{1}{2}$ " | 20 x 20 | 55 | W-0942 | 7,100 |
| S-01042 | 4,900 | 3-5" | 73 $\frac{3}{4}$ " | 20 x 20 | 60 | W-01042 | 8,100 |
| S-01142 | 5,500 | 3-5" | 82 | 21 x 21 | 60 | W-01142 | 9,100 |
| S-01242 | 6,000 | 4-5" | 73 $\frac{3}{4}$ " | 22 x 22 | 65 | W-01242 | 9,900 |
| S-01342 | 6,500 | 4-5" | 82 | 22 x 22 | 70 | W-01342 | 10,700 |
| S-01442 | 7,000 | 4-5" | 82 | 23 x 23 | 75 | W-01442 | 11,500 |
| S-01542 | 7,500 | 4-5" | 82 | 23 x 23 | 75 | W-01542 | 12,300 |
| S-01642 | 8,000 | 4-5" | 90 $\frac{1}{4}$ " | 24 x 24 | 80 | W-01642 | 13,100 |



Series No. 32

Dimensions

Series No. 32 | Series No. 42

Fire Door

9 $\frac{1}{2}$ " x 17" 12" x 23"

Ash Pit Door

8 $\frac{3}{4}$ " x 18 $\frac{3}{4}$ " 10 $\frac{1}{2}$ " x 23 $\frac{1}{4}$ "

A B A B


Low Crown Section

35 $\frac{1}{2}$ " 8 $\frac{1}{4}$ " 38 $\frac{1}{4}$ " 9"

High Crown Section

42 $\frac{1}{2}$ " 1" 46 $\frac{1}{4}$ " 1"

2" tapping on rear section for indirect water heater. Additional 1 $\frac{1}{2}$ " tappings can be furnished on intermediate sections.



Series No. 42

See pages 74 to 79 for additional dimensions and arrangement of sections.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Novus Sectional Boilers—Oil Burning Type Series No. 48

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| 048-6-S | 4,100 | 2-6" | 50 $\frac{3}{4}$ | 20 x 20 | 60 | 06-48-W | 6,700 |
| 048-7-S | 5,000 | 2-6" | 61 $\frac{1}{4}$ | 20 x 24 | 65 | 07-48-W | 8,300 |
| 048-8-S | 5,800 | 3-6" | 71 $\frac{3}{4}$ | 24 x 24 | 70 | 08-48-W | 9,600 |
| 048-9-S | 6,600 | 3-6" | 82 $\frac{1}{4}$ | 24 x 28 | 75 | 09-48-W | 10,900 |
| 048-10-S | 7,400 | 3-6" | 92 $\frac{3}{4}$ | 24 x 28 | 75 | 010-48-W | 12,200 |
| 048-11-S | 8,200 | 4-6" | 103 $\frac{1}{4}$ | 28 x 28 | 80 | 011-48-W | 13,500 |
| 048-12-S | 9,000 | 4-6" | 113 $\frac{3}{4}$ | 28 x 28 | 80 | 012-48-W | 14,800 |
| 048-13-S | 9,800 | 5-6" | 124 $\frac{1}{4}$ | 28 x 28 | 80 | 013-48-W | 16,100 |
| 048-14-S | 10,600 | 5-6" | 134 $\frac{3}{4}$ | 28 x 32 | 90 | 014-48-W | 17,400 |
| 048-15-S | 11,400 | 5-6" | 145 $\frac{1}{4}$ | 28 x 32 | 90 | 015-48-W | 18,700 |



Dimensions

2 Fire Doors 10 $\frac{3}{4}$ " x 17 $\frac{3}{4}$ "

Ashpit Door 11" x 19 $\frac{3}{4}$ "

One 2" tapping on rear of back section for indirect water heater. Additional 1 $\frac{1}{2}$ " tappings are furnished on side of intermediate sections on special order. See pages 85 and 86 for additional dimensions and arrangement of sections.

NATIONAL BONDED OIL BURNING BOILERS

Super-Smokeless Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|----------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| Series No. 24 | | | | | | | |
| S-0245 | 900 | 1-4" | 32 $\frac{1}{2}$ | 12 x 12 | 40 | W-0245 | 1,480 |
| S-0246 | 1,200 | 2-4" | 40 $\frac{3}{4}$ | 13 x 13 | 40 | W-0246 | 1,980 |
| S-0247 | 1,500 | 2-4" | 49 | 13 x 13 | 45 | W-0247 | 2,480 |
| S-0248 | 1,800 | 2-4" | 57 $\frac{1}{4}$ | 14 x 14 | 50 | W-0248 | 2,980 |
| S-0249 | 2,100 | 3-4" | 65 $\frac{1}{2}$ | 14 x 14 | 55 | W-0249 | 3,480 |

Series No. 33

| | | | | | | | |
|---------|-------|------|------------------|---------|----|---------|-------|
| S-0335 | 1,550 | 1-5" | 32 $\frac{1}{2}$ | 14 x 14 | 40 | W-0335 | 2,575 |
| S-0336 | 1,975 | 2-5" | 40 $\frac{3}{4}$ | 15 x 15 | 40 | W-0336 | 3,275 |
| S-0337 | 2,400 | 2-5" | 49 | 16 x 16 | 40 | W-0337 | 3,975 |
| S-0338 | 2,825 | 2-5" | 57 $\frac{1}{4}$ | 16 x 16 | 50 | W-0338 | 4,675 |
| S-0339 | 3,250 | 3-5" | 65 $\frac{1}{2}$ | 18 x 18 | 50 | W-0339 | 5,375 |
| S-03310 | 3,675 | 3-5" | 73 $\frac{3}{4}$ | 18 x 18 | 55 | W-03310 | 6,075 |
| S-03311 | 4,100 | 3-5" | 82 | 18 x 18 | 60 | W-03311 | 6,775 |
| S-03312 | 4,525 | 3-5" | 90 $\frac{1}{4}$ | 18 x 18 | 60 | W-03312 | 7,475 |

Dimensions

Series No. 24 Series No. 33


Fire Door 9 $\frac{1}{4}$ " x 16" 9 $\frac{1}{2}$ " x 17"

Ashpit Door 8 $\frac{3}{4}$ " x 19" 8 $\frac{3}{4}$ " x 18 $\frac{3}{4}$ "


Low Crown Section 35 $\frac{1}{4}$ " 8 $\frac{1}{4}$ "

High Crown Section 42 $\frac{1}{2}$ " 1"

One 2" tapping on rear of back section for indirect water heater. Additional 1 $\frac{1}{2}$ " tappings are furnished on side of intermediate sections on special order.



Series No. 24



Series No. 33

See pages 98 - 99 and 100 - 101 for additional dimensions and arrangement of sections.

NATIONAL BONDED OIL BURNING BOILERS

Super-Smokeless Boilers—Oil Burning Type Series No. 40

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| S-0406 | 2,600 | 2-5" | 40 $\frac{3}{4}$ | 16 x 16 | 50 | W-0406 | 4,200 |
| S-0407 | 3,200 | 2-5" | 49 | 18 x 18 | 50 | W-0407 | 5,200 |
| S-0408 | 3,800 | 3-5" | 57 $\frac{1}{4}$ | 18 x 18 | 55 | W-0408 | 6,200 |
| S-0409 | 4,400 | 3-5" | 65 $\frac{1}{2}$ | 20 x 20 | 55 | W-0409 | 7,200 |
| S-04010 | 5,000 | 3-5" | 73 $\frac{3}{4}$ | 20 x 20 | 60 | W-04010 | 8,200 |
| S-04011 | 5,600 | 3-5" | 82 | 21 x 21 | 60 | W-04011 | 9,200 |
| S-04012 | 6,200 | 4-5" | 73 $\frac{3}{4}$ | 22 x 22 | 65 | W-04012 | 10,200 |
| S-04013 | 6,800 | 4-5" | 73 $\frac{3}{4}$ | 22 x 22 | 70 | W-04013 | 11,200 |
| S-04014 | 7,400 | 4-5" | 82 | 23 x 23 | 75 | W-04014 | 12,200 |
| S-04015 | 8,000 | 4-5" | 82 | 23 x 23 | 75 | W-04015 | 13,200 |
| S-04016 | 8,600 | 4-5" | 82 | 24 x 24 | 80 | W-04016 | 14,200 |
| S-04017 | 9,200 | 4-5" | 82 | 24 x 24 | 80 | W-04017 | 15,200 |
| S-04018 | 9,800 | 4-5" | 82 | 25 x 25 | 80 | W-04018 | 16,200 |
| S-04019 | 10,400 | 5-5" | 82 | 25 x 25 | 85 | W-04019 | 17,200 |
| S-04020 | 11,000 | 5-5" | 82 | 25 x 25 | 90 | W-04020 | 18,200 |
| S-04021 | 11,600 | 5-5" | 82 | 25 x 25 | 100 | W-04021 | 19,200 |
| S-04022 | 12,200 | 5-5" | 82 | 26 x 26 | 100 | W-04022 | 20,200 |
| S-04023 | 12,800 | 5-5" | 82 | 27 x 27 | 100 | W-04023 | 21,200 |
| S-04024 | 13,400 | 5-5" | 82 | 27 x 27 | 100 | W-04024 | 22,200 |

Fire box length given above is distance from front of boiler to the bridgewall section. Add 8 $\frac{1}{4}$ " per section to dimensions given above to obtain distance from front section to back section.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Super-Smokeless Boilers—Oil Burning Type Duplex Series No. 82

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size Inches | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| S-0827 | 7,400 | 6-5" | 49 | 23 x 23 | 60 | W-0827 | 12,000 |
| S-0828 | 8,600 | 6-5" | 57 $\frac{1}{4}$ | 24 x 24 | 65 | W-0828 | 14,000 |
| S-0829 | 9,800 | 6-5" | 65 $\frac{1}{2}$ | 25 x 25 | 65 | W-0829 | 16,000 |
| S-08210 | 11,000 | 6-5" | 73 $\frac{3}{4}$ | 26 x 26 | 70 | W-08210 | 18,000 |
| S-08211 | 12,200 | 6-5" | 82 | 27 x 27 | 70 | W-08211 | 20,000 |
| S-08212 | 13,400 | 8-5" | 73 $\frac{3}{4}$ | 28 x 28 | 75 | W-08212 | 22,000 |
| S-08213 | 14,600 | 8-5" | 73 $\frac{3}{4}$ | 29 x 29 | 80 | W-08213 | 24,000 |
| S-08214 | 15,800 | 8-5" | 82 | 29 x 29 | 85 | W-08214 | 26,000 |
| S-08215 | 17,000 | 8-5" | 82 | 30 x 30 | 85 | W-08215 | 28,000 |
| S-08216 | 18,200 | 8-5" | 82 | 31 x 31 | 90 | W-08216 | 30,000 |
| S-08217 | 19,400 | 8-5" | 82 | 32 x 32 | 90 | W-08217 | 32,000 |
| S-08218 | 20,600 | 8-5" | 82 | 32 x 32 | 90 | W-08218 | 34,000 |


Dimensions

Series No. 40 and No. 82

Fire Door Opening 12" x 23"
Ashpit Door Opening 10 $\frac{1}{2}$ " x 23 $\frac{3}{4}$ "

One 2" tapping on rear of back section for indirect water heater. Additional 1 $\frac{1}{2}$ " tappings are furnished on side of intermediate sections on special order.

See pages 110-113 and 118-121 for additional dimensions and arrangements of sections.



Series No. 40

A B
Low Crown Section 38 $\frac{1}{4}$ " 9"
High Crown Section 46 $\frac{1}{4}$ " 1'


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Low Water Line Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."

| Steam | | Specifications Applying to Both | | | | Water | |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size In. | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| 035-S | 1,000 | 2-4" | 28½ | 12 x 12 | 40 | 035-W | 1,650 |
| 036-S | 1,300 | 2-4" | 35½ | 12 x 12 | 40 | 036-W | 2,150 |
| 037-S | 1,600 | 2-4" | 42½ | 12 x 12 | 40 | 037-W | 2,650 |
| 038-S | 1,900 | 2-4" | 49½ | 12 x 12 | 40 | 038-W | 3,150 |
| 039-S | 2,200 | 2-4" | 56½ | 12 x 16 | 45 | 039-W | 3,650 |
| 0310-S | 2,500 | 2-4" | 63½ | 12 x 16 | 45 | 0310-W | 4,150 |
| 0311-S | 2,800 | 2-4" | 70½ | 12 x 16 | 50 | 0311-W | 4,650 |
| 0312-S | 3,100 | 2-4" | 77½ | 16 x 16 | 50 | 0312-W | 5,150 |

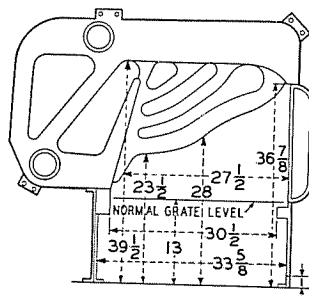

Dimensions

Fire Door 9½" x 14½"
Ashpit Door 9½" x 14½"

One 2" tapping on side of left end section for indirect water heater. Additional 1½" tappings are furnished on the front of intermediate sections on special order.

See pages 129, 148 for additional dimensions and arrangement of sections.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL BONDED OIL BURNING BOILERS

Low Water Line Boilers—Oil Burning Type

The number of square feet of direct cast iron radiation each boiler is bonded to heat is listed under the heading, "Bonded Direct C. I. Radiation, Square Feet."


| Steam | | Specifications Applying to Both | | | | Water | |
|---------------------|---------------------------------------|---------------------------------|------------------------|-------------|-------------|---------------------|---------------------------------------|
| Steam Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. | Outlets Number and Size In. | Fire Box Length Inches | Chimney | | Water Boiler Number | Bonded Direct C. I. Radiation Sq. Ft. |
| | | | | Area Inches | Height Feet | | |
| 046-S | 2,000 | 2-5" | 35½ | 12 x 16 | 45 | 046-W | 3,300 |
| 047-S | 2,500 | 2-5" | 42½ | 12 x 16 | 45 | 047-W | 4,100 |
| 048-S | 3,000 | 2-5" | 49½ | 16 x 16 | 50 | 048-W | 4,900 |
| 049-S | 3,500 | 2-5" | 56½ | 16 x 20 | 55 | 049-W | 5,700 |
| 0410-S | 4,000 | 2-5" | 63½ | 16 x 20 | 55 | 0410-W | 6,500 |
| 0411-S | 4,500 | 2-5" | 70½ | 20 x 20 | 55 | 0411-W | 7,300 |
| 0412-S | 5,000 | 2-5" 1-4" | 77½ | 20 x 20 | 60 | 0412-W | 8,100 |
| 0413-S | 5,500 | 2-5" 1-4" | 84½ | 24 x 24 | 65 | 0413-W | 8,900 |
| 0414-S | 6,000 | 2-5" 1-4" | 91½ | 24 x 24 | 65 | 0414-W | 9,700 |
| 0415-S | 6,500 | 2-5" 1-4" | 98½ | 24 x 28 | 65 | 0415-W | 10,500 |
| 0416-S | 7,000 | 2-5" 2-4" | 105½ | 28 x 28 | 70 | 0416-W | 11,300 |
| 0417-S | 7,500 | 2-5" 2-4" | 112½ | 28 x 28 | 70 | 0417-W | 12,100 |
| 0418-S | 8,000 | 2-5" 2-4" | 119½ | 28 x 32 | 70 | 0418-W | 12,900 |

Dimensions

Fire Door 9½" x 14½"
Ashpit Door 9½" x 14½"

One 2" tapping on side of left end section for indirect water heater. Additional 1½" tappings are furnished on the front of intermediate sections on special order.

See pages 138 and 149 for additional dimensions and arrangement of sections.

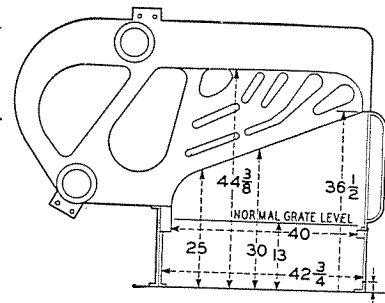

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL AERO RADIATION



NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL AERO RADIATION

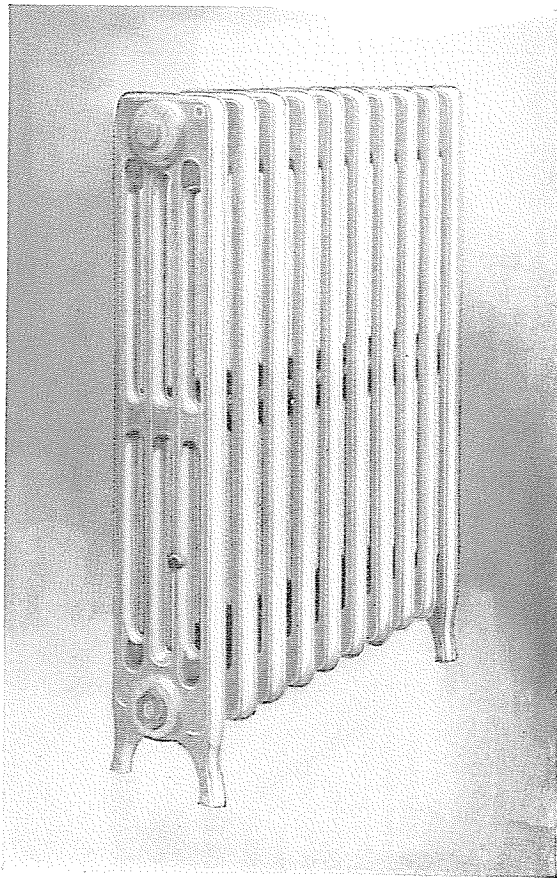

At once attractive and efficient, National Aero Radiation is noteworthy for the *fullness* of line that comes with a complete variety of shapes and sizes, as well as for the *broadness* of line that comes through a design which adapts itself to every conceivable application, giving constant evidence of its utility and effectiveness.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO RADIATION


Efficiency . . . Found in a Quest For Beauty

ODDLY enough, the design that gives National Radiation its outstanding attractiveness contributes most to its efficiency. The slender tubes and wide spacing gives the proper ratio of heating surface to air space, and increases the heat emission an amazing amount.

The radiators were designed not only to increase the output of warmth by convection, but also the radiant heat. Radiant heat rays, tests indicate, move at right angles to the face from which they emanate. By the combination of a concave surface, and proper spacing, these beams of heat have free exit in National Radiators.

National also used an octagonal, instead of the usual rounded barrel. For the same water or steam area, there is a greater radiating surface—which is, of course, the result to be desired. In the total surface of an entire radiator the increase in radiating area is considerable, and contributes to the high efficiency which is Aero's prime characteristic.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO RADIATION


Worth . . .

the effort, though
harder to make

THE smooth surface of National Radiator sections, with its freedom from pits, depressions, and flaws, is only one result of a care in manufacturing that extends to every operation, no matter how small.

Each batch of metal is tested with scrupulous care, and the exact proportions of chemicals needed to attain the desired strength and resilience are added. The Seacoal process used in casting assures a fine surface—an essential if the radiators are to be painted, as is the trend today.

Each individual radiator section is subjected to a hydrostatic test in excess of 90 pounds. The section is rigidly inspected while under pressure and only those that are absolutely water tight and up to the high National standard are approved. All four nipple ports are reamed



National Aero Malleable Push Nipple

out at one operation on a special machine, thus assuring perfect alignment. After the sections are assembled into radiators, each radiator is again put under pressure and again rigidly inspected.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO RADIATION

Push Nipples . . .

speedily assembled,
protection assured


THE malleable push nipple type of construction gives a permanently tight metal-to-metal joint, not dependent on gaskets to protect against leaks. It is significant that in boilers, where strains due to expansion and contraction are greatest, and where leaks must be guarded against at all cost, *push nipples are used exclusively* by leading boiler manufacturers. No stronger evidence of their value could be presented.

The malleable iron push nipples are not machined, but finished by a special process, which leaves intact a tough outer skin in which most of the strength resides. Originally, steel push nipples were used by the industry generally, but rapid corrosion made them short lived and impractical. Unable to successfully finish cast iron nipples to accurate limits, some manufacturers turned to screw nipples as the only alternative. National, realizing that cutting threads on a malleable nipple destroyed the effectiveness of the tough outer skin, patiently experimented and was one of the first companies to successfully utilize the malleable iron push nipple.

This type of connection is now generally recognized as the best because it forms a permanently tight iron-to-iron joint, not dependent upon gaskets to make it water-tight.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO THREE TUBE RADIATION

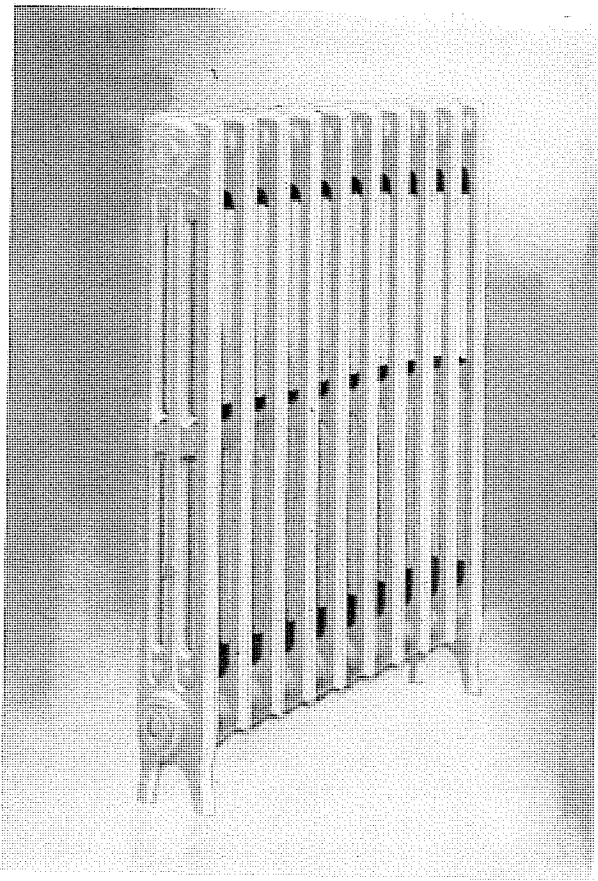

Graceful and pleasing, this slender model is particularly adapted to narrow corridors, and rooms where space is at a premium.

NATIONAL AERO THREE TUBE RADIATION

Three Tube Sizes and Ratings

| Number of Sections | *Length 2½ in. Per Sec. | Square Feet Per Section | | | | |
|--|-------------------------|-----------------------------------|----------------------------------|-----------------------------------|----------------------------------|-----------------------------------|
| | | 36-in. Height 3½ Sq. Ft. Per Sec. | 30-in. Height 3 Sq. Ft. Per Sec. | 26-in. Height 2½ Sq. Ft. Per Sec. | 23-in. Height 2 Sq. Ft. Per Sec. | 20-in. Height 1¾ Sq. Ft. Per Sec. |
| 2 | 5 | 7 | 6 | 4 2/3 | 4 | 3 1/2 |
| 3 | 7 1/2 | 10 1/2 | 9 | 7 | 6 | 5 1/4 |
| 4 | 10 | 14 | 12 | 9 1/3 | 8 | 7 |
| 5 | 12 1/2 | 17 1/2 | 15 | 11 2/3 | 10 | 8 3/4 |
| 6 | 15 | 21 | 18 | 14 | 12 | 10 1/2 |
| 7 | 17 1/2 | 24 1/2 | 21 | 16 1/3 | 14 | 12 1/4 |
| 8 | 20 | 28 | 24 | 18 2/3 | 16 | 14 |
| 9 | 22 1/2 | 31 1/2 | 27 | 21 | 18 | 15 3/4 |
| 10 | 25 | 35 | 30 | 23 1/3 | 20 | 17 1/2 |
| 11 | 27 1/2 | 38 1/2 | 33 | 25 2/3 | 22 | 19 1/4 |
| 12 | 30 | 42 | 36 | 28 | 24 | 21 |
| 13 | 32 1/2 | 45 1/2 | 39 | 30 1/3 | 26 | 22 3/4 |
| 14 | 35 | 49 | 42 | 32 2/3 | 28 | 24 1/2 |
| 15 | 37 1/2 | 52 1/2 | 45 | 35 | 30 | 26 1/4 |
| 16 | 40 | 56 | 48 | 37 1/3 | 32 | 28 |
| 17 | 42 1/2 | 59 1/2 | 51 | 39 2/3 | 34 | 29 1/4 |
| 18 | 45 | 63 | 54 | 42 | 36 | 31 1/2 |
| 19 | 47 1/2 | 66 1/2 | 57 | 44 1/3 | 38 | 33 1/4 |
| 20 | 50 | 70 | 60 | 46 2/3 | 40 | 35 |
| 21 | 52 1/2 | 73 1/2 | 63 | 49 | 42 | 36 3/4 |
| 22 | 55 | 77 | 66 | 51 1/3 | 44 | 38 1/2 |
| 23 | 57 1/2 | 80 1/2 | 69 | 53 2/3 | 46 | 40 1/4 |
| 24 | 60 | 84 | 72 | 56 | 48 | 42 |
| 25 | 62 1/2 | 87 1/2 | 75 | 58 1/3 | 50 | 43 3/4 |
| Distance from floor to center of top tapping. | | 33 13/16 | 27 25/32 | 23 13/16 | 20 33/64 | 17 27/32 |
| Distance from floor to center of bottom tapping. | | 4 1/2 | 4 1/2 | 4 1/2 | 4 1/2 | 4 1/2 |

Detailed measurements are given on page 190.

*Add 1/2-inch to length for each bushing.

Width of feet, 5 1/8 inches. Width of section, 5 1/8 inches.


Tapped 1 1/2 inches top and bottom both ends and bushed to sizes required.

National Aero Radiators are furnished legless or with legs 6 inches from floor to center of tapping boss when ordered.

To determine the overall height of 3-tube legless radiators, deduct 2 1/8 inches from the standard heights shown for this type. See pages 186, 190 for legless data.

Assembled with extra heavy malleable iron push nipples, top and bottom.

NATIONAL AERO FOUR TUBE RADIATION

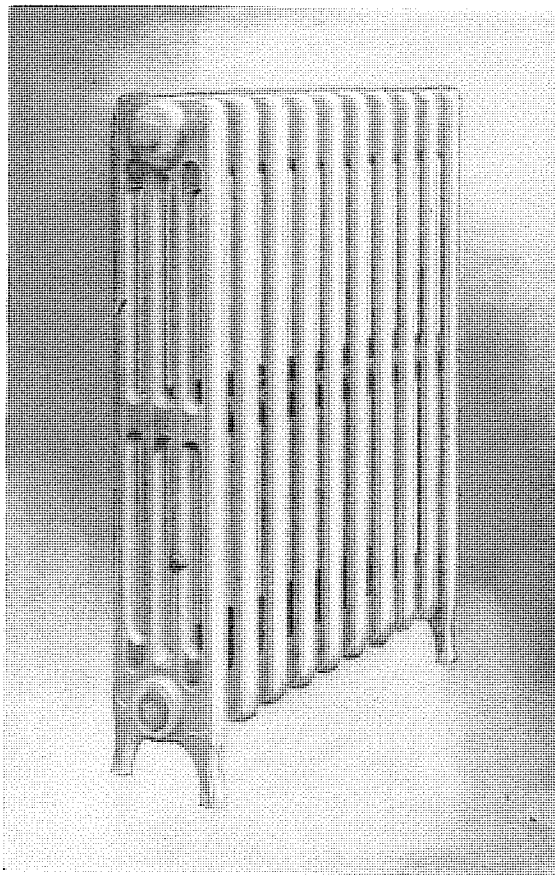

The slender tubes which contribute to the Aero Radiator's charm are responsible for its efficiency; they provide the scientifically correct ratio of air space to heating area

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO FOUR TUBE RADIATION

Four Tube Sizes and Ratings

| Number of Sections | *Length 2 1/2 in. Per Sec. | Square Feet Per Section | | | | |
|--|----------------------------------|---|---|---|---|---|
| | | 36-in. Height 4 1/4 Sq. Ft. Per Sec. | 30-in. Height 3 1/2 Sq. Ft. Per Sec. | 26-in. Height 2 3/4 Sq. Ft. Per Sec. | 23-in. Height 2 1/2 Sq. Ft. Per Section | 20-in. Height 2 1/4 Sq. Ft. Per Sec. |
| 2 | 5 | 8 1/4 | 7 | 5 1/2 | 5 | 4 1/2 |
| 3 | 7 1/2 | 12 3/4 | 10 1/2 | 8 1/4 | 7 1/2 | 6 3/4 |
| 4 | 10 | 17 | 14 | 11 | 10 | 9 |
| 5 | 12 1/2 | 21 1/4 | 17 1/2 | 13 3/4 | 12 1/2 | 11 1/4 |
| 6 | 15 | 25 1/4 | 21 | 16 1/2 | 15 | 13 1/4 |
| 7 | 17 1/2 | 29 3/4 | 24 1/2 | 19 1/4 | 17 1/2 | 15 3/4 |
| 8 | 20 | 34 | 28 | 22 | 20 | 18 |
| 9 | 22 1/2 | 38 1/4 | 31 1/2 | 24 1/4 | 22 1/2 | 20 1/4 |
| 10 | 25 | 42 1/2 | 35 | 27 1/2 | 25 | 22 1/2 |
| 11 | 27 1/2 | 46 3/4 | 38 1/2 | 30 1/4 | 27 1/2 | 24 3/4 |
| 12 | 30 | 51 | 42 | 33 | 30 | 27 |
| 13 | 32 1/2 | 55 1/4 | 45 1/2 | 35 3/4 | 32 1/2 | 29 1/4 |
| 14 | 35 | 59 1/4 | 49 | 38 1/2 | 35 | 31 1/2 |
| 15 | 37 1/2 | 63 3/4 | 52 1/2 | 41 1/4 | 37 1/2 | 33 3/4 |
| 16 | 40 | 68 | 56 | 44 | 40 | 36 |
| 17 | 42 1/2 | 72 1/4 | 59 1/2 | 46 3/4 | 42 1/2 | 38 1/4 |
| 18 | 45 | 76 1/4 | 63 | 49 1/2 | 45 | 40 1/2 |
| 19 | 47 1/2 | 80 3/4 | 66 1/2 | 52 1/4 | 47 1/2 | 42 3/4 |
| 20 | 50 | 85 | 70 | 55 | 50 | 45 |
| 21 | 52 1/2 | 89 1/4 | 73 1/2 | 57 3/4 | 52 1/2 | 47 1/4 |
| 22 | 55 | 93 1/4 | 77 | 60 1/2 | 55 | 49 1/2 |
| 23 | 57 1/2 | 97 3/4 | 80 1/2 | 63 1/4 | 57 1/2 | 51 3/4 |
| 24 | 60 | 102 | 84 | 66 | 60 | 54 |
| 25 | 62 1/2 | 106 1/4 | 87 1/2 | 68 3/4 | 62 1/2 | 56 1/4 |
| Distance from floor to center of top tapping. | | 33 13/16 | 27 27/32 | 23 13/16 | 20 5/16 | 17 27/32 |
| Distance from floor to center of bottom tapping. | | 4 1/2 | 4 1/2 | 4 1/2 | 4 1/2 | 4 1/2 |

Detailed measurements are given on page 190.

*Add 1/2-inch to length for each bushing.

Width of feet, 6 13/16 inches. Width of section, 6 13/16 inches.

Tapped 1 1/2 inches top and bottom both ends and bushed to sizes required.


National Aero Radiators are furnished legless or with legs 6 inches from floor to center of tapping boss when ordered.

To determine the overall height of 4-tube legless radiators deduct 2 1/4 inches from the standard heights shown for this type. See pages 186, 190 for legless data.

Assembled with extra heavy malleable iron push nipples, top and bottom.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO FIVE TUBE RADIATION

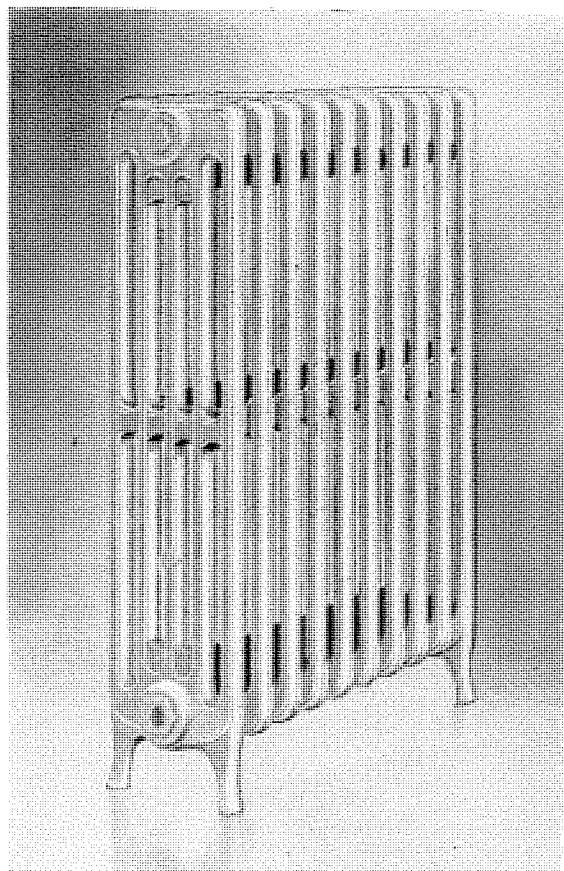

This model finds its field in all general applications: homes, schools and everywhere.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO FIVE TUBE RADIATION

Five Tube Sizes and Ratings

| Number of Sections | *Length 2½ in. Per Sec. | Square Feet Per Section | | | | |
|--|-------------------------|----------------------------------|-----------------------------------|-----------------------------------|----------------------------------|-----------------------------------|
| | | 36-in. Height 5 Sq. Ft. Per Sec. | 30-in. Height 4½ Sq. Ft. Per Sec. | 26-in. Height 3½ Sq. Ft. Per Sec. | 23-in. Height 3 Sq. Ft. Per Sec. | 20-in. Height 2½ Sq. Ft. Per Sec. |
| 2 | 5 | 10 | 8⅔' | 7 | 6 | 5½ |
| 3 | 7½ | 15 | 13 | 10½ | 9 | 8 |
| 4 | 10 | 20 | 17½ | 14 | 12 | 10⅔ |
| 5 | 12½ | 25 | 21⅔ | 17½ | 15 | 13½ |
| 6 | 15 | 30 | 26 | 21 | 18 | 16 |
| 7 | 17½ | 35 | 30½ | 24½ | 21 | 18⅔ |
| 8 | 20 | 40 | 34⅔ | 28 | 24 | 21⅔ |
| 9 | 22½ | 45 | 39 | 31½ | 27 | 24 |
| 10 | 25 | 50 | 43½ | 35 | 30 | 26⅔ |
| 11 | 27½ | 55 | 47⅔ | 38½ | 33 | 29½ |
| 12 | 30 | 60 | 52 | 42 | 36 | 32 |
| 13 | 32½ | 65 | 56½ | 45½ | 39 | 34⅔ |
| 14 | 35 | 70 | 60⅔ | 49 | 42 | 37⅔ |
| 15 | 37½ | 75 | 65 | 52½ | 45 | 40 |
| 16 | 40 | 80 | 69½ | 56 | 48 | 42⅔ |
| 17 | 42½ | 85 | 73⅔ | 59½ | 51 | 45⅔ |
| 18 | 45 | 90 | 78 | 63 | 54 | 48 |
| 19 | 47½ | 95 | 82½ | 66½ | 57 | 50⅔ |
| 20 | 50 | 100 | 86⅔ | 70 | 60 | 53⅔ |
| 21 | 52½ | 105 | 91 | 73½ | 63 | 56 |
| 22 | 55 | 110 | 95½ | 77 | 66 | 58⅔ |
| 23 | 57½ | 115 | 99⅔ | 80½ | 69 | 61⅔ |
| 24 | 60 | 120 | 104 | 84 | 72 | 64 |
| 25 | 62½ | 125 | 108½ | 87½ | 75 | 66⅔ |
| Distance from floor to center of top tapping. | | 33⅓⅙ | 27⅒⅙ | 23⅓⅙ | 20⅕⅙ | 17⅒⅙ |
| Distance from floor to center of bottom tapping. | | 4½ | 4½ | 4½ | 4½ | 4½ |

Detailed measurements are given on page 190.

*Add ½-inch to length for each bushing.

Width of feet, 8⅓⅙ inches. Width of sections, 8⅓⅙ inches.

Tapped 1½ inches top and bottom both ends and bushed to sizes required.


National Aero Radiators are furnished legless or with legs 6 inches from floor to center of tapping boss when ordered.

To determine the overall height of 5 tube legless radiators deduct 2½ inches from the standard heights shown for this type. See pages 186, 190 for legless data.

Assembled with extra heavy malleable iron push nipples, top and bottom.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO SIX TUBE RADIATION

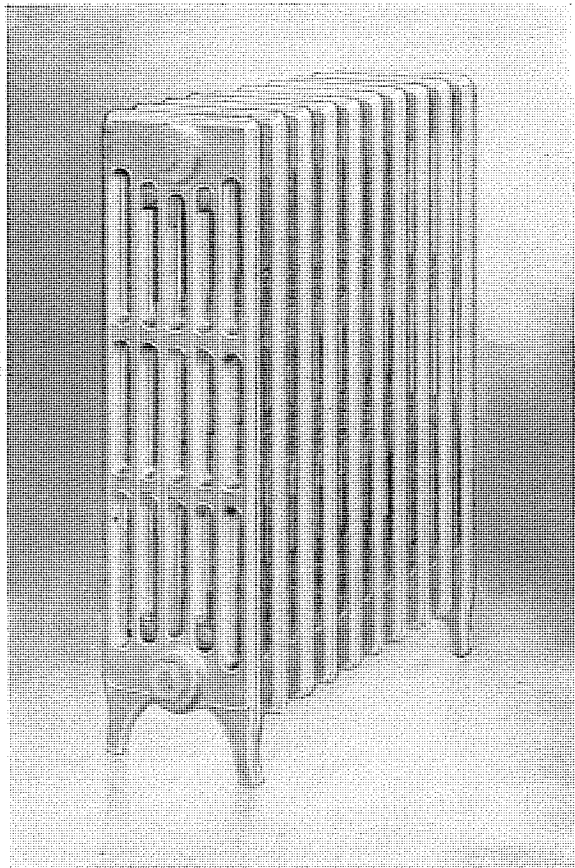

The six tube type provides an unusual amount of radiating surface, but being only nine inches wide takes up very little space

NATIONAL AERO SIX TUBE RADIATION

Six Tube Sizes and Ratings

| Number of Sections | *Length 2½-in. Per Sec. | Square Feet Per Section | | | | |
|--|-------------------------|----------------------------------|----------------------------------|----------------------------------|-----------------------------------|----------------------------------|
| | | 38-in. Height 6 Sq. Ft. Per Sec. | 32-in. Height 5 Sq. Ft. Per Sec. | 26-in. Height 4 Sq. Ft. Per Sec. | 23-in. Height 3½ Sq. Ft. Per Sec. | 20-in. Height 3 Sq. Ft. Per Sec. |
| 2 | 5 | 12 | 10 | 8 | 7 | 6 |
| 3 | 7½ | 18 | 15 | 12 | 10½ | 9 |
| 4 | 10 | 24 | 20 | 16 | 14 | 12 |
| 5 | 12½ | 30 | 25 | 20 | 17½ | 15 |
| 6 | 15 | 36 | 30 | 24 | 21 | 18 |
| 7 | 17½ | 42 | 35 | 28 | 24½ | 21 |
| 8 | 20 | 48 | 40 | 32 | 28 | 24 |
| 9 | 22½ | 54 | 45 | 36 | 31½ | 27 |
| 10 | 25 | 60 | 50 | 40 | 35 | 30 |
| 11 | 27½ | 66 | 55 | 44 | 38½ | 33 |
| 12 | 30 | 72 | 60 | 48 | 42 | 36 |
| 13 | 32½ | 78 | 65 | 52 | 45½ | 39 |
| 14 | 35 | 84 | 70 | 56 | 49 | 42 |
| 15 | 37½ | 90 | 75 | 60 | 52½ | 45 |
| 16 | 40 | 96 | 80 | 64 | 56 | 48 |
| 17 | 42½ | 102 | 85 | 68 | 59½ | 51 |
| 18 | 45 | 108 | 90 | 72 | 63 | 54 |
| 19 | 47½ | 114 | 95 | 76 | 66½ | 57 |
| 20 | 50 | 120 | 100 | 80 | 70 | 60 |
| 21 | 52½ | 126 | 105 | 84 | 73½ | 63 |
| 22 | 55 | 132 | 110 | 88 | 77 | 66 |
| 23 | 57½ | 138 | 115 | 92 | 80½ | 69 |
| 24 | 60 | 144 | 120 | 96 | 84 | 72 |
| 25 | 62½ | 150 | 125 | 100 | 87½ | 75 |
| Distance from floor to center of top tapping. | | 35⅞ | 29⅞ | 23⅞ | 20⅞ | 17⅞ |
| Distance from floor to center of bottom tapping. | | 4½ | 4½ | 4½ | 4½ | 4½ |

Detailed measurements are given on page 190.

*Add ½ inch to length for each bushing.

Width of feet, 9 inches. Width of section, 9 inches.


Tapped 1½ inches top and bottom both ends and bushed to size required.

National Aero Radiators are furnished legless or with legs 6 inches from floor to center of tapping boss when ordered.

To determine the overall height of 6-tube legless radiators deduct 2½ inches from the standard heights shown for this type. See pages 186, 190 for legless data.

Assembled with extra heavy malleable iron push nipples.

NATIONAL AERO SEVEN TUBE RADIATION

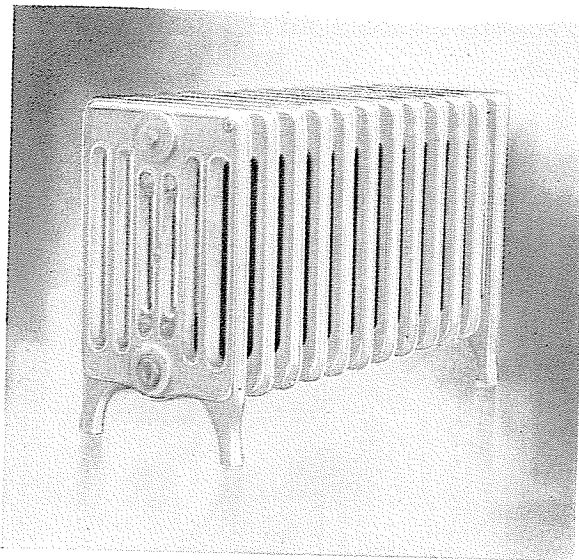

A unit with tremendous warming capacity. The low heights fit nicely under windows, applying the heat where needed. The 36, 30 and 26 inch heights are used where space limitations will not permit a long radiator.

National Aero Radiator Pedestals

Where additional clearance beneath any Aero Radiator is desired cast iron Aero Radiator Pedestals should be used. Heights available are $\frac{1}{2}$ " , 1" , $1\frac{1}{2}$ " , 2" , $2\frac{1}{2}$ " , 3" , and 4" .



NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO SEVEN TUBE RADIATION

Seven Tube Sizes and Ratings

| Number of Sections | *Length 2½-in. Per Sec. | Square Feet Per Section | | | | | |
|--|-------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|-----------------------------------|------------------------------------|
| | | 36-in. Height 6¾ Sq. Ft. Per Sec. | 30-in. Height 5½ Sq. Ft. Per Sec. | 26-in. Height 4¾ Sq. Ft. Per Sec. | 20-in. Height 3¾ Sq. Ft. Per Sec. | 16½-in. Height 3 Sq. Ft. Per Sec. | 13½-in. Height 2½ Sq. Ft. Per Sec. |
| 2 | 5 | 13½ | 11 | 9½ | 7½ | 6 | 5 |
| 3 | 7½ | 20¼ | 16½ | 14¼ | 11 | 9 | 7½ |
| 4 | 10 | 27 | 22 | 19 | 14¾ | 12 | 10 |
| 5 | 12½ | 33¾ | 27½ | 23¾ | 18½ | 15 | 12½ |
| 6 | 15 | 40½ | 33 | 28½ | 22 | 18 | 15 |
| 7 | 17½ | 47¼ | 38½ | 33¼ | 25¾ | 21 | 17½ |
| 8 | 20 | 54 | 44 | 38 | 29½ | 24 | 20 |
| 9 | 22½ | 60¾ | 49½ | 42¾ | 33 | 27 | 22½ |
| 10 | 25 | 67½ | 55 | 47½ | 36¾ | 30 | 25 |
| 11 | 27½ | 74¼ | 60½ | 52¼ | 40½ | 33 | 27½ |
| 12 | 30 | 81 | 66 | 57 | 44 | 36 | 30 |
| 13 | 32½ | 87¾ | 71½ | 61¾ | 47¾ | 39 | 32½ |
| 14 | 35 | 94½ | 77 | 66½ | 51½ | 42 | 35 |
| 15 | 37½ | 101¼ | 82½ | 71¼ | 55 | 45 | 37½ |
| 16 | 40 | 108 | 88 | 76 | 58¾ | 48 | 40 |
| 17 | 42½ | 114¾ | 93½ | 80¾ | 62¾ | 51 | 42½ |
| 18 | 45 | 121½ | 99 | 85½ | 66 | 54 | 45 |
| 19 | 47½ | 128¼ | 104½ | 90¼ | 69¾ | 57 | 47½ |
| 20 | 50 | 135 | 110 | 95 | 73½ | 60 | 50 |
| 21 | 52½ | 141¾ | 115½ | 99¾ | 77 | 63 | 52½ |
| 22 | 55 | 148½ | 121 | 104½ | 80¾ | 66 | 55 |
| 23 | 57½ | 155¼ | 126½ | 109¼ | 84½ | 69 | 57½ |
| 24 | 60 | 162 | 132 | 114 | 88 | 72 | 60 |
| 25 | 62½ | 168¾ | 137½ | 118¾ | 91¾ | 75 | 62½ |
| Distance from floor to center of top tapping. | | 33½ | 27½ | 23½ | 17½ | 14½ | 11½ |
| Distance from floor to center of bottom tapping. | | 4½ | 4½ | 4½ | 4½ | 3 | 3 |

Detailed measurements are given on page 190.

*Add ½-inch to length for each bushing.

Width of feet, 12 inches. Width of section, 12 inches.

Tapped 1½ inches top and bottom both ends and bushed to sizes required.


Can be finished legless or with 6 inch high legs on all six heights also 4½ inch high legs on 16½ inch and 13½ inch heights.

To determine the overall height of the 7-tube legless radiators deduct 2½ inches from the standard height except on the 13½ inch and 16½ inch heights in which case ¾ of an inch should be deducted. See page 186, 190 for legless data.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO LEGLESS TYPE RADIATION

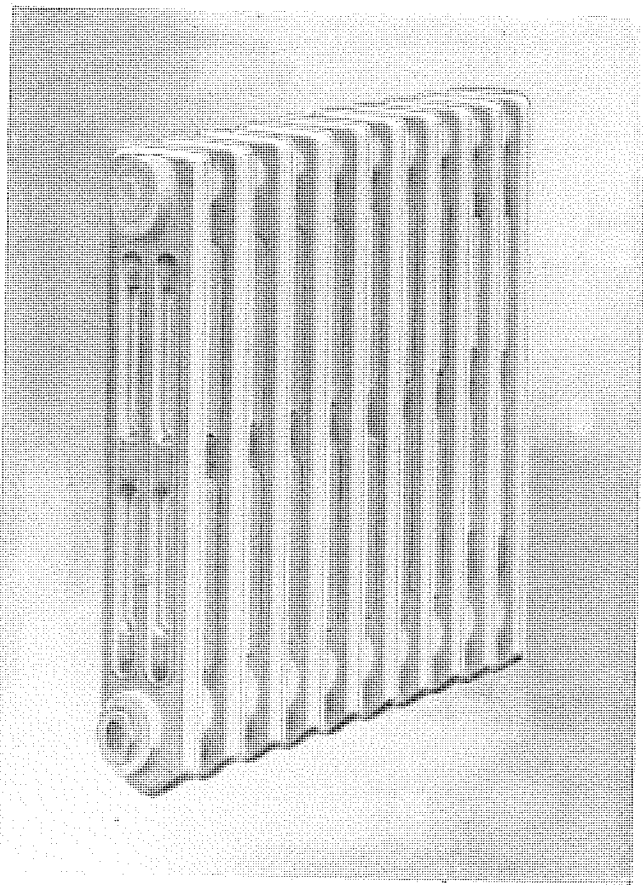


Aero Legless Radiators are made up in three, four, five, six and seven-tube models. See pages 177 to 185 for sizes and ratings; 190 for overall heights. They are hung on the wall, out of the way. There are no legs to interfere with cleaning. Their usefulness is apparent in hospitals, bathrooms, kitchens and fully carpeted rooms.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL PANEL RADIATION

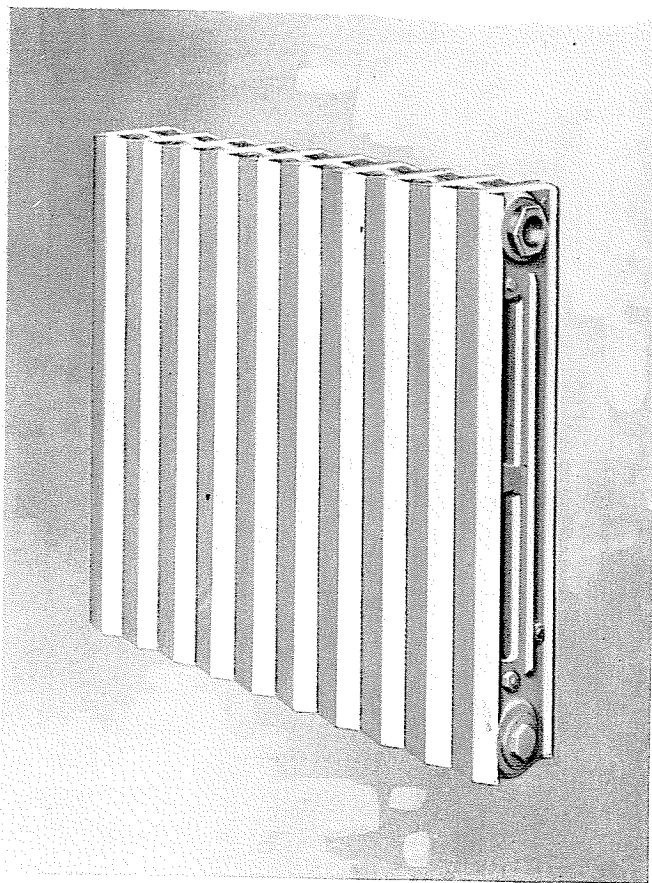

The unobtrusive beauty of National Panel Radiation makes it a decorative unit that actually enhances the appearance of the room. See pages 210 to 221 for data and dimensions.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

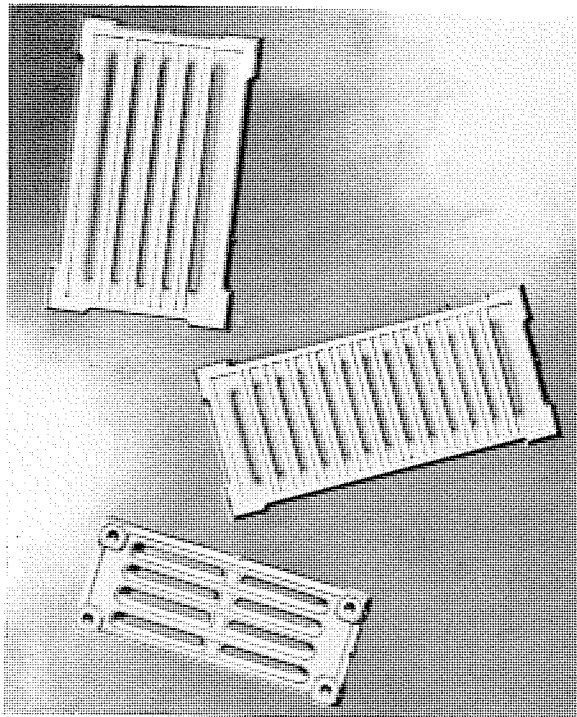

Aero Wall Radiation is extensively used in factories, storehouses, garages, bathrooms, halls, schools and similar applications, because of its ability to provide maximum heat in a restricted space. The Aero Bathroom Radiator (lower illustration) was especially designed for use in apartment and hotel bath rooms.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

Maximum . . .

warmth—with
minimum space

NATIONAL Aero Wall Radiators are made up in sections and in a variety of sizes. This permits of assemblage into numerous grouping arrangements to fit into spaces of practically any size or shape—under windows, or between them—on walls or ceilings.

To secure maximum heating efficiency, Aero Wall Radiation should always be assembled with bars vertical. It is made in two types to facilitate this in various assemblages. The 7A and 9A types have bars running the short way of the section and the 7B and 9B types have bars running the long way of the section.

Complete dimensions and assemblies are shown on pages 192 to 199 inclusive.

Aero Bathroom Radiator

These radiators are furnished in single sections, rated at $3\frac{1}{2}$ square feet per section. They are tapped $\frac{1}{2}$ inch top and bottom both ends.


Dimensions: Length $20\frac{7}{16}$ inches, Height $8\frac{13}{32}$ inches, Thickness $1\frac{13}{16}$ inches. Center to center of tappings $6\frac{13}{32}$ inches.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

AERO TUBE-TYPE RADIATION

Dimensions

See table on opposite page for measurements.

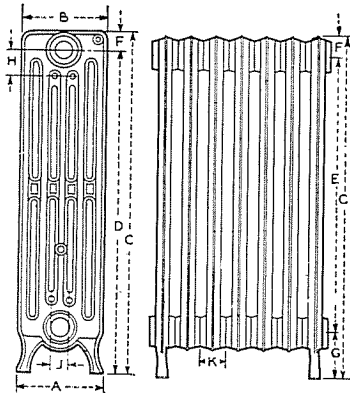

- A. Width of feet.
- B. Width of section.
- C. Total height.
- D. Distance from floor to center of top tapping.
- E. Distance from center of top tapping to center of bottom tapping.
- F. Distance from top of radiator to center of top tapping.

- G. Distance from floor to center of bottom tapping.
- H. Distance from center of top tapping to center of rod holes.
- J. Center to center distance between rod holes.
- K. Center to center distance between sections, 2 1/4 inches.

Can be furnished with high legs, making distance from floor to center of bottom tapping 6 inches in all heights including 16 1/2" and 13 1/2" 7 Tube. 16 1/2" and 13 1/2" 7 Tube heights can also be furnished with high legs making distance from floor to center of bottom tapping 4 1/2".

Aero Legless Radiation

Overall Height 3, 4, 5 and 7 Tubes

Standard Height— 36" - 30" - 26" - 23" - 20" - 16 1/2" - 13 1/2"
 Legless Height— 33 3/8" - 27 7/8" - 23 3/8" - 20 1/8" - 17 1/8" - 15 3/4" - 12 3/4"

6 Tube

Standard Height— 38" - 32" - 26" - 23" - 20"
 Legless Height— 35 1/2" - 29 1/2" - 23 1/2" - 20 1/2" - 17 1/2"

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

AERO TUBE-TYPE RADIATION




Dimensions

| AERO | Height | A | B | C | D | E | F | H | J |
|--------|--------|---------|---------|---------|---------|---------|--------|--------|--------|
| 3 Tube | 20" | 5 3/8" | 5 3/8" | 19 5/8" | 17 7/8" | 13 1/2" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 23" | 5 3/8" | 5 3/8" | 22 3/4" | 20 1/8" | 16 5/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 26" | 5 3/8" | 5 3/8" | 25 1/4" | 23 5/8" | 19 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 30" | 5 3/8" | 5 3/8" | 29 5/8" | 27 7/8" | 23 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| 4 Tube | 36" | 5 1/2" | 5 1/2" | 35 3/8" | 33 3/8" | 29 9/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 20" | 6 5/16" | 6 5/16" | 19 5/8" | 17 7/8" | 13 1/2" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 23" | 6 5/16" | 6 5/16" | 22 3/4" | 20 1/8" | 16 5/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 26" | 6 5/16" | 6 5/16" | 25 1/4" | 23 5/8" | 19 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| 5 Tube | 30" | 8 1/8" | 8 1/8" | 29 5/8" | 27 7/8" | 23 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 20" | 8 1/8" | 8 1/8" | 19 5/8" | 17 7/8" | 13 1/2" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 23" | 8 1/8" | 8 1/8" | 22 3/4" | 20 1/8" | 16 5/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 26" | 8 1/8" | 8 1/8" | 25 1/4" | 23 5/8" | 19 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| 6 Tube | 38" | 9" | 9" | 31 5/8" | 33 5/8" | 29 9/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 20" | 9" | 9" | 19 7/8" | 17 7/8" | 13 1/2" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 23" | 9" | 9" | 22 3/4" | 20 1/8" | 16 5/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 26" | 9" | 9" | 25 1/4" | 23 5/8" | 19 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |
| 7 Tube | 36" | 12" | 12" | 35 3/8" | 33 3/8" | 29 9/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 20" | 12" | 12" | 19 5/8" | 17 7/8" | 13 1/2" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 23" | 12" | 12" | 22 3/4" | 20 1/8" | 16 5/8" | 1 1/2" | 2 1/2" | 1 1/2" |
| | 26" | 12" | 12" | 25 1/4" | 23 5/8" | 19 1/4" | 1 1/2" | 2 1/2" | 1 1/2" |

Dimensions are in Inches. See Outline Drawing on Opposite Page

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

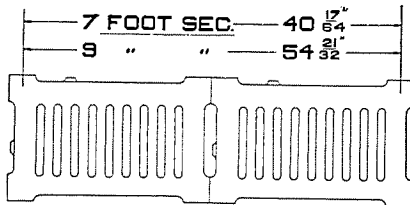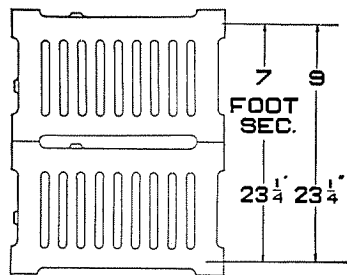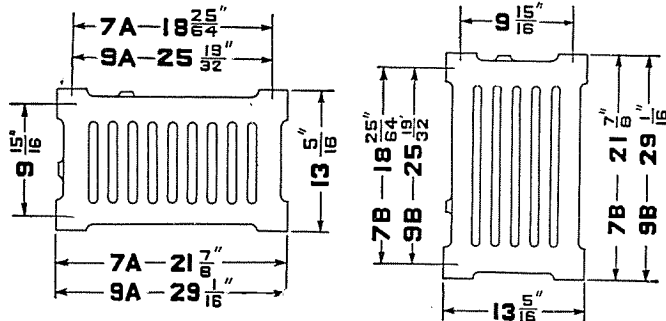

Dimensions

Regular tappings are indicated by letters A, B, C, D, E, F, G and H. Special tappings which can be furnished at extra charge are indicated by numbers 10, 20, 30, 40, 50, 60, 70 and 80. Tappings are 1 1/2", supply and return, and bushed as desired.

Add 1 1/8" to length measurement for each hexagon nipple used in assembling. The sections are connected with right and left internal threaded nipples, provided with two heavy inside lugs.

All orders should refer to figure number showing assembly or be accompanied by sketch.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

Table Showing Length of Space Occupied- And Heating Surface

For Various Sizes and Assemblages of Aero Wall Radiators.

| No. of Sections | Length of Space Occupied | | | | | | Heating Surface, Square Feet | |
|-----------------|--------------------------|--------|----------|---------|----------------|----------|------------------------------|--------|
| | Type 7-A | | Type 9-A | | Types 7-B, 9-B | | Type 7 | Type 9 |
| | Ft. | In. | Ft. | In. | Ft. | In. | | |
| 1 | 1 | 9 7/8 | 2 | 5 1/16 | 1 | 1 5/16 | 7 | 9 |
| 2 | 3 | 7 3/4 | 4 | 10 1/8 | 2 | 2 5/8 | 14 | 18 |
| 3 | 5 | 5 5/8 | 7 | 3 3/16 | 3 | 3 15/16 | 21 | 27 |
| 4 | 7 | 3 1/2 | 9 | 8 1/4 | 4 | 5 1/4 | 28 | 36 |
| 5 | 9 | 1 3/8 | 12 | 1 5/16 | 5 | 6 9/16 | 35 | 45 |
| 6 | 10 | 11 1/4 | 14 | 6 3/8 | 6 | 7 7/8 | 42 | 54 |
| 7 | 12 | 9 1/8 | 16 | 11 7/16 | 7 | 9 3/16 | 49 | 63 |
| 8 | 14 | 7 | 19 | 4 1/2 | 8 | 10 1/2 | 56 | 72 |
| 9 | 16 | 4 7/8 | 21 | 9 9/16 | 9 | 11 13/16 | 63 | 81 |
| 10 | 18 | 2 3/4 | 24 | 2 5/8 | 11 | 1 1/8 | 70 | 90 |
| 11 | 20 | 0 5/8 | 26 | 7 11/16 | 12 | 2 7/16 | 77 | 99 |
| 12 | 21 | 10 1/2 | 29 | 0 3/4 | 13 | 3 3/4 | 84 | 108 |
| 13 | 23 | 8 3/8 | 31 | 5 13/16 | 14 | 5 1/16 | 91 | 117 |
| 14 | 25 | 6 1/4 | 33 | 10 7/8 | 15 | 6 3/8 | 98 | 126 |
| 15 | 27 | 4 1/8 | 36 | 3 15/16 | 16 | 7 11/16 | 105 | 135 |
| 16 | 29 | 2 | 38 | 9 | 17 | 9 | 112 | 144 |
| 17 | 30 | 11 7/8 | 41 | 2 1/16 | 18 | 10 5/16 | 119 | 153 |
| 18 | 32 | 9 3/4 | 43 | 7 1/8 | 19 | 11 5/8 | 126 | 162 |
| 19 | 34 | 7 5/8 | 46 | 0 2/16 | 21 | 0 15/16 | 133 | 171 |
| 20 | 36 | 5 1/2 | 48 | 5 1/4 | 22 | 2 1/4 | 140 | 180 |
| 21 | 38 | 3 3/8 | 50 | 10 5/16 | 23 | 3 9/16 | 147 | 189 |
| 22 | 40 | 1 1/4 | 53 | 3 3/8 | 24 | 4 7/8 | 154 | 198 |
| 23 | 41 | 11 1/8 | 55 | 8 7/16 | 25 | 6 3/16 | 161 | 207 |
| 24 | 43 | 9 | 58 | 1 1/2 | 26 | 7 1/2 | 168 | 216 |
| 25 | 45 | 6 7/8 | 60 | 6 9/16 | 27 | 8 13/16 | 175 | 225 |
| 26 | 47 | 4 3/4 | 62 | 11 5/8 | 28 | 10 1/8 | 182 | 234 |

To these lengths add 1/8 inch for each end bushed and 1 1/8 inches for each Hexagon Nipple used in assembling.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO WALL RADIATION

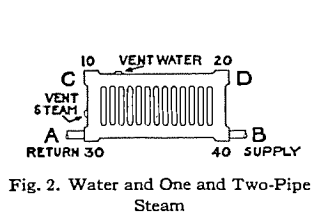


Fig. 2. Water and One and Two-Pipe Steam




Fig. 1. Water and One and Two-Pipe Steam

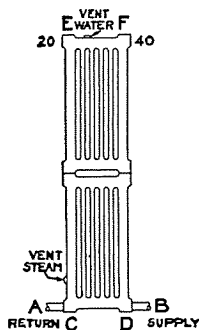


Fig. 7. Two Sections in Two Tiers — Water and One and Two-Pipe Steam

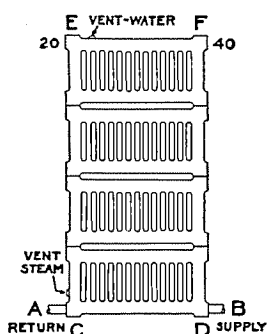


Fig. 9. Four Sections in Four Tiers — Water and One and Two-Pipe Steam

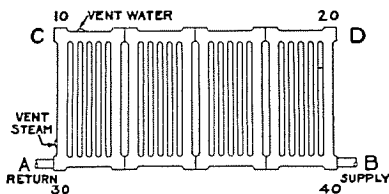


Fig. 13. Water and One and Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.



NATIONAL AERO WALL RADIATION

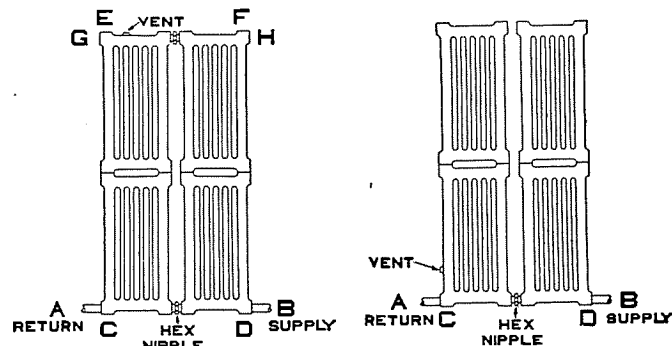


Fig. 5. Four Sections in Two Tiers — Water

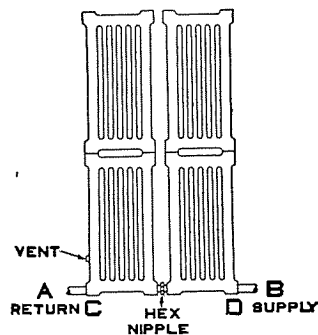


Fig. 6. Four Sections in Two Tiers — One and Two-Pipe Steam

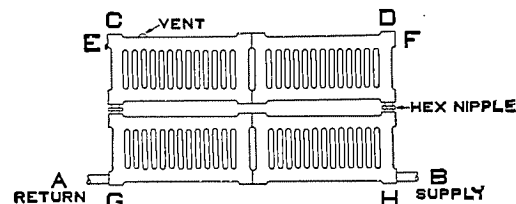


Fig. 9 1/2. Four Sections in Two Tiers — Water

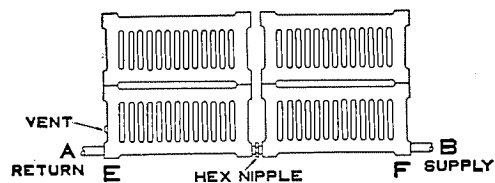


Fig. 10. Four Sections in Two Tiers — One and Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.

NATIONAL AERO WALL RADIATION

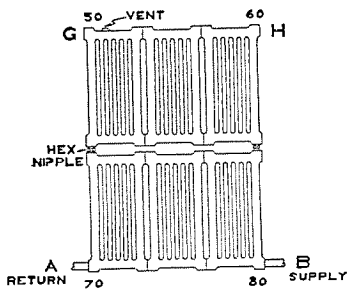


Fig. 8. Six Sections in Two Tiers—Water

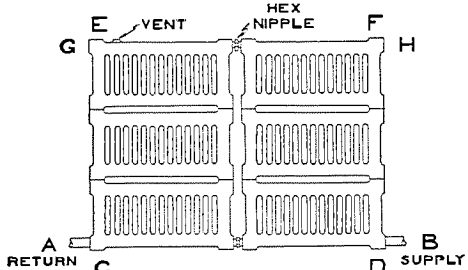


Fig. 11. Six Sections in Three Tiers—Water

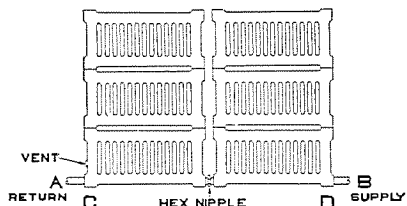


Fig. 12. Six Sections in Three Tiers—One and Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

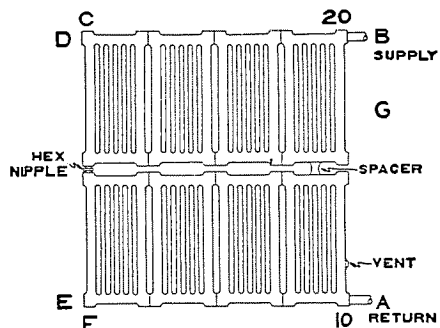


Fig. 20. Eight Sections in Two Tiers—Two-Pipe Steam Using Spacing Saddle

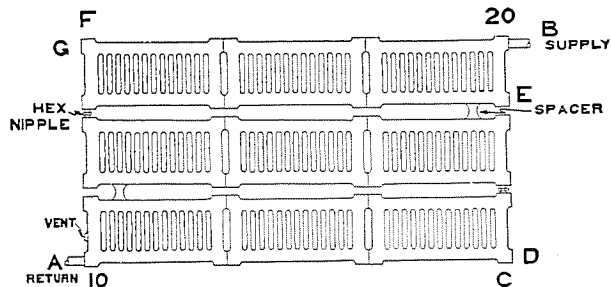


Fig. 18. Nine Sections in Three Tiers—Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO WALL RADIATION




Fig. 14. Water and One and Two-Pipe Steam.

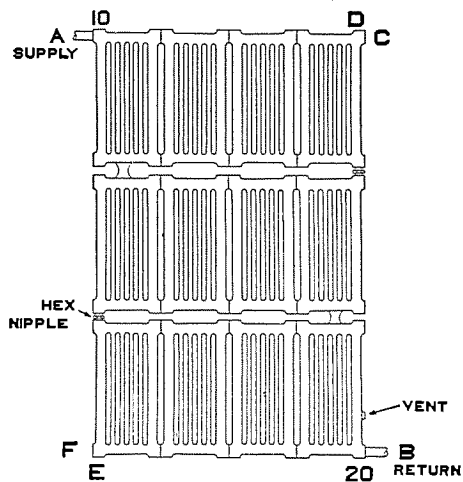


Fig. 19. Twelve Sections in Three Tiers—Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.



NATIONAL AERO WALL RADIATION

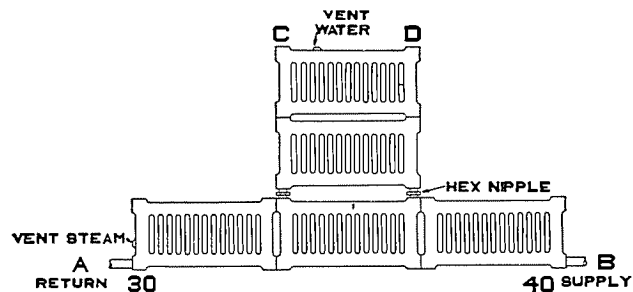


Fig. 15. Three and Two Sections with Three Tiers in Center—Water and One and Two-Pipe Steam

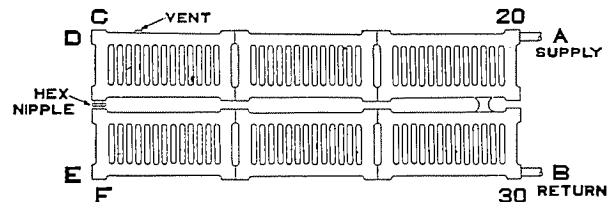


Fig. 16. Six Sections in Two Tiers—Water

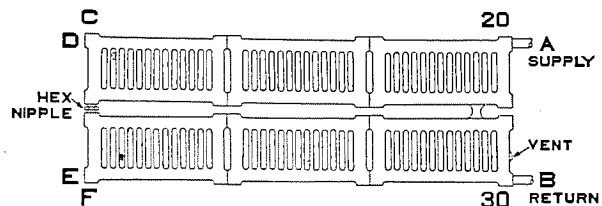


Fig. 17. Six Sections in Two Tiers—Two-Pipe Steam

All orders should refer to figure number showing assembly or be accompanied by sketch.

NATIONAL LEGLESS RADIATOR HANGERS

National Adjustable Radiator Hangers


With the increasing popularity of the Legless type Radiator, has come a need for an easily installed effective support. This need has been filled by National Type MT and Type N Adjustable Radiator Hangers. (Type MT illustrated on next page and Type N is illustrated below).

Type N Hangers


Easily installed, effective supports, which eliminate the need for precise measurements in installing hangers, and permit shifting the radiator's position. The Type N has a steel back with cast fittings. It is made in two sizes—the NH for high radiators and the NL for low radiators.

Measurements

| Radiator Height | B | C | D |
|-----------------|-------------------|----|-------------------|
| 38" | 2 $\frac{3}{4}$ " | 7" | 9 $\frac{1}{2}$ " |
| 36" | 2 $\frac{3}{4}$ " | 7" | 9 $\frac{1}{2}$ " |
| 32" | 2 $\frac{3}{4}$ " | 7" | 9 $\frac{1}{2}$ " |
| 30" | 2 $\frac{3}{4}$ " | 7" | 9 $\frac{1}{2}$ " |
| 26" | 3 $\frac{3}{4}$ " | | 8 $\frac{1}{2}$ " |
| 23" | 3 $\frac{3}{4}$ " | | 8 $\frac{1}{2}$ " |
| 20" | 3 $\frac{3}{4}$ " | | 8 $\frac{1}{2}$ " |



Type NH




Type NL

Fastened with $\frac{3}{8}$ inch lag screws or bolts (not furnished with hangers).

When ordering hangers specify type desired, also the height of the radiator and number of tubes.



Type NH
For 38", 36", 32"
and 30" High
Radiators




Type NL
For 26", 23"
and 20" High
Radiator

NATIONAL LEGLESS RADIATOR HANGERS

Type MT Adjustable Hanger


These hangers are fastened to the wall by means of anchor bolts furnished with the hangers. Type MT hangers are adjustable 2 $\frac{1}{2}$ in. horizontally and 4 $\frac{1}{2}$ inches vertically.

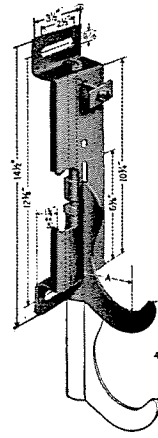

"A" Measurements Type MT

| | |
|--------|----------------------|
| 3 tube | 21 $\frac{7}{32}$ " |
| 4 tube | 31 $\frac{13}{32}$ " |
| 5 tube | 4 5 $\frac{5}{32}$ " |
| 6 tube | 4 1 $\frac{1}{2}$ " |
| 7 tube | 6" |

Type X Concealed Hangers

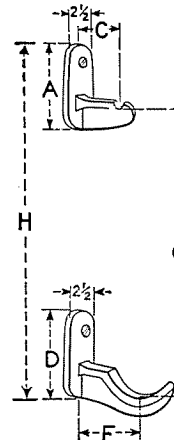


| No. Tubes | Top—Inches | | Dimensions—"G"—Inches | | | | | | | |
|-----------|-----------------|--------------------|-----------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--|
| | A | C | 38 | 36 | 32 | 30 | 26 | 23 | 20 | |
| 3 | 4 $\frac{3}{8}$ | 2 5 $\frac{5}{8}$ | 28 $\frac{1}{16}$ | 22 1 $\frac{1}{8}$ | 18 1 $\frac{1}{8}$ | 15 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | |
| 4 | 4 $\frac{3}{8}$ | 2 5 $\frac{5}{8}$ | 28 $\frac{1}{16}$ | 22 $\frac{1}{16}$ | 18 $\frac{11}{16}$ | 15 $\frac{11}{16}$ | 12 $\frac{11}{16}$ | 12 $\frac{11}{16}$ | 12 $\frac{11}{16}$ | |
| 5 | 6 | 4 5 $\frac{5}{8}$ | 28 $\frac{1}{8}$ | 22 1 $\frac{1}{8}$ | 18 1 $\frac{1}{8}$ | 15 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | 12 1 $\frac{1}{8}$ | |
| 6 | 6 | 6 1 $\frac{1}{2}$ | 29 $\frac{15}{16}$ | 23 $\frac{15}{16}$ | 17 $\frac{15}{16}$ | 14 $\frac{15}{16}$ | 11 $\frac{15}{16}$ | 11 $\frac{15}{16}$ | 12 1 $\frac{1}{8}$ | |
| 7 | 6 | 6 3 $\frac{1}{16}$ | 28 $\frac{1}{2}$ | 22 1 $\frac{1}{2}$ | 18 1 $\frac{1}{2}$ | 15 1 $\frac{1}{2}$ | 12 1 $\frac{1}{2}$ | 12 1 $\frac{1}{2}$ | 12 1 $\frac{1}{2}$ | |

| No. Tubes | Bottom—Inches | | Dimensions—"H"—Inches | | | | | | | |
|-----------|-----------------|-------------------|-----------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|--|
| | D | F | 38 | 36 | 32 | 30 | 26 | 23 | 20 | |
| 3 | 4 $\frac{3}{8}$ | 3 1 $\frac{1}{2}$ | 32 | 26 | 22 | 19 | 16 | 16 | 16 | |
| 4 | 6 | 4 $\frac{15}{16}$ | 32 $\frac{3}{4}$ | 26 3 $\frac{3}{4}$ | 22 3 $\frac{3}{4}$ | 19 3 $\frac{3}{4}$ | 16 3 $\frac{3}{4}$ | 16 3 $\frac{3}{4}$ | 16 3 $\frac{3}{4}$ | |
| 5 | 6 | 5 1 $\frac{1}{2}$ | 33 $\frac{1}{4}$ | 27 1 $\frac{1}{4}$ | 23 1 $\frac{1}{4}$ | 20 1 $\frac{1}{4}$ | 17 1 $\frac{1}{4}$ | 17 1 $\frac{1}{4}$ | 17 1 $\frac{1}{4}$ | |
| 6 | 6 $\frac{1}{4}$ | 6 1 $\frac{1}{2}$ | 35 7 $\frac{1}{16}$ | 29 7 $\frac{1}{16}$ | 23 7 $\frac{1}{16}$ | 20 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | |
| 7 | 6 $\frac{3}{4}$ | 7 | 33 $\frac{1}{16}$ | 27 7 $\frac{1}{16}$ | 23 7 $\frac{1}{16}$ | 20 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | 17 7 $\frac{1}{16}$ | |

NATIONAL WALL RADIATOR HANGERS

Adjustable Wall Hangers

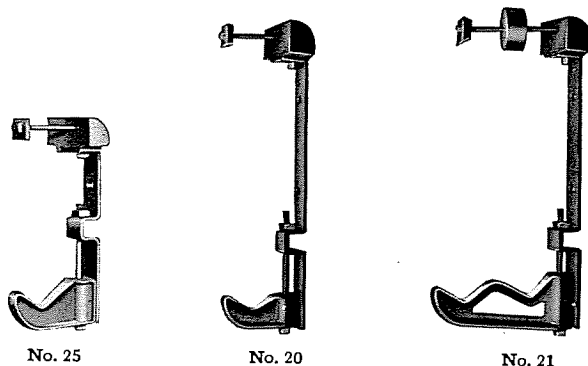

No. 20—21—25—Combination Top and Bottom Brackets (Adjustable)—Steel and Iron—Require $\frac{3}{8}$ Inch Lag Screws (not furnished with hanger.)

Number of Adjustable Hangers Required


| | | | |
|----------------------------|---|---------|--|
| No. 20 Single | | | |
| 5 to 12 Sections inclusive | 2 | Hangers | |
| 13 to 18 " " | 3 | " " | |
| 19 to 25 " " | 4 | " " | |
| 26 and 30 " " | 5 | " " | |

| | | | |
|---------------------------|---|---------|--|
| No. 21 Double | | | |
| 5 to 8 Sections inclusive | 2 | Hangers | |
| 9 to 14 " " | 4 | " " | |
| 15 to 24 " " | 6 | " " | |
| 25 to 32 " " | 8 | " " | |

NATIONAL WALL RADIATOR HANGERS

Adjustable Hangers—Type MW.


Type MW hangers are fastened to the wall by means of anchor bolts furnished with the hangers. Type MW hangers are adjustable $2\frac{1}{2}$ inches horizontally and $4\frac{1}{2}$ inches vertically. The "A" measurement is $1\frac{1}{2}$ inches.

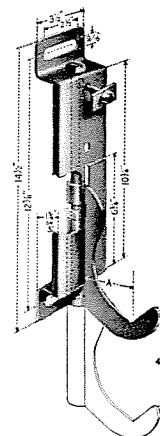

MW Hanger

Concealed Hangers

Hanger A is screwed to wall, baseboard or wainscoting, and supports all sizes of wall radiators. Hangers B and BB are screwed to wall, baseboard or wainscoting and intended to be used as a guide or to hold in position radiator supported by bracket A or C. The BB bracket is slotted for four and the B bracket for two wood screws, not supplied with hangers. With each BB bracket one one-quarter inch stove bolt and button is furnished.

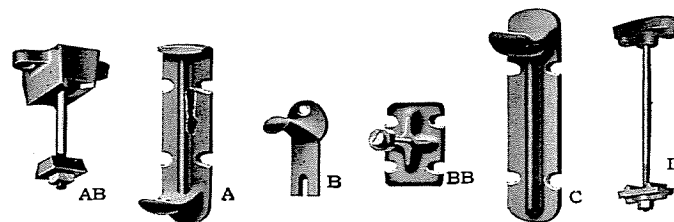


Hanger D—Steel and Iron, is screwed to the ceiling with No. 14 screws (not furnished with hanger.)

Hanger AB is screwed to the wall, baseboard or wainscoting and supports the Aero Bathroom Radiator.



AERO INDIRECT RADIATION

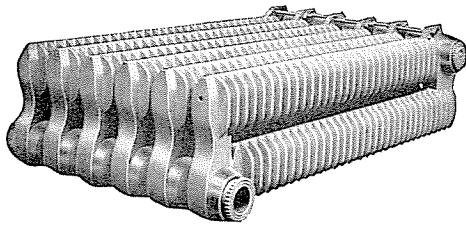

Aero Prime Indirect Radiation

PRIME Indirect Radiators are designed for the use of either steam or water. Each section has a radiation capacity of 15 square feet. Sections are assembled at factory and shipped complete unless ordered "knocked down." An additional charge is made for assembling Prime Indirect Radiation, as shown in Trade Price Sheet.


Dimensions of Sections

| | |
|----------------|------------|
| Length..... | 36½ inches |
| Height..... | 10 inches |
| Thickness..... | 4 inches |

Sections are connected with No. 3 extra heavy malleable iron slip nipples. End sections are regularly tapped 2 inches and bushed to required size.



AERO INDIRECT RADIATION

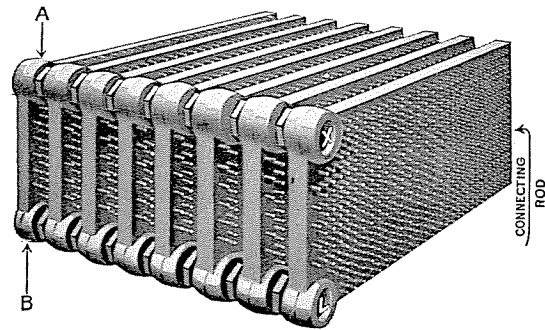

Stack of Eight Sections showing special connecting rod

Aero Pin Indirect Radiation

THESE radiators are made in 15- and 20-foot sections in water pattern only; tapped for steam when so ordered.

End sections are regularly tapped 2 inches at "X" and "L" (see illustration); right hand thread at the supply end and left hand at the return end. The air valve tapping is ⅜ inch.

Special 1¼ inch tapings can be furnished at A and B (see illustration) when so ordered. An extra charge will be made for these special tapings, as shown in the Trade Price Sheet.

AERO INDIRECT RADIATION

Pin Indirect Radiation (continued)

Connections between sections are made by means of extra heavy 2-inch right and left hand threaded nipples having hexagon nut at center. Sections are stayed by means of a draw rod running through cored openings at opposite end from nipple connection, as illustrated.

| Dimensions | 15-Foot Section | 20-Foot Section |
|---|-----------------|-----------------|
| Length of Section..... | 35½" | 35½" |
| Height of Section..... | 10¼" | 14" |
| Height of Section at Connecting Point.. | 11½" | 15½" |
| Width each Section Occupies in Stack... | 4" | 4" |
| Distance between Tappings X and L.... | 8" | 11½" |

When ordering Pin Indirect Radiators specify number of inside sections desired, number of supply and return sections desired, and whether for steam or water (15 or 20 foot sections).

Radiators are shipped assembled unless ordered "knocked down". An extra charge for assembling will be made as shown in Trade Price Sheet.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL AERO WALL RADIATION

Directions For Ordering National Aero Wall Radiation

For convenience in handling and shipping, radiators will be assembled in stacks, as follows, unless otherwise ordered. Longer assemblings are not recommended because of possibility of strain in shipment.

- 5 ft. Horizontal, not to exceed 6 sections
- 7 ft. Horizontal, not to exceed 4 sections
- 9 ft. Horizontal, not to exceed 3 sections
- 7 ft. and 9 ft. Vertical, not to exceed 7 sections

Right and left threaded nipple with hexagon nut at center furnished to enable fitter to assemble stacks having more sections than above mentioned.

Number of Adjustable Hangers Required

Single Row

| | | |
|---------------------------------|---|---------|
| 5 to 12 Sections inclusive..... | 2 | Hangers |
| 13 to 18 " " | 3 | " " |
| 19 to 25 " " | 4 | " " |
| 26 to 30 " " | 5 | " " |

Double Row

| | | |
|--------------------------------|---|---------|
| 5 to 8 Sections inclusive..... | 2 | Hangers |
| 9 to 14 " " | 4 | " " |
| 15 to 24 " " | 6 | " " |
| 25 to 32 " " | 8 | " " |

Unless order specifies the exact number required, hangers will be furnished in accordance with the above table.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL AERO RADIATION

National Radiation Standard Tappings

One Pipe Steam Systems

| | |
|-------------------------------------|----------------------|
| 0 to 24 square feet inclusive..... | 1 inch |
| 25 to 60 square feet inclusive..... | 1 $\frac{1}{4}$ inch |
| 61 square feet and above..... | 1 $\frac{1}{2}$ inch |

Two Pipe Steam Systems

| | |
|-------------------------------------|--|
| 0 to 48 square feet inclusive..... | 1 x $\frac{3}{4}$ inch |
| 49 to 96 square feet inclusive..... | 1 $\frac{1}{4}$ x 1 inch |
| Over 96 square feet..... | 1 $\frac{1}{2}$ x 1 $\frac{1}{4}$ inch |

Hot Water Systems

| | |
|-------------------------------------|--|
| 0 to 40 square feet inclusive..... | 1 x 1 inch |
| 41 to 72 square feet inclusive..... | 1 $\frac{1}{4}$ x 1 $\frac{1}{4}$ inch |
| Over 72 square feet..... | 1 $\frac{1}{2}$ x 1 $\frac{1}{2}$ inch |

(This table is not intended to cover closed systems or the practice in some localities of using $\frac{3}{4}$ inch on upper floor radiators.)



NATIONAL AERO RADIATION

Standard Tappings, (continued)

Vapor And Vacuum Systems

Unless otherwise specified, all radiators for vapor will be tapped top and bottom at opposite ends as follows:

| | |
|---------------------------------------|--------------------------------------|
| 0 to 30 square feet inclusive..... | $\frac{1}{2}$ x $\frac{1}{2}$ inch |
| 31 to 60 square feet inclusive..... | $\frac{3}{4}$ x $\frac{1}{2}$ inch |
| 61 to 120 square feet inclusive..... | 1 x $\frac{1}{2}$ inch |
| 121 to 200 square feet inclusive..... | 1 $\frac{1}{4}$ x $\frac{1}{2}$ inch |
| Over 200 square feet..... | 1 $\frac{1}{2}$ x $\frac{3}{4}$ inch |

(Return tappings eccentric.)

Radiator Tappings


All tube radiators are tapped 1 $\frac{1}{2}$ inches at top and at bottom right hand and bushed to the required size. All wall radiators are tapped 1 $\frac{1}{2}$ inches right hand on the supply end, 1 $\frac{1}{2}$ inches left hand on the return end and bushed to the size required.

All air vents are $\frac{1}{8}$ inch, located at the top for water, and two-thirds down the return end section for steam. Air vents are plugged and eccentric bushings are furnished ONLY upon request.

Unless otherwise ordered all National Radiators will be bushed in accordance with above schedule.



NATIONAL PANEL RADIATION

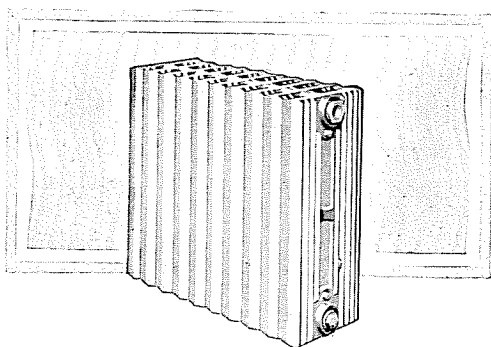

National Panel Radiation (5-Tube)

IN designing Panel-Rad (Registered Trade Mark) the National Radiator Corporation successfully coordinated three divergent and desirable qualities, to produce a unit that meets every requirement.

National Panel Radiation is unobtrusive; only its pleasingly smooth face is visible.

National Panel Radiation is space saving; when fully recessed it occupies no floor space whatever, leaves the room clear for furniture and fittings.

National Panel Radiation is highly efficient; the convection air currents progress unimpeded and at high velocity through specially designed flues which present a maximum of heating surface, and promote quick and continuous heat transfer. There is also a large percentage of radiated heat.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL PANEL RADIATION

Efficient . . .

space saving
unobtrusive


NATIONAL Panel-Rad (registered trade-mark name) finds its particular field in large buildings, where every foot of space is valuable and every means of saving space must be utilized. It is likewise of value for homes and hospitals. High efficiency, a high percentage of radiated heat which warms the lower portion of the room rapidly, and the decorative effect presented by the solid metal panel recommend it for all applications.

One advantage of National Panel-Rad is found in the fact that its closed end sections permit it to be recessed or wall mounted, without the necessity of entirely enclosing the unit. The radiation may be fully enclosed in a sheet metal casing with a grill at the bottom and the top, or the grill at the bottom may be omitted, or no casing need be used at all. When the radiator is recessed it is advisable to insulate the recess with asbestos or cork board.

National Panel-Rad owes its attractiveness to the fact that front faces of the sections come together, making an uninterrupted, iron-to-iron contact, and presenting therefore a uniform and pleasing appearance. This is made possible through National's use of push nipples, permitting the sections to be assembled tightly and permanently and without the use of gaskets.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL PANEL RADIATION




One Tube Panel Radiation—Sizes and Ratings

| Number of Sections | Length Overall Inches | 17-Inch Height 13¼ Square Feet Per Section | 23-Inch Height 2¼ Square Feet Per Section |
|--------------------|-----------------------|--|---|
| 2 | 4½ | 3½ | 4½ |
| 3 | 7 | 5¼ | 6¾ |
| 4 | 9½ | 7 | 9 |
| 5 | 12 | 8¾ | 11¼ |
| 6 | 14½ | 10½ | 13½ |
| 7 | 17 | 12¼ | 15¾ |
| 8 | 19½ | 14 | 18 |
| 9 | 22 | 15¾ | 20¼ |
| 10 | 24½ | 17½ | 22½ |
| 11 | 27 | 19¼ | 24¾ |
| 12 | 29½ | 21 | 27 |
| 13 | 32 | 22¾ | 29¼ |
| 14 | 34½ | 24½ | 31½ |
| 15 | 37 | 26¼ | 33¾ |
| 16 | 39½ | 28 | 36 |
| 17 | 42 | 29¾ | 38¼ |
| 18 | 44½ | 31½ | 40½ |
| 19 | 47 | 33¼ | 42¾ |
| 20 | 49½ | 35 | 45 |
| 21 | 52 | 36¾ | 47¼ |
| 22 | 54½ | 38½ | 49½ |
| 23 | 57 | 40¼ | 51¾ |
| 24 | 59½ | 42 | 54 |
| 25 | 62 | 43¾ | 56¼ |

NATIONAL PANEL RADIATION

One Tube Panel Radiation

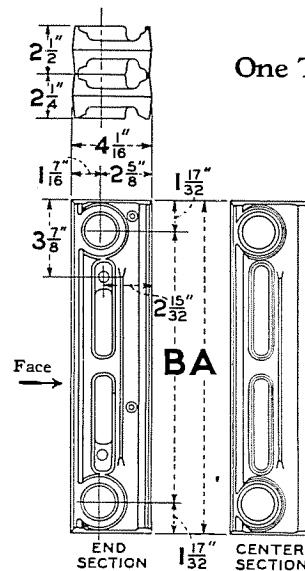

Dimensions

| Radiator Size | A | B |
|---------------|----------------------------------|------------------------------------|
| 17-inch | 17" | 13 ¹⁵ / ₁₆ " |
| 23-inch | 22 ³ / ₄ " | 19 ¹ / ₁₆ " |

Tappings—1½ inch top and bottom both ends. Bushed to meet requirements.

Connections—Assembled with extra heavy Malleable Iron Push Nipples.

Vents—All Panel Radiators regularly furnished with Steam and Water Vents.

Note: Distance from top of radiator to center of ½ inch diameter top rod hole—3⁷/₈ inches. Rod hole is ⁵/₃₂" off center line of nipple opening.


Add ½ inch to length for each bushing.

Guaranteed Heat Emission of 240 B. T. U. per Square Foot listed rating in room temperature of 70° F. with Steam at 215° F.

Interchangeable for Steam or Water.

Detail of hangers furnished on request.

NATIONAL PANEL RADIATION

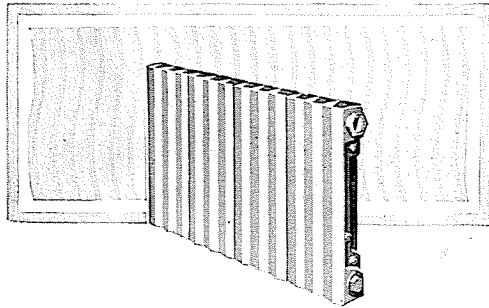


Two Tube Panel Radiation—Sizes and Ratings

| Number of Sections | Length Overall Inches | 17-Inch Height $3\frac{1}{2}$ Square Feet Per Section | 23-Inch Height $4\frac{1}{4}$ Square Feet Per Section |
|--------------------|-----------------------|---|---|
| 2 | 15 | $6\frac{3}{8}$ | $8\frac{1}{2}$ |
| 3 | $22\frac{1}{2}$ | 10 | $12\frac{3}{4}$ |
| 4 | 30 | $13\frac{1}{2}$ | 17 |
| 5 | $37\frac{1}{2}$ | $16\frac{3}{8}$ | $21\frac{1}{4}$ |
| 6 | 45 | 20 | $25\frac{1}{2}$ |
| 7 | $52\frac{1}{2}$ | $23\frac{1}{4}$ | $29\frac{3}{4}$ |
| 8 | 60 | $26\frac{3}{8}$ | 34 |
| 9 | $67\frac{1}{2}$ | 30 | $38\frac{1}{4}$ |
| 10 | 75 | $33\frac{1}{2}$ | $42\frac{1}{2}$ |
| 11 | $82\frac{1}{2}$ | $36\frac{3}{8}$ | $46\frac{3}{4}$ |
| 12 | 90 | 40 | 51 |
| 13 | $97\frac{1}{2}$ | $43\frac{1}{2}$ | $55\frac{1}{4}$ |
| 14 | 105 | $46\frac{3}{8}$ | $59\frac{1}{2}$ |
| 15 | $112\frac{1}{2}$ | 50 | $63\frac{3}{4}$ |
| 16 | 120 | $53\frac{1}{2}$ | 68 |

NATIONAL PANEL RADIATION

Two Tube Panel Radiation

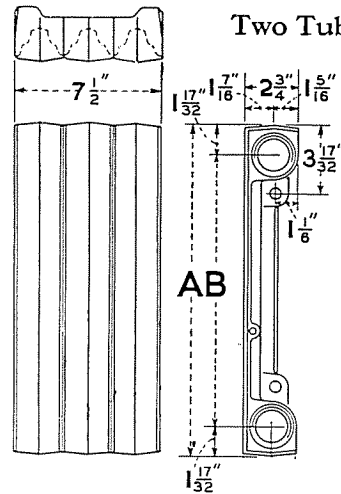

Dimensions

| Radiator Size | A | B |
|---------------|-------------------|---------------------|
| 17-inch | 17" | $13\frac{1}{16}$ " |
| 23-inch | $22\frac{3}{4}$ " | $19\frac{11}{16}$ " |

Tappings— $1\frac{1}{2}$ inch top and bottom both ends. Bushed to meet requirements.

Connections—Assembled with extra heavy Malleable Iron Push Nipples.

Vents—All Panel Radiators regularly furnished with Steam and Water Vents.

Note: Distance from top of radiator to center of $\frac{1}{2}$ inch diameter top rod hole— $3\frac{11}{32}$ inches.


Add $\frac{1}{2}$ inch to length for each bushing.

Guaranteed Heat Emission of 240 B. T. U. per Square Foot listed rating in room temperature of 70° F. with Steam at 215° F.

Interchangeable for Steam or Water.

Detail of hangers furnished on request.

NATIONAL PANEL RADIATION




Three Tube Panel Radiation—Sizes and Ratings

| Number of Sections | Length Overall Inches | 17-Inch Height 2 Square Feet Per Section | 20-Inch Height 2 1/4 Square Feet Per Section | 23-Inch Height 2 3/4 Square Feet Per Section |
|--------------------|-----------------------|--|--|--|
| 2 | 4 1/2 | 4 | 4 3/4 | 5 1/4 |
| 3 | 7 | 6 | 7 | 8 |
| 4 | 9 1/2 | 8 | 9 1/4 | 10 3/4 |
| 5 | 12 | 10 | 11 3/4 | 13 1/4 |
| 6 | 14 1/2 | 12 | 14 | 16 |
| 7 | 17 | 14 | 16 1/4 | 18 3/4 |
| 8 | 19 1/2 | 16 | 18 3/4 | 21 1/4 |
| 9 | 22 | 18 | 21 | 24 |
| 10 | 24 1/2 | 20 | 23 1/4 | 26 3/4 |
| 11 | 27 | 22 | 25 3/4 | 29 1/4 |
| 12 | 29 1/2 | 24 | 28 | 32 |
| 13 | 32 | 26 | 30 1/4 | 34 3/4 |
| 14 | 34 1/2 | 28 | 32 3/4 | 37 1/4 |
| 15 | 37 | 30 | 35 | 40 |
| 16 | 39 1/2 | 32 | 37 1/4 | 42 3/4 |
| 17 | 42 | 34 | 39 3/4 | 45 1/4 |
| 18 | 44 1/2 | 36 | 42 | 48 |
| 19 | 47 | 38 | 44 1/4 | 50 3/4 |
| 20 | 49 1/2 | 40 | 46 3/4 | 53 1/4 |
| 21 | 52 | 42 | 49 | 56 |
| 22 | 54 1/2 | 44 | 51 1/4 | 58 3/4 |
| 23 | 57 | 46 | 53 3/4 | 61 1/4 |
| 24 | 59 1/2 | 48 | 56 | 64 |
| 25 | 62 | 50 | 58 1/4 | 66 3/4 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL PANEL RADIATION

Three Tube Panel Radiation

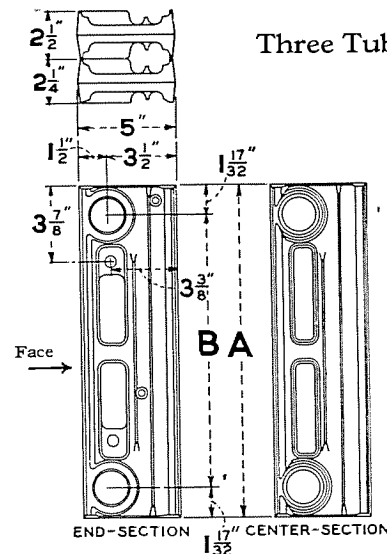

Dimensions

| Radiator Size | A | B |
|---------------|---------|-----------|
| 17-inch | 17" | 13 15/16" |
| 20-inch | 20" | 16 15/16" |
| 23-inch | 22 3/4" | 19 11/16" |

Tappings—1 1/2 inch top and bottom both ends. Bushed to meet requirements.

Connections—Assembled with extra heavy Malleable Iron Push Nipples.

Vents—All Panel Radiators regularly furnished with Steam and Water Vents.

Note: Distance from top of radiator to center of 1/2 inch diameter top rod hole—3 3/8 inches. Rod hole is 1/8" off center line of nipple opening.

Add 1/2 inch to length for each bushing.


Guaranteed Heat Emission of 240 B. T. U. per Square Foot listed rating in room temperature of 70° F. with Steam at 215° F.

Interchangeable for Steam or Water.

Detail of hangers furnished on request.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL PANEL RADIATION

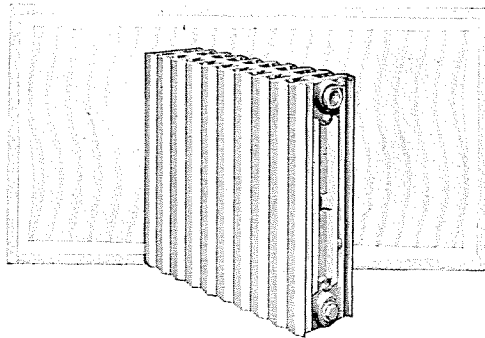


Four Tube Panel Radiation—Sizes and Ratings

| Number of Sections | Length Overall Inches | 17-Inch Height 2 2/3 Square Feet Per Section | 20-Inch Height 3 Square Feet Per Section | 23-Inch Height 3 1/2 Square Feet Per Section |
|--------------------|-----------------------|--|--|--|
| 2 | 4 1/2 | 5 1/2 | 6 | 6 3/4 |
| 3 | 7 | 8 | 9 | 10 |
| 4 | 9 1/2 | 10 2/3 | 12 | 13 1/3 |
| 5 | 12 | 13 1/3 | 15 | 16 2/3 |
| 6 | 14 1/2 | 16 | 18 | 20 |
| 7 | 17 | 18 2/3 | 21 | 23 1/3 |
| 8 | 19 1/2 | 21 1/3 | 24 | 26 2/3 |
| 9 | 22 | 24 | 27 | 30 |
| 10 | 24 1/2 | 26 2/3 | 30 | 33 1/3 |
| 11 | 27 | 29 1/3 | 33 | 36 2/3 |
| 12 | 29 1/2 | 32 | 36 | 40 |
| 13 | 32 | 34 2/3 | 39 | 43 1/3 |
| 14 | 34 1/2 | 37 1/3 | 42 | 46 2/3 |
| 15 | 37 | 40 | 45 | 50 |
| 16 | 39 1/2 | 43 2/3 | 48 | 53 1/3 |
| 17 | 42 | 45 1/3 | 51 | 56 2/3 |
| 18 | 44 1/2 | 48 | 54 | 60 |
| 19 | 47 | 50 2/3 | 57 | 63 1/3 |
| 20 | 49 1/2 | 53 1/3 | 60 | 66 2/3 |
| 21 | 52 | 56 | 63 | 70 |
| 22 | 54 1/2 | 58 2/3 | 66 | 73 1/3 |
| 23 | 57 | 61 1/3 | 69 | 76 2/3 |
| 24 | 59 1/2 | 64 | 72 | 80 |
| 25 | 62 | 66 2/3 | 75 | 83 1/3 |

NATIONAL PANEL RADIATION

Four Tube Panel Radiation

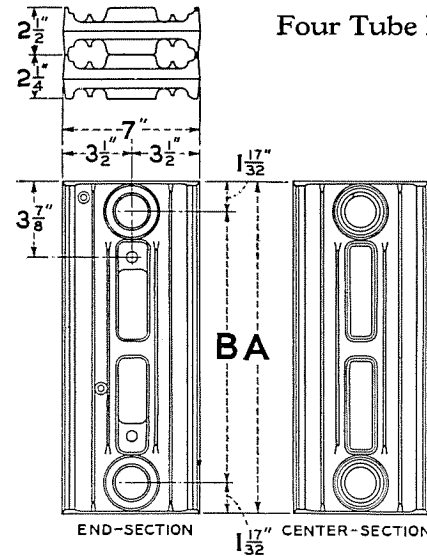

Dimensions

| Radiator Size | A | B |
|---------------|---------|-----------|
| 17-inch | 17" | 13 1/16" |
| 20-inch | 20" | 16 15/16" |
| 23-inch | 22 3/4" | 19 11/16" |

Tappings—1 1/2 inch top and bottom both ends. Bushed to meet requirements.

Connections—Assembled with extra heavy Malleable Iron Push Nipples.

Vents—All Panel Radiators regularly furnished with Steam and Water Vents.

Note: Distance from top of radiator to center of 1/2 inch diameter top rod hole—3 7/8 inches.


Add 1/2 inch to length for each bushing.

Guaranteed Heat Emission of 240 B. T. U. per Square Foot listed rating in room temperature of 70° F. with Steam at 215° F.

Interchangeable for Steam or Water.

Detail of hangers furnished on request.

NATIONAL PANEL RADIATION




Five Tube Panel Radiation—Sizes and Ratings

| Number of Sections | Length Overall Inches | 17-Inch Height 3 1/4 Square Feet Per Section | 23-Inch Height 4 Square Feet Per Section |
|--------------------|-----------------------|--|--|
| 2 | 4 1/2 | 6 1/2 | 8 |
| 3 | 7 | 9 3/4 | 12 |
| 4 | 9 1/2 | 13 | 16 |
| 5 | 12 | 16 1/4 | 20 |
| 6 | 14 1/2 | 19 1/2 | 24 |
| 7 | 17 | 22 3/4 | 28 |
| 8 | 19 1/2 | 26 | 32 |
| 9 | 22 | 29 1/4 | 36 |
| 10 | 24 1/2 | 32 1/2 | 40 |
| 11 | 27 | 35 3/4 | 44 |
| 12 | 29 1/2 | 39 | 48 |
| 13 | 32 | 42 1/4 | 52 |
| 14 | 34 1/2 | 45 1/2 | 56 |
| 15 | 37 | 48 3/4 | 60 |
| 16 | 39 1/2 | 52 | 64 |
| 17 | 42 | 55 1/4 | 68 |
| 18 | 44 1/2 | 58 1/2 | 72 |
| 19 | 47 | 61 3/4 | 76 |
| 20 | 49 1/2 | 65 | 80 |
| 21 | 52 | 68 1/4 | 84 |
| 22 | 54 1/2 | 71 1/2 | 88 |
| 23 | 57 | 74 3/4 | 92 |
| 24 | 59 1/2 | 78 | 96 |
| 25 | 62 | 81 1/4 | 100 |

NATIONAL PANEL RADIATION

Five Tube Panel Radiation

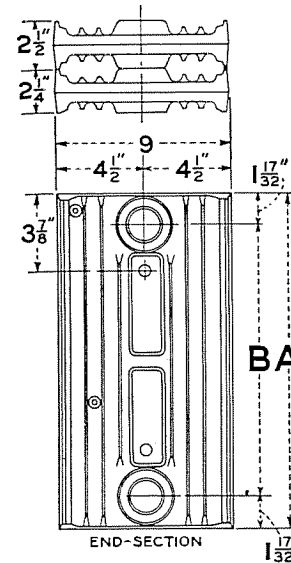

Dimensions

| Radiator Size | A | B |
|---------------|---------|-----------|
| 17-inch | 17" | 13 15/16" |
| 23-inch | 22 3/4" | 19 11/16" |

Tappings—1 1/2 inch top and bottom both ends. Bushed to meet requirements.

Connections—Assembled with extra heavy Malleable Iron Push Nipples.

Vents—All Panel Radiators regularly furnished with Steam and Water Vents.

Note: Distance from top of radiator to center of 1/2 inch diameter top rod hole—3 7/8 inches.

Add 1/2 inch to length for each bushing.

Guaranteed Heat Emission of 240 B. T. U. per Square Foot listed rating in room temperature of 70° F. with Steam at 215° F.

Interchangeable for Steam or Water.


Detail of hangers furnished on request.




NATIONAL UNIT HEATERS

Warmth . . . where, when, and as it is wanted

NATIONAL Unit Heaters provide an ideal means of efficiently and quickly heating mills, factories, garages, and similar structures. The warmth is distributed uniformly through the working zone, being forced down towards the floor, instead of rising to the ceiling. Chill-zones are eliminated. An additional advantage lies in the fact that in the summer the units may be operated as recirculating fans for cooling.




Front view No. 100; ceiling mounted with louvers.




Front view No. 101, 102; ceiling mounted with louvers.

National Unit Heaters consist of copper radiator tubes, fused to steel headers. Copper fins, 1½ inch outside diameter, are imbedded in the radiator tubing, giving a positive metal-to-metal contact, and assuring maximum heat transfer. A gang of radiator tubes are installed in a jacket. A motor driven fan is attached to the rear.

The Heaters are furnished in single-fan or dual-fan units, for ceiling or wall mounting. Motors can be furnished for any ordinary voltage; single or polyphase, 25 or 60 cycles; and direct current. Constant, and variable, speed motors are available.



Front view No. 121, 131; ceiling mounted with louvers.




Rear view No. 141; ceiling mounted with louvers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL UNIT HEATERS

National Unit Heaters are tested under pressure of 1000 pounds to the square inch, and are guaranteed for any operating steam pressure up to 200 pounds, with the exception of the No. 100. This unit is tested to 300 pounds, and guaranteed for 150 pounds operating steam pressure.



No. 101 or 102; wall mounted outside air intake, with louvers, dampers and screen.


Installation costs, including piping, etc., are low, making these heaters economically practicable as replacement heating systems in old plants, as well as highly desirable in new buildings.

To determine the size of unit or units required for a given application, the radiation can be estimated by means of the National Direct Reading Radiation Tables. The result obtained is expressed in square feet of steam radiation required for a 70° temperature difference. For


other inside temperatures, apply the "Made to Measure" heating factors, page 311.

To obtain the hourly B.T.U.'s required, multiply the square feet of steam radiation by 240.

To compute the B.T.U. requirements directly, use the coefficients of heat transfer for various types of construction. These coefficients are shown in the building construction diagrams pages 300-307.



No. 101 or 102; floor mounted recirculating box with louvers.

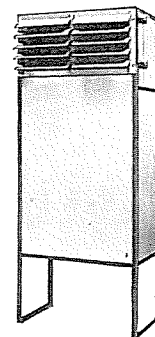

No. 121 or 131; floor mounted recirculating box with louvers.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL UNIT HEATERS

National Unit Heater No. 100
Rated Capacities

1700 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—714
Total Motor H. P.—1/15 Fan H. P. .06 (60° Air)
Equivalent Direct Radiation—167

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F. | | | | 62,000 | 70.8 | 65 |
| 50 | 43,200 | 104.7 | 45 | 45,000 | 106.8 | 47 |
| 60 | 40,000 | 111.5 | 41 | 42,000 | 114.2 | 44 |
| 70 | 37,100 | 118.7 | 38 | 39,000 | 121.2 | 41 |
| 80 | 34,100 | 125.7 | 35 | 36,000 | 128.3 | 37 |

1425 R. P. M.*

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—591
Total Motor H. P.—1/20 Fan H.P. .04 (60° Air)
Equivalent Direct Radiation—145

| | | | | | | |
|------|--------|-------|----|--------|-------|----|
| 0°F. | | | | 53,900 | 74.4 | 56 |
| 50 | 37,500 | 107.2 | 39 | 39,200 | 109.9 | 41 |
| 60 | 34,800 | 114.2 | 36 | 36,600 | 117.0 | 38 |
| 70 | 32,200 | 121.0 | 33 | 33,900 | 123.6 | 35 |
| 80 | 29,700 | 127.9 | 31 | 31,200 | 130.3 | 33 |

1100 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—474
Total Motor H. P.—1/30 Fan H. P. .028 (60° Air)
Equivalent Direct Radiation—123

| | | | | | | |
|------|--------|-------|----|--------|-------|----|
| 0°F. | | | | 45,600 | 78.4 | 48 |
| 50 | 31,700 | 110.3 | 33 | 33,100 | 113.1 | 34 |
| 60 | 29,400 | 117.0 | 30 | 30,900 | 119.9 | 32 |
| 70 | 27,200 | 123.7 | 28 | 28,600 | 126.5 | 30 |
| 80 | 25,000 | 130.4 | 26 | 26,500 | 133.4 | 28 |

810 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—357
Total Motor H. P.—1/40 Fan H. P. .022 (60° Air)
Equivalent Direct Radiation—99

| | | | | | | |
|------|--------|-------|----|--------|-------|----|
| 0°F. | | | | 36,600 | 83.7 | 38 |
| 50 | 25,400 | 114.3 | 26 | 26,600 | 118.7 | 28 |
| 60 | 23,600 | 120.9 | 24 | 24,800 | 124.0 | 26 |
| 70 | 21,900 | 127.5 | 23 | 23,000 | 130.6 | 24 |
| 80 | 20,100 | 133.8 | 21 | 21,100 | 136.5 | 22 |

*25 Cycle

NATIONAL UNIT HEATERS

National Unit Heater No. 101
Rated Capacities

1750 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—1770
Total Motor H. P.—1/6 Fan H. P. .140 (60° Air)
Equivalent Direct Radiation—300

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F. | | | | 111,500 | 51.3 | 116 |
| 50 | 77,500 | 89.5 | 80 | 81,100 | 91.4 | 84 |
| 60 | 72,000 | 97.5 | 74 | 75,600 | 99.3 | 79 |
| 70 | 66,600 | 105.3 | 69 | 70,200 | 107.2 | 73 |
| 80 | 61,400 | 113.2 | 64 | 64,900 | 115.1 | 67 |

1450 R. P. M.*

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—1465
Total Motor H. P.—1/8 Fan H. P. .093 (60° Air)
Equivalent Direct Radiation—259

| | | | | | | |
|------|--------|-------|----|--------|-------|-----|
| 0°F. | | | | 96,200 | 53.3 | 100 |
| 50 | 66,800 | 91.1 | 69 | 70,000 | 93.0 | 73 |
| 60 | 62,100 | 98.9 | 64 | 65,200 | 100.8 | 68 |
| 70 | 57,500 | 106.7 | 60 | 60,500 | 108.6 | 63 |
| 80 | 53,000 | 114.5 | 55 | 55,900 | 116.4 | 58 |

1160 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—1170
Total Motor H. P.—1/8 Fan H. P. .064 (60° Air)
Equivalent Direct Radiation—218

| | | | | | | |
|------|--------|-------|----|--------|-------|----|
| 0°F. | | | | 81,200 | 56.4 | 85 |
| 50 | 56,500 | 93.5 | 58 | 59,000 | 95.4 | 61 |
| 60 | 52,400 | 101.1 | 54 | 55,100 | 103.2 | 57 |
| 70 | 48,600 | 108.9 | 50 | 51,100 | 110.9 | 53 |
| 80 | 44,700 | 116.4 | 46 | 47,200 | 118.5 | 49 |

870 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—880
Total Motor H. P.—1/10 Fan H. P. .039 (60° Air)
Equivalent Direct Radiation—175

| | | | | | | |
|------|--------|-------|----|--------|-------|----|
| 0°F. | | | | 65,100 | 60.1 | 68 |
| 50 | 45,200 | 96.3 | 47 | 47,200 | 98.3 | 49 |
| 60 | 42,000 | 103.8 | 43 | 44,100 | 106.0 | 46 |
| 70 | 38,900 | 111.4 | 40 | 40,800 | 113.4 | 42 |
| 80 | 35,800 | 118.8 | 37 | 37,800 | 121.0 | 39 |

*25 Cycle

NATIONAL UNIT HEATERS

National Unit Heater No. 102

Rated Capacities

1750 R. P. M.

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—1695
 Total Motor H. P.—1/6 Fan H. P. .150 (60° Air)
 Equivalent Direct Radiation—417

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F | | | | 155,000 | 74.4 | 161 |
| 50 | 107,800 | 107.3 | 111 | 112,700 | 109.8 | 117 |
| 60 | 100,000 | 114.2 | 104 | 105,000 | 116.8 | 109 |
| 70 | 92,600 | 121.1 | 96 | 97,400 | 123.7 | 101 |
| 80 | 85,300 | 128.1 | 88 | 90,100 | 130.7 | 94 |

1450 R. P. M. *

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—1405
 Total Motor H. P.—1/8 Fan H. P. .101 (60° Air)
 Equivalent Direct Radiation—363

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 94,000 | 110.3 | 97 | 135,200 | 78.4 | 141 |
| 60 | 87,300 | 117.0 | 90 | 98,300 | 113.1 | 102 |
| 70 | 80,800 | 123.8 | 84 | 91,600 | 119.9 | 95 |
| 80 | 74,400 | 130.5 | 77 | 85,000 | 126.7 | 88 |
| | | | | 78,600 | 133.4 | 82 |

1160 R. P. M.

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—1120
 Total Motor H. P.—1/8 Fan H. P. .066 (60° Air)
 Equivalent Direct Radiation—309

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 79,800 | 114.2 | 83 | 114,800 | 83.4 | 119 |
| 60 | 74,200 | 120.8 | 77 | 83,500 | 117.2 | 87 |
| 70 | 68,700 | 127.5 | 71 | 77,800 | 123.8 | 81 |
| 80 | 63,200 | 133.8 | 65 | 72,200 | 130.4 | 75 |
| | | | | 66,800 | 137.0 | 70 |

870 R. P. M.

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—840
 Total Motor H. P.—1/10 Fan H. P. .040 (60° Air)
 Equivalent Direct Radiation—248

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 64,100 | 118.7 | 66 | 92,200 | 89.2 | 96 |
| 60 | 59,500 | 125.1 | 62 | 67,000 | 121.9 | 70 |
| 70 | 55,100 | 131.4 | 57 | 62,500 | 128.4 | 65 |
| 80 | 50,800 | 137.7 | 53 | 58,000 | 134.7 | 60 |
| | | | | 53,600 | 140.9 | 56 |

*25 Cycle

NATIONAL UNIT HEATERS

National Unit Heater No. 121

Rated Capacities

1750 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—3770
 Motor H. P.—2-1/6 Fan H. P. .33 (60° Air)
 Equivalent Direct Radiation—605

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F | | | | 224,500 | 48.5 | 234 |
| 50 | 156,300 | 87.4 | 161 | 163,400 | 89.1 | 170 |
| 60 | 145,000 | 95.4 | 150 | 152,200 | 97.1 | 158 |
| 70 | 134,200 | 103.4 | 139 | 141,100 | 105.1 | 147 |
| 80 | 123,700 | 111.3 | 128 | 130,600 | 113.1 | 136 |

1450 R. P. M. *

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—3130
 Motor H. P.—2-1/8 Fan H. P. .225 (60° Air)
 Equivalent Direct Radiation—525

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 135,700 | 89.1 | 140 | 195,200 | 50.7 | 204 |
| 60 | 126,000 | 97.1 | 130 | 142,000 | 91.0 | 148 |
| 70 | 116,600 | 104.9 | 121 | 132,300 | 98.9 | 138 |
| 80 | 107,500 | 112.8 | 111 | 122,700 | 106.7 | 128 |
| | | | | 113,500 | 114.6 | 118 |

1160 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—2500
 Motor H. P.—2-1/8 Fan H. P. .154 (60° Air)
 Equivalent Direct Radiation—445

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 115,200 | 91.6 | 119 | 165,700 | 53.8 | 172 |
| 60 | 107,000 | 99.3 | 111 | 120,500 | 93.5 | 126 |
| 70 | 99,000 | 107.2 | 103 | 112,300 | 101.3 | 117 |
| 80 | 91,300 | 114.9 | 94 | 104,200 | 109.1 | 109 |
| | | | | 96,400 | 116.8 | 100 |

870 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—1870
 Motor H. P.—2-1/10 Fan H. P. .099 (60° Air)
 Equivalent Direct Radiation—360

| 0°F | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|-----|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 50 | 93,200 | 95.0 | 96 | 134,000 | 58.4 | 140 |
| 60 | 86,500 | 102.4 | 90 | 97,500 | 97.1 | 102 |
| 70 | 80,100 | 110.0 | 83 | 90,800 | 104.7 | 95 |
| 80 | 73,700 | 117.7 | 76 | 84,300 | 112.3 | 88 |
| | | | | 77,900 | 119.8 | 81 |

*25 Cycle

NATIONAL UNIT HEATERS

National Unit Heater No. 131
Rated Capacities

1750 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—3470
Motor H. P.—2-1/6 Fan H. P. .34 (60° Air)
Equivalent Direct Radiation—800

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F. | | | | 297,500 | 69.6 | 310 |
| 50 | 207,000 | 103.8 | 214 | 216,500 | 106.2 | 226 |
| 60 | 192,000 | 110.9 | 199 | 201,500 | 113.4 | 210 |
| 70 | 177,700 | 118.0 | 184 | 187,000 | 120.5 | 195 |
| 80 | 163,800 | 125.0 | 170 | 173,000 | 127.6 | 180 |

1450 R. P. M.*

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—2870
Motor H. P.—2-1/8 Fan H. P. .233 (60° Air)
Equivalent Direct Radiation—695

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 180,000 | 106.6 | 186 | 258,500 | 73.2 | 269 |
| | | | | | 167,000 | 113.5 | 173 | 188,000 | 109.1 | 196 |
| | | | | | 154,600 | 120.4 | 160 | 175,300 | 116.2 | 183 |
| | | | | | 142,300 | 127.4 | 147 | 162,700 | 123.1 | 169 |
| | | | | | | | | 150,500 | 130.0 | 157 |

1160 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—2290
Motor H. P.—2-1/8 Fan H. P. .156 (60° Air)
Equivalent Direct Radiation—590

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 152,500 | 110.0 | 158 | 219,500 | 77.9 | 228 |
| | | | | | 141,500 | 116.7 | 147 | 159,500 | 112.8 | 166 |
| | | | | | 131,000 | 123.6 | 136 | 148,500 | 119.6 | 155 |
| | | | | | 120,700 | 130.3 | 125 | 137,800 | 126.4 | 143 |
| | | | | | | | | 127,500 | 133.2 | 133 |

870 R. P. M.

Cubic Feet per Minute (70° volume) at 60° Entering Temperature—1710
Motor H. P.—2-1/10 Fan H. P. .1 (60° Air)
Equivalent Direct Radiation—475

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 123,500 | 115.2 | 128 | 177,500 | 84.5 | 185 |
| | | | | | 114,500 | 121.5 | 119 | 129,000 | 118.1 | 135 |
| | | | | | 106,100 | 128.2 | 110 | 120,200 | 124.7 | 125 |
| | | | | | 97,800 | 134.6 | 101 | 111,700 | 131.3 | 116 |
| | | | | | | | | 103,200 | 137.8 | 107 |

* 25 cycle

NATIONAL UNIT HEATERS

National Unit Heater No. 141
Rated Capacities

1750 R. P. M.

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—3300
Motor H. P.—2-1/6 Fan H. P. .346 (60° Air)
Equivalent Direct Radiation—983

| Ent. Air Temp. | Steam at 2 lbs. Gauge | | | Steam at 5 lbs. Gauge | | |
|----------------|-----------------------|-------------|---------------------|-----------------------|-------------|---------------------|
| | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| 0°F. | | | | 366,000 | 90.2 | 381 |
| 50 | 254,500 | 119.5 | 263 | 266,000 | 122.7 | 277 |
| 60 | 236,000 | 125.8 | 244 | 248,000 | 129.2 | 258 |
| 70 | 218,500 | 132.0 | 226 | 230,000 | 135.3 | 239 |
| 80 | 201,500 | 138.4 | 208 | 213,000 | 141.7 | 222 |

1450 R. P. M.*

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—2730
Motor H. P.—2-1/8 Fan H. P. .242 (60° Air)
Equivalent Direct Radiation—863

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 223,000 | 123.7 | 240 | 320,000 | 95.3 | 333 |
| | | | | | 207,000 | 129.7 | 214 | 232,500 | 126.9 | 242 |
| | | | | | 191,500 | 135.7 | 198 | 217,000 | 133.2 | 226 |
| | | | | | 176,000 | 141.5 | 182 | 201,000 | 139.0 | 209 |
| | | | | | | | | 186,000 | 145.1 | 193 |

1160 R. P. M.

Cubic Feet per Minute (70° Volume) at 60° Entering Temperature—2190
Motor H. P.—2-1/8 Fan H. P. .160 (60° Air)
Equivalent Direct Radiation—737

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 191,000 | 128.7 | 197 | 274,500 | 102.0 | 286 |
| | | | | | 177,000 | 134.3 | 183 | 199,500 | 132.2 | 208 |
| | | | | | 164,000 | 140.2 | 169 | 186,000 | 138.1 | 194 |
| | | | | | 151,000 | 145.8 | 156 | 172,500 | 143.8 | 180 |
| | | | | | | | | 159,500 | 149.5 | 166 |

870 R. P. M.


Cubic Feet per minute (70° Volume) at 60° Entering Temperature—1645
Motor H. P.—2-1/10 Fan H. P. .101 (60° Air)
Equivalent Direct Radiation—606

| 0°F. | 50 | 60 | 70 | 80 | Steam at 2 lbs. Gauge | | Steam at 5 lbs. Gauge | | | |
|------|----|----|----|----|-----------------------|-------------|-----------------------|-----------------|-------------|---------------------|
| | | | | | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour | B.T.U. per Hour | Final Temp. | Lbs. Cond. per Hour |
| | | | | | 156,500 | 136.0 | 162 | 225,000 | 111.5 | 234 |
| | | | | | 145,500 | 141.6 | 150 | 163,500 | 139.8 | 170 |
| | | | | | 134,500 | 146.9 | 139 | 152,500 | 145.6 | 159 |
| | | | | | 124,000 | 152.2 | 128 | 141,500 | 150.9 | 147 |
| | | | | | | | | 131,000 | 156.2 | 136 |


* 25 cycle

NATIONAL UNIT HEATERS



Dimensions

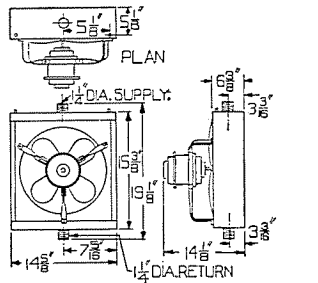

REAR END
NATIONAL UNIT HEATER NO. 100.

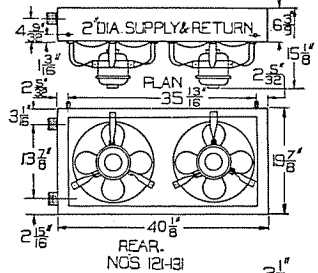


REAR.
NOS. 121-131

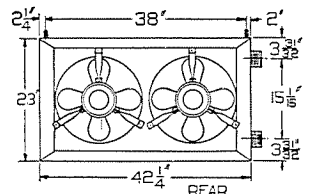


NO-141


NATIONAL UNIT HEATERS

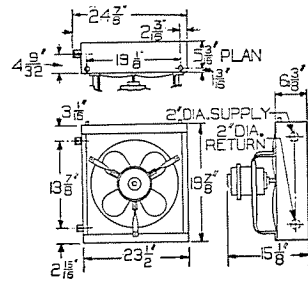

REAR END
NATIONAL UNIT HEATERS NOS. 101-102






FRONT END



FRONT END
NATIONAL UNIT HEATERS
WITH FLOOR MOUNTING

NATIONAL HEATING ACCESSORIES



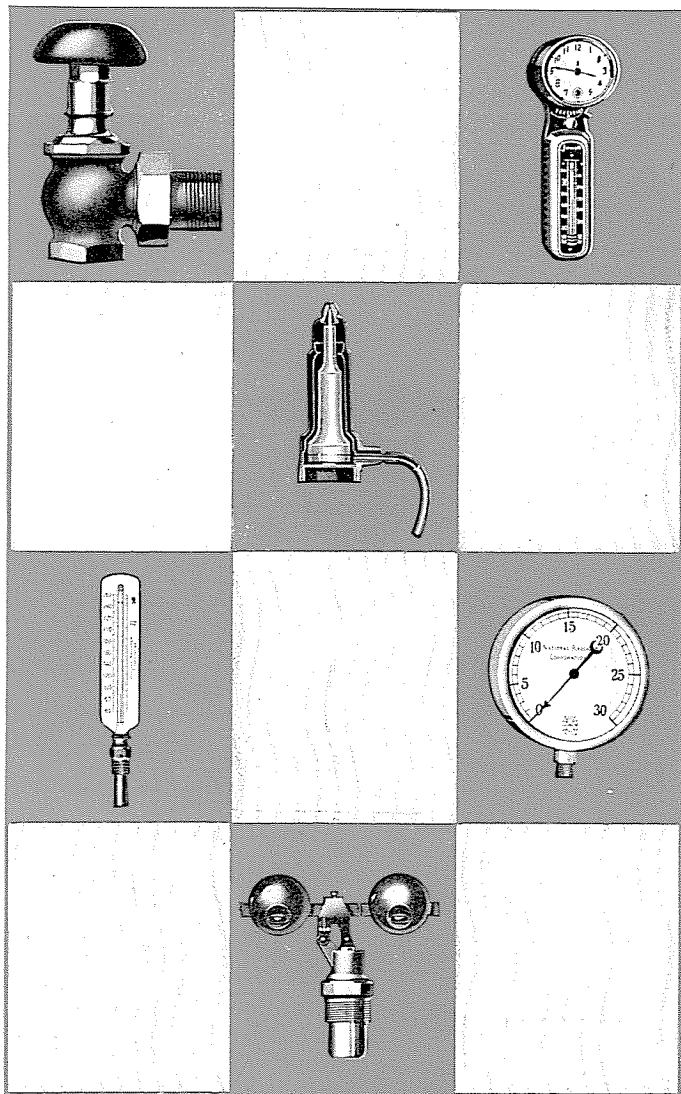

NATIONAL HEATING ACCESSORIES

Ideals . . .

Govern National Accessory Selection


THE same careful investigation is made of each new accessory that would be made of a new National Product. Exhaustive and rigorous tests are applied, or proof of them required. Manufacturing methods are checked up, and must demonstrate strict adherence to quality standards. Materials and workmanship are carefully scrutinized. Even in these products made by other manufacturers, National Ideals can be said to govern.

Experience has shown the wisdom of using National Heating Accessories with National Heating Systems. They have been tested together; the capabilities of each are known. In many cases, the particular type of accessory selected was chosen because of its proved ability to "team up" with the heating system, work with it in giving to the user the utmost in healthful comfort, proportioned warmth, and complete and permanent heating satisfaction.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

National Sta-Pak Packless
Steam Radiator Valve
No. 23



THIS valve has special graphite packing, inserted under pressure, permanently seated by a spring; it never needs repacking. The special red metal body has a high percentage of copper, is compact and non-porous. Valve seat is ground; composition valve disc has long wearing qualities. The composition mushroom handle contains an embedded metal plate which takes the strains of operating; it will not warp, check, or crack under influence of heat or moisture. One turn completely opens or closes valve. The forged tail piece nut has tremendous strength that withstands abuse, and is guaranteed against breakage. Finish on valve body is "Triple-Coat" rough nickel; smooth nickel finish on other metal parts. The valve stem is short, to obviate the wobbling that often comes with wear.




| | | | | | | |
|-------------|------|------|----|--------|--------|----|
| No. 23 Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|-------------|------|------|----|--------|--------|----|


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

National Sta-Pak Packless
Hot Water Radiator Valve
No. 24




THE sectional view below shows the ingenious and effective mechanism of this valve. The graphite packing, inserted under pressure, is permanently compressed by the action of a spring; repacking is not required. The valve body is red metal, approaching bronze in its characteristics, and containing a high percentage of copper; texture is smooth, fine and non-porous; threads are true, and free from pits and cracks. Valve contact surfaces are carefully machined. Stem is short, eliminating wobbling that often comes with use in long stems. Handle is a composition mushroom, with embedded metal plate to take strain of turning; one revolution opens and closes valve. Packing nut is annealed, and tail piece nut is forged, with great strength. It will withstand all sorts of abuse, and is guaranteed against breakage.



| | | | | | | |
|-------------|------|------|----|--------|--------|----|
| No. 24 Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|-------------|------|------|----|--------|--------|----|

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




Sta-Pak Graduating
Steam Valve No. 29

An adjustable metal indicating plate, graduated, accurately shows the amount the valve is opened. Stop feature, adjusted by a single screw, permits use for fractional distribution. Never needs repacking, has all the outstanding features of other Sta-Pak steam valves.


Sta-Pak Graduating
Hot Water Valve No. 28

Lever operated. A pointer sweeping over a graduated indicating plate shows the amount of valve opening. Adjustable stop permits setting valve for any desired permissible opening. Never needs repacking. Has composition, finish, durability, and other outstanding features of other Sta-Pak Hot Water Valves.

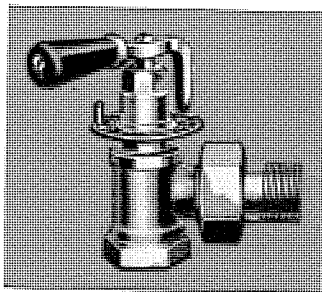


Sta-Pak Steam Corner
Valve No. 27

Red Metal, body fine-textured and free from porosity. Perfect threads. Composition mushroom handle will not warp or crack. One-turn opens and closes. Graphite packing never needs attention. Forged tail-piece nut. All right-hand threads.



Right Hand



Left Hand


Sizes No. 29, 28 and 27 $\frac{1}{2}$ " $\frac{3}{4}$ " 1" $1\frac{1}{4}$ " $1\frac{1}{2}$ " 2"

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL HEATING ACCESSORIES

National Steam Radiator
Valve No. 41

Composition handle, non-cracking, is unaffected by heat or moisture. Asbestos wick packing. Heavy metal body, rough nickel finish coat, perfect threads, strong tail piece nut.



No. 41 Size $\frac{1}{2}$ " $\frac{3}{4}$ " 1" $1\frac{1}{4}$ " $1\frac{1}{2}$ " 2"



National Steam Radiator Valve,
with Lock Shield No. 41-L



Can be operated only by a key, retained by authorized person. Has all other features of National Steam Radiator Valve No. 41.

No. 41-L Size $\frac{1}{2}$ " $\frac{3}{4}$ " 1" $1\frac{1}{4}$ " $1\frac{1}{2}$ " 2"

National Hot Water Radiator
Valve No. 142

Has composition handle, heavy metal body, and asbestos packing. Is carefully machined and ground.

No. 142 Size $\frac{1}{2}$ " $\frac{3}{4}$ " 1" $1\frac{1}{4}$ " $1\frac{1}{2}$ " 2"




National Elbow Union No. 152

Has heavy body, perfect threads, ground tail piece seat, and heavy forged nut. Is strong and sturdy.

No. 152 Size $\frac{1}{2}$ " $\frac{3}{4}$ " 1" $1\frac{1}{4}$ " $1\frac{1}{2}$ " 2"

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




Right Hand

National Steam Corner Valve No. 52


Made of heavy metal with high copper content. Seat is ground. Has long-wearing composition valve disc, asbestos packing, composition handle and strong tail-

piece nut to stand stresses. Furnished for hot water on order.



Left Hand

| | | | | | | |
|-------------|------|------|----|--------|--------|----|
| No. 52 Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|-------------|------|------|----|--------|--------|----|



National Gate Radiator Valve No. 256


Excellent construction. Each gate is ground into its own individual valve seat on a special machine, assuring a perfect fit and high effectiveness.

| | | | | | | |
|--------------|------|------|----|--------|--------|----|
| No. 256 Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|--------------|------|------|----|--------|--------|----|




National Globe Valve No. 260

Has heavy, non-porous, nickel finish body, ground seat, asbestos packing and composition mushroom handle.

| | | | | | | |
|--------------|------|------|----|--------|--------|----|
| No. 260 Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|--------------|------|------|----|--------|--------|----|



NATIONAL HEATING ACCESSORIES




National Radiator Valves

Roughing-in Measurements

These measurements cover the entire line of National Radiator Valves. The letters on the diagrams refer to corresponding letters on the table below:

| Cat. No. | Size | 1/2" | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" |
|--------------------------------------|------|--------|--------|--------|--------|---------|--------|
| Nos. 23 and 29 Packless | A | 2 3/4 | 2 3/4 | 3 1/16 | 3 7/16 | 3 3/4 | 4 3/8 |
| Nos. 27 and 52 Corner | A | 2 3/4 | 2 9/16 | 3 3/16 | 3 5/16 | 3 15/16 | 4 1/2 |
| | B | 1 5/16 | 1 5/16 | 1 | 1 3/16 | 1 5/8 | 2 3/16 |
| Nos. 24 and 28 Packless Hot Water | A | 2 3/4 | 2 3/4 | 3 1/16 | 3 7/16 | 3 3/4 | 4 1/2 |
| No. 41 Steam | A | 2 1/4 | 2 5/8 | 3 1/16 | 3 7/16 | 3 3/4 | 4 3/8 |
| Nos. 142 and 146 Hot Water | A | 2 1/4 | 2 5/8 | 3 1/16 | 3 7/16 | 3 3/4 | 4 1/2 |
| No. 152 Union Elbow | A | 2 1/4 | 2 1/2 | 3 | 3 3/8 | 4 | 4 3/8 |
| No. 256 Union Gate | E | 3 | 3 1/2 | 4 | 4 1/4 | 4 7/8 | 5 1/2 |
| No. 260 Union Globe | E | 3 1/4 | 3 3/4 | 4 1/2 | 5 1/8 | 5 3/4 | 6 1/2 |

NATIONAL HEATING ACCESSORIES




National Air Valves


Novus Automatic Air Valve

This is a competition valve, surprisingly effective in view of its low cost. It is of the carbon post type, with a brass-pin core to prevent buckling. Heavily nickel plated. Top cap is threaded to permit adjustment.


National Compression Air Valves



Wheel operated type.



Key operated type.




Key. Two furnished with each dozen valves.

These valves are made of first quality metal, finely finished, and with perfect threads. The valves are of the needle type. They are provided in either key or hand-wheel operated types.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




Dole Siphon Air Valve

No. 1

Every demand of steam radiator air valves is met in this Dole No. 1. 100% Automatic—nothing to adjust or regulate. Steam enters the entire radiator without resistance. Equally efficient on steady or intermittent escape of air.

Heavy drawn brass connecting stem, riveted and brazed, $\frac{1}{8}$ " I. P. T.

Height $3\frac{3}{8}$ ". Diameter $1\frac{1}{8}$ ". Stem length $\frac{3}{4}$ ".





Dole Vacuum Valve

No. 2-B

This valve performs the duty of a Siphon Air Valve and in addition holds a partial vacuum in any suitable system.

The air escapes freely thru the full size vent. Steam enters the entire radiator without resistance. When water enters the valve the float rises, and the vent is sealed. As the water siphons away the valve continues to vent.




NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Dole Quick Vent Air Valves

(Straight Shank)

No. 3-A, 3-B, and 3-C



For venting ends of steam mains, tanks, long mains, hot water generators and low pressure feed water heaters.

Three sizes for all popular demands.

Equally efficient on steady or intermittent escape of air.


No. 3-A has $\frac{1}{8}$ " I.P.T., No. 3-B has $\frac{1}{4}$ " I.P.T., No. 3-C has $\frac{3}{4}$ " I.P.T.



Dole Vacuum Valve


(Straight Shank)

No. 6-B




Steam heating systems equipped with vacuum valves should have Dole No. 6 Straight Shank Vacuum Valves on the mains. Assures quick venting. Vacuum feature makes one-pipe steam system more efficient.

The stem is part of the cast base— $\frac{1}{4}$ " I.P.T.



NATIONAL HEATING ACCESSORIES

National Marval Siphon
Auto-Air Valves



THIS popular priced valve vents air at any temperature, closes for steam through thermostatic action, and for water through the action of a float. Self draining—cannot waterlog. Tested on steam, air, and water under actual working conditions up to 10 pounds pressure. It is adjusted, sealed to prevent tampering, and shipped ready for use on pressures up to 10 pounds on one-pipe gravity steam systems. Frees radiators of air, makes all of the radiation hot, and boosts efficiency. The temperature of steam entering the valve instantly causes thermostatic expansion in the float—the concave diaphragm at the float bottom becomes convex—and this vertical movement forces the seating pin to seal the vent. The pressure seal continues until the steam supply ceases; whereupon the thermostatic element contracts lowering the seating pin in readiness for the next venting.



A bent length of tubing expanded within the base siphons off all condensation. This tubing is swiveled; permitting the valve to be easily screwed into place on the radiator. Guaranteed against defects for 5 years. Also furnished in straight shank style as illustrated, with $\frac{1}{8}$ " or $\frac{1}{4}$ " bottom connection.



NATIONAL HEATING ACCESSORIES

Hoffman Venting and Thermostatic Valves

HOFFMAN Valves are automatic, non-adjustable and, (excepting Nos. 20 and 21) are guaranteed to function properly for a period of five years, when installed and operated under conditions for which they were designed. They are made entirely of metal, and each part of a special alloy best adapted for its particular purpose.

The basic principle used in the design of all of these valves is that of an all-metal thermostatic member, with one or more flexible diaphragms, containing a volatile or heat sensitive fluid which causes valve action upon slight temperature changes.

They have a wide range in which they operate with the same degree of accuracy, for the internal fluid pressure in the thermostatic member maintains a constant relationship with the external steam pressure throughout the whole range for which each valve is intended.

The architect, engineer and heating contractor acknowledge that heat service obtainable from a steam heating apparatus is largely dependent upon the operation of valves of this kind.

They are so designed and constructed that, without thought or attention of the user, they automatically insure flexibility and economy of operation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL HEATING ACCESSORIES

No. 1 Hoffman Siphon Air Valve

For one pipe gravity systems

IT positively distinguishes between steam, air and water. The combined thermostatic member and float is a sealed metal chamber with a flexible diaphragm in the bottom, containing a volatile or heat sensitive fluid which vaporizes when the thermostat is in contact with steam, generating an internal vapor pressure which deflects the diaphragm and thereby closes the port. The vent port is kept either wide open or shut tightly with no intermediate position. Such positive action permits all air to escape until steam reaches the valve when instantaneous closure is made. It is noiseless in operation.




The float also takes care of any sudden charge of water within the radiator. Frequently a radiator while venting, "works water" causing water to surge against the air valve. The float action is so positive that as long as water remains against the valve the port is held closed. The instant water drops away, the siphon automatically discharges all the water back into the radiator without a single "spit," and venting is resumed.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES

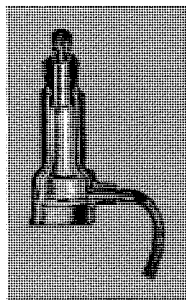

No. 2 Hoffman Siphon Air
and Vacuum Valve

THROUGH its use an ordinary one-pipe steam system may be changed into a vacuum type. This valve is similar in construction to the No. 1, but in addition when the radiator is once freed of air, return of air through the vent port *is prevented*.

Normally, the vent port is wide open until steam comes in contact with the valve, when the thermostatic fluid in the float expands the diaphragm and closes the vent port. When generation of steam ceases the float diaphragm contracts and the vacuum diaphragm in the base follows up the float diaphragm and holds the port tightly closed, thereby permitting a vacuum to form in the radiator because no air is permitted to return and take the place given up by the steam in condensing. If radiator is only partially heated, to prevent return of air to the system, a light air check or "automatic vacuum starter," is placed directly over the port. As soon as pressure within the radiator goes below atmospheric pressure, the check drops and temporarily retards the return of air through the vent port until a vacuum of 1" is obtained in the radiator. Then atmospheric pressure acting through the port in the bottom of the valve, pushes the vacuum diaphragm upward and thus positively closes the port.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES


No. 3 Hoffman Air Line Valve

A compact, well constructed valve for Air Line, or as they are frequently termed "Paul" Systems. It is sensitive in action and closes the instant steam fills the radiator. No adjustment is necessary either before or after installation. Connections $\frac{1}{8}$ " x $\frac{1}{4}$ ".




No. 4 Hoffman Quick Vent Valve

For use in venting mains, risers, Vento Stacks, Coils, etc. All air is freely vented through a $\frac{1}{8}$ -inch vent port without steam loss, but valve *does not close against water*. Standard connection $\frac{3}{4}$ ". $\frac{1}{4}$ " can be supplied when so ordered.




No. 5 Hoffman Quick Vent Float
Air Valve

For venting all air, without steam or water loss, where water is a factor. Especially recommended for the ends of steam or dry return mains, indirect radiators, blast coils, Vento or Aerofin Stacks, hot water generators, low pressure feed water heaters, driers, drums, etc. In principle the No. 5 is the same as No. 1. $\frac{1}{16}$ " vent port standard for pressures up to 10 lbs. $\frac{3}{16}$ " port for less than 3 lbs. Supplied with $\frac{3}{8}$ " connection.




NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




No. 6 and No. 16 Hoffman Quick Vent Float Air and Vacuum Valves

While Hoffman No. 2 Valves create a vacuum in the radiators, it is also necessary in order to completely vacuumize the system to vent and lock the air out of the mains. The No. 16 valve is recommended for this purpose except in cases where excessive amounts of water are encountered, when the No. 6 valve should be used. The No. 16 and No. 6 are suitable for use on mains, risers, and under other conditions where a quick vent is required and return of air to the system must be prevented. For venting the ends of mains where the difference between the low point of main and the water line is less than 18 inches, the No. 6 valve should always be used. For handling all conditions in one-pipe vacuum systems, the No. 6 valve is recommended. This valve has the double shell construction and operates under steam, air and water conditions in the same manner as the No. 2 vacuum valve. The No. 6 is, unless otherwise ordered, furnished with a $\frac{1}{16}$ inch port, and a $\frac{3}{8}$ inch connection. In vapor vacuum systems where pressure is less than 3 pounds, a $\frac{3}{16}$ inch port may be obtained. The No. 16 can be used on pressures up to 10 pounds. Size of port $\frac{1}{16}$ inch; connection $\frac{3}{4}$ inch.



NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

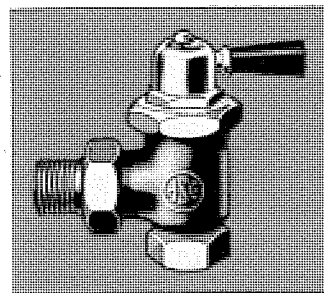

No. 7 Hoffman Adjustable Modulating Valve

FOR use on vapor or vapor vacuum systems. Valve is made in $\frac{3}{4}$ " size, Angle Pattern only, having a range of adjustment up to 200 sq. ft. of direct cast iron radiation. Easily adjusted whether system is in operation or cold, so as to limit the flow of steam into each radiator to which it is connected.


All adjustments are external and are made by means of a visible dial which is graduated with marks indicating a port area sufficient for 10 sq. ft. of radiation. Adjustment consists of loosening a lock nut, and moving a rotary sleeve which controls the port area. The ease of adjustment, which is locked by the steamfitter, permits "balancing up" the system, or causing certain radiators to heat before others. A supplementary dial having fractional graduations, viz: SHUT, $\frac{1}{4}$, $\frac{1}{2}$, $\frac{3}{4}$ and OPEN, permits the user to admit sufficient steam to fill any desired portion of the radiator and thus control room temperature.

The valve stuffing box has a lubricated fibre packing that lasts indefinitely and requires no attention, at the same time giving a very free valve action.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Nos. 8 and 9 Hoffman Return
Line Valves
(Or Radiator Traps)



THESE valves are installed on the return side of the radiator and permit discharge of air and condensation into the return main but close the vent port on contact with steam. Normally, the vent port is wide open and this is maintained for the discharge of air and condensation until steam fills the radiator when the port is instantly closed. Water at a temperature slightly below that of steam opens the port and permits the condensation to escape without steam loss.


Because of their wide range of operation from 0 to 50 lbs. valves may be installed in systems where steam is supplied through a reducing valve and perfect operation obtained even when reducing valve fails to function. Thermostats may be changed from one body to another of the same size as Hoffman Return Line Valves are non-adjustable. Therefore, it is easy to comply with engineer's specifications, which require removal of the thermostats while system is being cleaned.

Diaphragms are constructed of a special Hoffman alloy which resists acid corrosion, does not soften or crack under repeated action, and maintains a constant metal tension.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

No. 18 Hoffman
Return Line
Valve

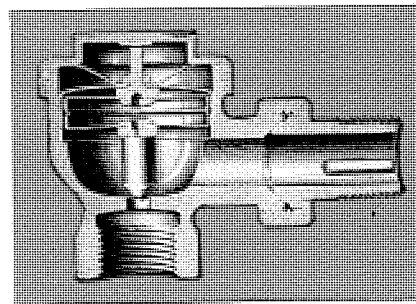


THIS valve is similar in construction and basic principle to the No. 8 Hoffman Return Line Valve. It is used where radi-

ator units contain not over 100 sq. ft. of direct cast iron radiation, and the pressure at the trap is not in excess of 15 lbs. The thermostat consists of one chamber made by two diaphragms separated by a space ring to which they are fastened. In the center of the bottom diaphragm the valve pin is attached. The joint being expanded and soldered remains absolutely tight. The thermostat is held in its cage by a pin expanded and attached to the top diaphragm, this pin extending through the cage and engaging with the boss on the cap.

No. 19 Hoffman
Radiator Valve

QUICK-OPENING, semi-packless type intended for vacuum pump installation or for vapor systems where modulation is not required. Valve is made in $\frac{3}{4}$ " size only, having a capacity up to 200 sq. ft. direct cast iron radiation; maximum operating pressure 15 lbs. It is heavily nickel-plated and has polished trimmings.

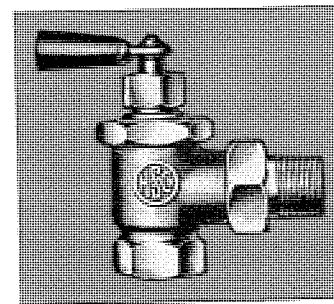

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

No. 19 Valve (continued)

The valve stem is in one piece, the end engaging in disc holder having a quadruple thread which allows full port opening with three-quarters of a turn of handle.


The stem packing is lubricated, compressed asbestos fibre that will last indefinitely and requires no attention other than an occasional take-up of the packing nut. Handle is hard black fibre that withstands severe service without breakage. Valve disc is genuine Jenkins Bros. composition.

Regularly supplied in lever handle type. On special orders, wood wheel handles, lock shields, closed tops, chain pull or extended stems can be furnished.



No. 11 Hoffman Vapor Vacuum Valve

This valve is especially designed for venting return mains of vapor-vacuum systems, or other conditions requiring large venting capacity, without return of air to system. Vent port $\frac{3}{4}$ in. Large float prevents water leakage. Connection $\frac{3}{4}$ in.



No. 12 Hoffman Blast Trap


For draining condensation from indirect radiators, Blast, "Vento" or "Aerofin" stacks, Unit heaters, Ends of steam mains and risers, driers and drums, hot water generators, and laundry machinery. Relieves condensa-

tion immediately, regardless of its temperature, vents hot or cold air, but closes against steam. If quantity of condensation to be handled is beyond the capacity of the thermostat controlled port, float rises, opening large port. Pipe connections with strainer 1-inch inlet and outlet.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

No. 13 Hoffman Damper Regulator

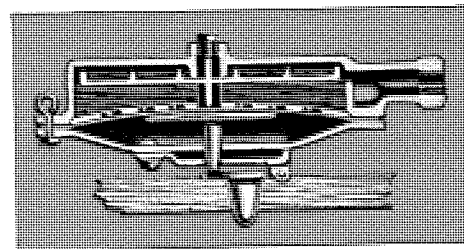

THE new
Hoffman
Damper Regu-

lator, with its compensating or balancing plate, is like a pair of scales. It is practically frictionless, remarkably sensitive and operates on slight changes in pressure.

The compensating plate prevents the accumulation of an extra amount of water when the diaphragm is pushed downward by pressure. This makes the load on the diaphragm constant under all conditions and the result is uniformly sensitive response to slight variations in pressures.

It is automatic in operation and after it has once been set at the desired pressure requires no attention. It controls the dampers, and responds immediately when any radiator valve is turned on or off, accelerating or retarding the fire to meet the change in demand for steam from radiators. This not only assures heat but conserves fuel. It will fit any type boiler, and is equipped with lever, weights, chain and pulleys.

Connection 1 in.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES

Hoffman Differential Loop

TO eliminate complicated apparatus for handling condensation and returning it to the boiler it is possible in most cases to permit condensation to return by gravity. This, however, necessitates some control over the boiler water line to prevent water from leaving the boiler if a high pressure is accidentally generated.

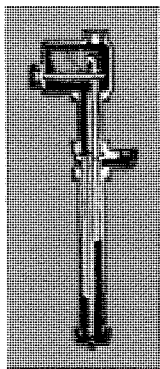

Differential Loop

Sold as part of Controlled Heat Equipment.

Prices on Loops or basement specialties, for use otherwise, are quoted on application, and sold only when we approve plan of installation.

No. 0 and No. 02 Loops should not be used where the low point in the dry return is less than 24 in. above boiler water line. With the No. 03 and No. 04 Loop this distance must be at least 30 in.

The Hoffman Differential Loop is a simple, yet efficient, device, that provides this safeguard. It does not function under normal operation. If, however, a dangerous pressure should be generated, the Loop instantly comes into action and prevents damage to the boiler.

The Loop contains no moving parts to corrode or stick and prevent action at any time when necessary. The operation is obtained through the use of a water column which seals a connection between the steam and return mains until such time as a predetermined pressure is generated, when the connection is unsealed and a small quantity of steam is blown into the return main. This action closes the port of the main vent and compresses the air in the return sufficiently to prevent water from rising beyond the level in the return established by the predetermined pressure.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS




NATIONAL HEATING ACCESSORIES

As soon as a sufficient quantity of steam is delivered to the return to accomplish the desired results, the blow-over connection is resealed and remains so until there is need for an additional supply of steam.

When the Loop functions it maintains a fixed differential pressure between the steam and return main. In the standard No. 0 and No. 02, Loops the differential pressure is 10 ounces, while with the No. 03 and No. 04 a 14-ounce differential is maintained. The maintenance of this differential permits circulation of steam throughout the system even though the main vent port is closed. Furthermore, by the maintenance of this differential when the Loop has functioned, a radiator which has been turned off may be put into commission and filled with steam in practically the same time as would be required if the Loop had not functioned.

Hoffman No. 15 Valve


In conjunction with the Loop a special valve for venting the entire system is used—the No. 15 Hoffman Vacuum Valve—which permits free venting of air through its $\frac{3}{4}$ -inch vent port and prevents air returning to the system by means of a light check, which is thoroughly reliable in fulfilling its requirements.



The No. 15 Valve is intended for use only in connection with Hoffman Differential Loops.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

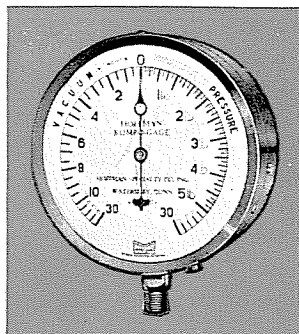

No. 14A Hoffman Kompo-Gage

THE Hoffman Kompo Gage is used with either Hoffman Controlled Heat installations or One Pipe Gravity Systems equipped with No. 2 Vacuum Valves. It accurately indicates the conditions under which the plant is operating.

The Kompo Gage measures pressure up to 30 lbs., the first 5 lbs. shown in ounce graduations, with a retard from 5 to 30 lbs. Vacuum is shown up to 30 inches, the first 10 inches in $\frac{1}{2}$ in. graduations and retarded from 10 to 30 inches. An externally operated set screw resets the hand to zero if jarred from its normal position during shipment.

Diameter 5 inches, Connection $\frac{1}{4}$ in.

Hoffman Specialties

For convenience in estimating and ordering Hoffman Controlled Heat Equipment is grouped into 2 classes.

Radiator Specialties consisting of

- 1 No. 7 Hoffman Modulating Valve
- 1 No. 8 Hoffman Return Line Valve

Basement Specialties, consisting of the following classes are grouped according to size of installation.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Hoffman Specialties—Group Assortments

For Single Boiler Installations

CLASS "O"

Basement Specialties for installations up to 2000 sq. ft. Direct Radiation, consisting of

- 2 No. 18 Return Line Valves for venting Steam Mains into Dry Return.
- 1 No. 0 Hoffman Differential Loop, including one No. 15 Vacuum Valve.
- 1 No. 13 Hoffman Damper Regulator.
- 1 No. 14A Hoffman Kompo Gage.

CLASS "B"

Basement Specialties for installations of 2001 to 3500 sq. ft. Direct Radiation, consisting of

- 3 No. 18 Return Line Valves for Venting Steam Mains into Dry Return.
- 1 No. 02 Hoffman Differential Loop, including one No. 15 Vacuum Valve.
- 1 No. 13 Hoffman Damper Regulator.
- 1 No. 14A Hoffman Kompo Gage.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Hoffman Specialties Group Assortments (continued)

CLASS "C"

Basement Specialties for installations of 3501 to 7500 sq. ft. Direct Radiation, consisting of

- 4 No. 18 Return Line Valves for venting Steam Mains into Dry Return.
- 1 No. 03 Hoffman Differential Loop, including one No. 15 Vacuum Valve.
- 1 No. 13 Hoffman Damper Regulator.
- 1 No. 14A Hoffman Kompo Gage.


CLASS "D"

Basement Specialties for installations of 7501 to 15,000 sq. ft. Direct Radiation, consisting of

- 6 No. 18 Return Line Valves for venting Steam Mains into Dry Return.
- 1 No. 04 Hoffman Differential Loop, including two No. 15 Vacuum Valves.
- 1 No. 13 Hoffman Damper Regulator.
- 1 No. 14A Hoffman Kompo Gage.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

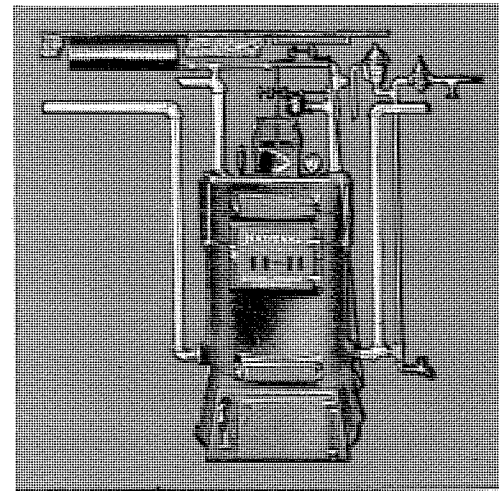

Thrush System of Hot Water Heating

The Thrush System for regulating hot water heating plants not only provides Automatic Temperature Damper Regulation, but it makes of any gravity job a Closed System operating under increased pressure with increased heat transmission and greater fuel economy resulting.




Patented Thrush Pressure Relief Valve

Thrush Water Relief

The Thrush Differential Pressure Relief Valve provides a safe overflow and holds a constant pressure against air cushion in pressure tank. The Differential principle builds up pressure tending to open the valve, nearly ten times as great as the pressure in the system, assuring positive operation. The valve seat is submerged in water so there is no place for corrosion or sediment to accumulate.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




Thrush Pressure Reducing Valve

FURNISHED with Thrush Class Double (AA) equipment and Double (BB) equipment to maintain constant pressures from water lines and to provide automatic refilling of boiler. First quality construction, brass working parts, submerged valve seat, non-corrosive parts. Adjustment easily made for various pressures without special tool.

Thrush Regulator

THE Thrush Thermostatic Temper Damper Regulator consists of a 3" Multiple Disc Thermostat which sets in an inner shell surrounded with the hot water from the boiler. The Thermostats operate the lever with the change of the water temperature, thus maintaining uniform temperatures in the rooms to be heated. This also prevents runaway fires and saves fuel. Regulator is complete within itself and can be adapted to any kind of Hot Water Boiler. Requires very little attention for proper operation. Thrush System comes complete with full instructions for operation. Installation is easy as it all goes on or near the boiler and requires only six feet of pipe and eight connections. Thrush Piping Plans free to the trade.

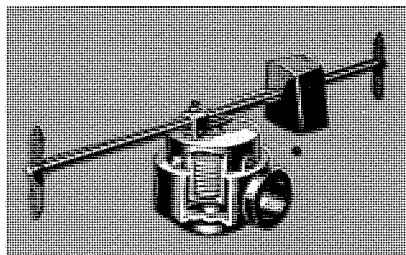

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Thrush Group Assortments

Thrush Class Double (AA) Equipment

Automatic Filling, consists of Thrush Automatic Damper Regulator, Differential Pressure Relief, Pressure Reducing Valve, Copper Bearing Steel Tank and Special Gauge.

Size No. 0 up to 350 sq. ft. of radiation.

Size No. 1 up to 700 sq. ft. of radiation.

Size No. 2 up to 1200 sq. ft. of radiation.

Size No. 3 up to 2000 sq. ft. of radiation.

Thrush Class A Equipment

Same as above except it has no Pressure Reducing Valve for Automatic Filling.

Size No. 0 up to 350 sq. ft. of radiation.

Size No. 1 up to 700 sq. ft. of radiation.


Size No. 2 up to 1200 sq. ft. of radiation.

Size No. 3 up to 2000 sq. ft. of radiation.

Thrush Class Double (BB) Equipment

Automatic Filling, consists of Thrush Differential Pressure Relief, Pressure Reducing Valve, Copper Bearing Steel Pressure Tank and Special Gauge.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES

Thrush Group Assortments (continued)

- Size No. 0 up to 350 sq. ft. of radiation.

- Size No. 1 up to 700 sq. ft. of radiation.

- Size No. 2 up to 1200 sq. ft. of radiation.

- Size No. 3 up to 2000 sq. ft. of radiation.

Thrush Class B Equipment

Same as above except it does not have Reducing Pressure Valve for Automatic Filling.

- Size No. 0 up to 350 sq. ft. of radiation.

- Size No. 1 up to 700 sq. ft. of radiation.

- Size No. 2 up to 1200 sq. ft. of radiation.

- Size No. 3 up to 2000 sq. ft. of radiation.

Thrush Separate Units

- Thrush Automatic Damper Regulator.
- Thrush Differential Pressure Relief.

Thrush Copper Bearing Steel Pressure Tanks

- Size No. 0 up to 350 sq. ft. of radiation.

- Size No. 1 up to 700 sq. ft. of radiation.

- Size No. 2 up to 1200 sq. ft. of radiation.


- Size No. 3 up to 2000 sq. ft. of radiation.

NOTE: For Buildings Higher than 3 Stories, Use One Size Larger Pressure Tank.



NATIONAL HEATING ACCESSORIES

The Thrush Dual Control Unit

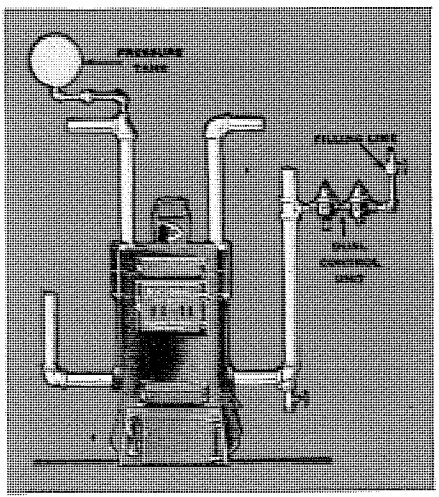


For Hot Water Heating

THE Automatic Dual Control Unit may be used for small to medium sized hot water heating plants, easily and economically, by merely installing the Dual Control Unit in the water supply line. This provides the advantages of a pressure or "closed system" with increased circulation and heating efficiency and assures safety to the equipment. The water supply is maintained automatically and excessive pressures are automatically relieved.

Installation is very simple, easy and inexpensive. Requires no attention or effort on the customer's part. For greatest efficiency a pressure tank should be added.

NATIONAL HEATING ACCESSORIES

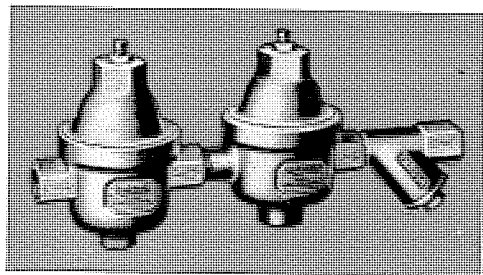


The Dual Control Unit


Soundly engineered, dependably built. Guaranteed against defects in material and workmanship.

Dual Control Pressure Reducing Valve

A high grade, thoroughly dependable device. Working parts are made of high quality brass. Pressure may be changed or varied to suit local conditions as they exist on the job. These Pressure Reducing Valves are set at the factory to maintain pressure from 12 to 15 pounds, suitable for a two or three-story building.



Dual Control Water Relief Valve



An efficient safety device. It is very dependable, having no small restricted openings, no tight-fitting working parts. Working parts are brass throughout and non-corrosive. Pressure is adjustable within a slight range, but cannot be set to more than 35 pounds



pressure. Guaranteed against defects of material and workmanship. A good valve for small jobs.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Galvanized Expansion Tanks

These tanks are made of refined galvanized steel, and are double riveted, caulked and tested to 100 pounds pressure. They are tapped top and bottom for one-inch overflow, and expansion pipe, and on the side near the top 1-inch for filling attachment. Also tapped for 1/2-inch water gauge brasses on 12-inch centers. Furnished in 8, 10, 15, 20, 26, 32 and 42 gallon capacities.

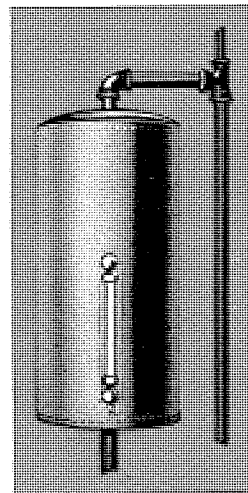


Sure Grip Tank Bracket

Fits any size tank. Heavy castings, with adequate strength to support full tanks. Easily applied with heavy screws.

Pop Safety Valves

Made to A. S. M. E. standards. Spring will retain resiliency indefinitely. Valve and seat non-corrosive, non-sticking. Fitted with a hand release lever. Set at factory to 15 pounds and sealed.


The heavy hex nut on the base permits wrench to be used in installation without crushing seat or housing.



Size 3/4" 1" 1 1/4" 1 1/2" 2" 2 1/2" 3" 3 1/2" 4"

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

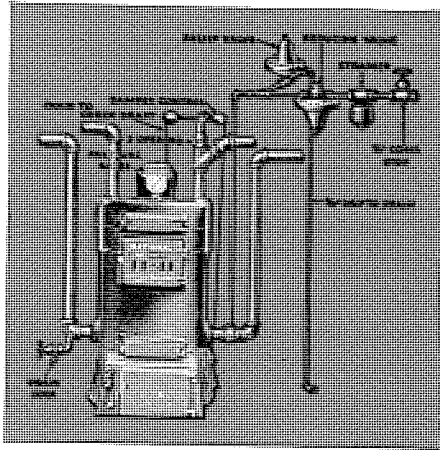

Mueller System of Hot Water Heat Control

THE Mueller System provides a means of converting a gravity return system into a closed system, with a consequent increase in the speed of circulation, and so of the heating effectiveness of the installation. All equipment is on one assembly, and so can be quickly and economically installed.


The expansion tank is eliminated completely, the necessary pressure head being built up by the expansion of the water in the closed system. Any water lost from system is replaced through the reducing valve, when the pressure drops to the point at which it is set.

The assembly complete consists of a relief valve, a reducing valve, a strainer, and a $\frac{1}{2}$ -inch compression stop. In addition a damper control and pressure gauge, not on assembly, are furnished.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Jewell Temperature Regulators



FOR most satisfactory operation, 3-unit controls—Room Thermostat, Limiting Device, and Motor—are recommended.



The Jewell Thermostatic Unit has a bi-metallic coil that is extremely sensitive to heat and cold. One degree change in tem-

perature above or below normal level makes this coil expand or contract. This makes an electric contact which causes the motor in the basement to operate, and open or close the draft and check dampers on the boiler. An adjustable indicator is provided, so that this operation will take place at any desired temperature. The clock thermostats automatically open the drafts at any pre-determined time in the morning, and bring the house up to the desired temperature. The eight day clock thermostat, in addition to this, shuts the drafts and checks the fire at a pre-determined time in the evening.

To specify a complete regulator by written or telegraphic code give the model number of the units wanted. For example, an order for the units mentioned above would read, "One J-8, A-1, J-E Regulator." This is important and necessary to insure the packing of the required fittings for the installation of the equipment.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Jewell Regulator Units


| Item | Model Number | Description |
|------------------|--------------|--|
| Thermostats | J-8 | Eight-Day Clock Thermostat |
| | J-1 | One-Day Clock Thermostat |
| | J-0 | Plain Thermostat |
| Limiting Devices | B-2 | Immersion Aquastat for Hot Water |
| | 70 | Pressure Regulator—for Steam |
| | A-1 | Vaportrol for Low Pressure Vapor |
| | E-1 | Surface Aquastat |
| Motors | J-E-S | Electric 110V. 60 Cy. A. C. with built-in switch |
| | J-E | Electric 110V. 60 Cy. A. C. |
| | J-S | Spring Motor |
| | J-G | Gravity Motor |

Upon special order motors can be furnished in 110 or 220 volt, 25, 30, 40 or 50 cycle A. C. and 110 or 220 Volt D. C.

NATIONAL HEATING ACCESSORIES

Taco Heaters

Domestic Taco with Brass Unions




THE Domestic Taco Water Heater is connected below the water line of steam or vapor boilers. The water in the heating boiler circulates through shell of Taco, transferring its heat to the domestic water which flows through the coil

to the tank. The Domestic Taco Heater consists of a cast iron housing containing a one-piece coil to which it is permanently fastened and tested to 1,200 pounds making positive assurance against leakage. Unions are provided for quick installation. Water is in contact with copper and brass (not iron) to avoid any possible discoloration. Removable cover permits of easy cleaning without disconnecting any piping. Sizes No. 0, 30, 1, 2 and 3. See Super Taco for larger capacities.

| Size | 0 | 30 | 1 | 1A | 2 | 2A | 3 |
|--|----|-------|-------|-------|--------|---------|---------|
| Capacity, below water line, gal. 100° rise 3 hours | 30 | 30-40 | 40-60 | 60-80 | 80-120 | 120-160 | 160-200 |
| 100° rise 1 hour | | | | | 30-40 | 40-50 | 50-66 |
| Square feet water radiation | | | | | 60 | 90 | 120 |
| Height, inches | 8½ | 11 | 13 | 14 | 16½ | 19 | 21½ |
| Diameter, inches | 5½ | 5½ | 5½ | 7 | 7½ | 8½ | 8½ |
| Tank connections, inches | ¾ | ¾ | ¾ | 1 | 1 | 1 | 1½ |
| Boiler connections, inches | 1 | 1 | 1 | 1¼ | 1¼ | 1½ | 2 |
| Shipping weight, pounds | 9 | 11 | 14 | 20 | 24 | 45 | 54 |

NATIONAL HEATING ACCESSORIES

Taco
Apartment
Heaters

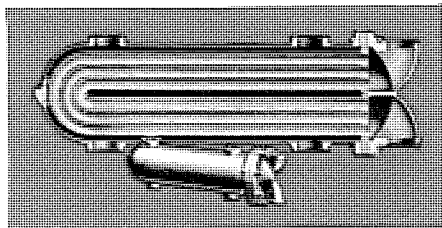

THE Apartment Taco is designed primarily for use with live steam wherever constant steam supply is available, as from a central plant. Used for heating domestic water or heating hot water radiators. Can also be used below water line of steam heating boilers. Apartment Taco is installed in a horizontal position—consists of cast iron housing containing a series of copper “U” tubes through which the domestic water circulates. Double top and bottom connections in shell regularly furnished for use when heating hot water radiators, or otherwise when required.

Taco No. 4, 5, 6

| Size | 4 | 5 | 6 |
|--|-----|--------------------------------|--------------------------------|
| Capacity, below water line, gal. | * | * | * |
| Cap. Steam Gals. 100° rise 3 hrs. | 600 | 1200 | 1800 |
| **Cap. Steam Gals. 100° rise 1 hr. | 200 | 400 | 600 |
| Square feet water radiation | 240 | 480 | 750 |
| Length, inches | 26 | 38 | 40 |
| Diameter, inches | 8 | 11 ³ / ₄ | 13 ¹ / ₂ |
| Tank connections, inches | 2 | 2 ¹ / ₂ | 3 |
| Boiler connections, inches | 2 | 2 ¹ / ₂ | 3 |
| Shipping weight, pounds | 96 | 192 | 265 |

*For these capacities Super Tacos are recommended.

When desired below water line, Capacity Gallons.


100° rise 3 hrs. No. 4, 320; No. 5, 640; No. 6, 960

**100° rise 1 hr. No. 4, 100; No. 5, 210; No. 6, 320

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES


Super Taco Heaters



SUPER TACO—A Vertical Type Heater for Installation Either Entirely Below, or Partly Below and Partly Above Water Line of Steam and Vapor Heating Boilers.

Capacities from 160 to 5000 gal. The Super Taco is a vertical type water heater made in a wide range of sizes. Consists of a cast iron housing to which water and steam from the heating boiler is admitted, transmitting heat through a series of vertical copper tubes to domestic water circulating to storage tank. Heads are of heavy bronze on all sizes up to and including No. 50. Liberal pipe connections provided. Vertically installed so as to provide positive circulation to hot water tank, even when located relatively low. Removable cover provides for easy cleaning without disconnecting any piping.

Where Oil Is Used for Fuel—When Taco Heaters are to be used in conjunction with a boiler using an automatic oil burner it will be necessary to increase the size of the Taco Heater, approximately, three times. For instance, where with coal a 200-gal. tank requires a No. 8 Taco Heater which has a capacity of 220 gal., a No. 12 Taco Heater which has a capacity of 600 gal. would be required when oil-fired. This is due to intermittent operation of oil burner and lower average temperature of boiler water.




NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Super Taco Heaters

SUPER-TACOS are furnished with or without jackets. Jackets are of heavy steel, finished with two coats of baked red enamel with black trimmings, and are thoroughly insulated with Asbestocel.

Super Tacos are equipped with removable bronze heads for tank connections. 4 convenient tappings for boiler connections. Vertical copper tubing assures quick heating.

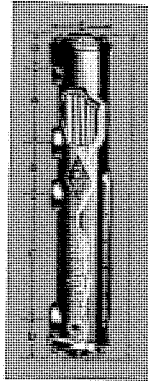

| Size | 7 | 8 | 9 | 10 | 12 | 15 | 20 | 25 | 35 | 50 | 75 | 100 |
|----------------------------|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|
| Capacity, gal. | | | | | | | | | | | | |
| 100° rise 3 hrs. | 160 | 220 | 320 | 450 | 600 | 800 | 1000 | 1250 | 1750 | 2500 | 3750 | 5000 |
| **100° rise 1 hr. | 52 | 70 | 100 | 150 | 200 | 265 | 333 | 415 | 580 | 830 | 1250 | 1660 |
| A (inches) | 8 | 10 | 8 | 10 | 10 | 12 | 7½ | 8½ | 8½ | 12 | 12 | 12 |
| B (inches) | 5½ | 7½ | 5 | 7 | 6½ | 9 | 8 | 11½ | 11½ | 18 | 18 | 18 |
| C (inches) | 13½ | 17½ | 13 | 17 | 16½ | 21 | 15½ | 20 | 20 | 30 | 30 | 29 |
| D (inches) | 3¾ | 3¾ | 5 | 5 | 6 | 6 | 7 | 7 | 7½ | 8½ | 10½ | 12½ |
| E (inches) | 6¼ | 6¼ | 7½ | 7½ | 9¼ | 9¼ | 11¾ | 11¾ | 14¼ | 14¼ | 19 | 21 |
| F (inches) | 34½ | 42½ | 36 | 44 | 45 | 54 | 45 | 54 | 55 | 77 | 81 | 84 |
| Boiler Con's., in. | 2 | 2 | 2½ | 2½ | 3 | 3 | 4 | 4 | 4 | 5 | 5 | 6 |
| Tank Con's., in. | 1½ | 1½ | 2 | 2 | 2 | 2 | 2½ | 2½ | 4 | 4 | 5 | 6 |
| Shipping wt., lbs. | 70 | 100 | 130 | 150 | 185 | 220 | 280 | 350 | 500 | 685 | 1050 | 1250 |


Increase size of Taco for inadequate tank capacity. Thirty-gallon tank capacity is usually required per family.

**For intermittent oil or gas fired installations, capacities based on 100° temperature rise in 1 hour are recommended.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Taco Heaters

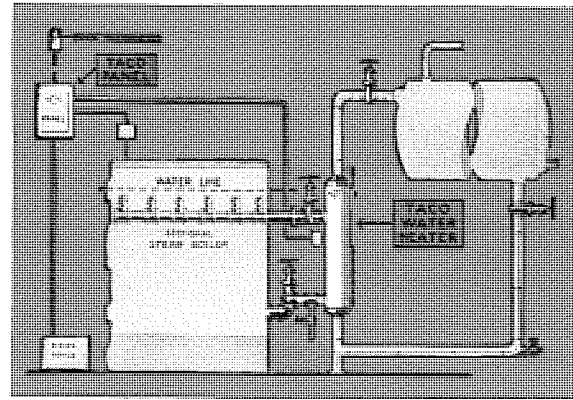

Taco-Abbott System For Oil Burner Installations

THE Taco-Abbott System (patented) is designed for furnishing year-round domestic hot water, using a steam heating boiler with an intermittent firing device and full automatic control.

The illustration shows a cast iron sectional boiler having each section tapped and headed together just below the water line. This permits a free circulation of the boiler water to the Taco from all sections of the boiler and prevents the boiler from steaming during the summer months. With round cast iron and steel boilers no header is needed. The boiler water temperature control is attached to the super TACO, a tapping for this being provided. This control is set to maintain a given water temperature in the boiler continuously, usually 170° to 180° F. The connecting of the room thermostat, together with the other controls, to the proper posts in the TACO

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS


NATIONAL HEATING ACCESSORIES

Taco Abbott Systems (continued)


Panel, prevents the boiler from making steam unless the room thermostat is demanding heat, hence there is no steam in the radiators during the summer months or on warm winter days.

Universal Taco

For use in any round hot water heating boiler. Better than a pipe coil. Fits in the fire pot. Interferes less with fire and there are no screwed connections to burn out. Three 1-in. connections on back, one on bottom. Made in both brass and malleable iron.

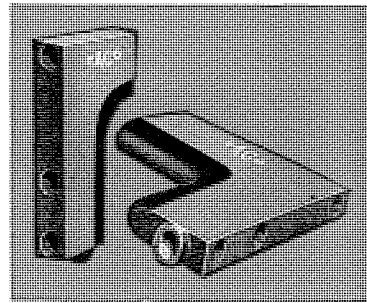

| No. | Capacity Gallons | Height Inches | Width Inches | Shipping Weight Lbs. |
|--------------|------------------|---------------|--------------|----------------------|
| 6-9-30 Iron | 30 | 10½ | 6 | 10 |
| 6-9-60 Iron | 60 | 10½ | 11½ | 17 |
| 6-9-30 Brass | 30 | 10½ | 6 | 10 |
| 6-9-60 Brass | 60 | 10½ | 11½ | 17 |

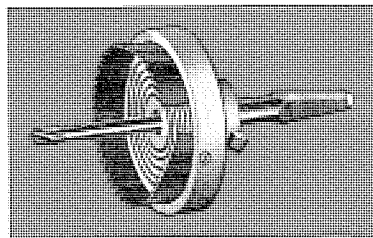

Rotary Hack Saw Tool

For Tapping Cast Iron and Steel Boilers.

Cuts openings 1", 1¼", 1½", and 2" leaving exact amount of stock for pipe threads.

Tool furnished complete including two blades of every size.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Naraco Water Regulator

No. 800A
Patented Sept. 23, 1924. Patent Pending

For Damper Control on Hot Water Boiler



A DAMPER regulator designed for hot water boilers which will control the drafts so as to maintain a constant

water temperature at any degree between 100° and 220° Fahrenheit.

The Naraco Water Regulator is made entirely of metal. Within the bulb is an expansion metallic bellows, surrounding which is volatile liquid. As the water temperature in the system increases, the liquid vaporizes and the gas pressure generated thereby compresses the bellows and forces upward the thrust rod or stem which tilts the lever and closes the drafts. As the water cools the gas pressure is relieved and the counterweight opens the drafts. There are no perishable parts to wear out. The action is sensitive and accurate. Adjustment for temperature is obtained by changing the position of weights on the lever.

Data and Dimensions

Length of bulb, 2⅞ inches. Connection, 2-inch standard pipe thread. Trimmings consist of one 37-inch lever, two four-pound weights, 12 feet of chain, two ceiling pulleys, four "S" Hooks. Shipping weight, 15 pounds.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES


Naraco Steam Regulator

No. 905A

Patent Pending

An improved type of all metal pressure regulator for controlling dampers on steam heating boilers. Extreme sensitiveness has been obtained by a new design of rocker. The operating element is a one piece brass metallic bellows—not built up from discs. The head is an integral part of the bellows, which eliminates the possibilities of leakage at soldered joints.

For steam pressure up to 15 pounds—finely finished in black baked-on enamel. Connection to boiler 1-inch I. P. S. male thread. Trimmings furnished, one 36-inch lever, one 4-pound weight, 12 feet of chain, two ceiling pulleys, four S-Hooks. Shipping weight 16 pounds.

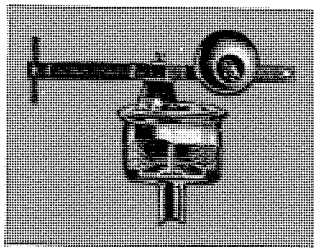

Naraco Junior Water Regulator No. 801A

Patented Sept. 23, 1924 Pending

This regulator is designed especially for hot water supply boilers. The construction and operation is similar to that of No. 800 A Water Regulator, described on page 275, but it is smaller and less powerful.

The Naraco Junior Water Regulator saves fuel by preventing overheating, saves attention to drafts, maintains constant water temperature, prevents boiling, sputtering, steaming water at the faucets and insures plenty of hot water as long as there is sufficient fire in the heater.


Data and Dimensions

Length of bulb, 2 inches. Connection $1\frac{1}{2}$ inch standard pipe thread. Temperature Range, 130° to 180° Fahr. Trimmings furnished, one 30-inch lever, one 3-lb. weight, 6 feet of chain, two "S" hooks. Shipping weight, 11 pounds.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

McDonnell & Miller Duplex Boiler Feeder

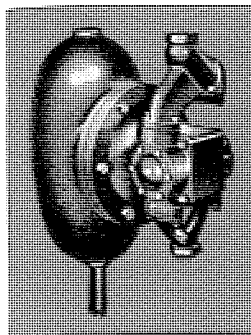

THIS feeder maintains the water line at all times and under all conditions of service, supplying the feed water requirements automatically and removing excess water when the boiler water line is abnormally high.

Highly desirable for steam systems,


and especially important on oil-burning installations. Has self-cleaning rotary phosphor bronze valves, with monel metal seats, insulated from float chamber, to prevent formation of scale. Rectangular valve orifices, and stream line water passages, reduce flow resistance to a minimum; and so supply water has full city pressure behind it. Water line may be changed over a range of two inches after installation, and differential changed to 1, 2, 3, 4, or 5 inches.

For Small Boilers


To meet the demand for a small water feeder, suitable for residence use, the No. 30 McDonnell and Miller Safety Feeder has been developed. This feeder is amazingly simple, positive in action, and highly effective. It is equipped with stainless steel valves, which eliminate the possibility of sticking. All of the quality features of the larger model have been retained.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

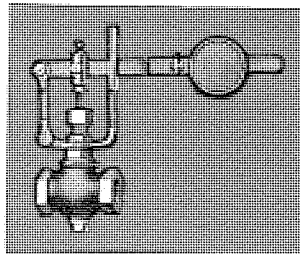

For use on natural gas



For use on central plant steam or gas

National Regulating Valves


Well made, sensitive, and positive acting. Adjustable weight. Bypass connection for pilot light.

Sizes 1" 1 1/4" 1 1/2" 2"

Empire Steam Traps

These traps as regularly made, are for low pressure, and should not be used where pressures exceed 20 pounds per square inch.

The copper floats are of the finest material, and are guaranteed not to collapse at authorized working pressures. The valve stems operate through guides, eliminating any possibility of their being unseated.

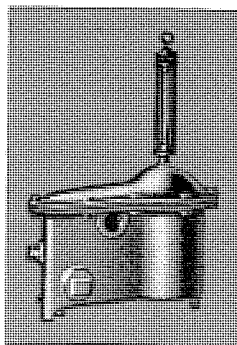


Sizes and Capacities

| Number | 00 | 0 | 1 | 2 | 3 |
|--|-------|--------|--------|--------|--------|
| Weight, Pounds | 15 | 30 | 59 | 72 | 117 |
| Inlet connections, inches | 3/4 | 1 | 1 1/4 | 1 1/2 | 2 |
| Outlet connection, inches | 3/4 | 1 | 1 1/4 | 1 1/2 | 2 |
| Drainage capacity, lineal feet of 1-inch pipe | 9,000 | 15,000 | 36,000 | 54,000 | 80,000 |
| Drainage capacity, square feet of direct radiating surface | 3,000 | 5,000 | 12,000 | 18,000 | 27,000 |

The above capacities are based on a condensation equal to 33/100-pound of water per hour per square foot of radiation, operating under low pressure.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

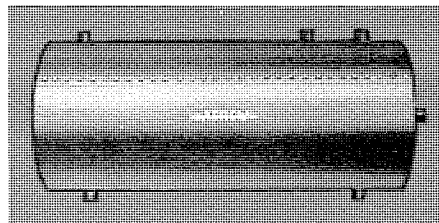

Arrow Hot Water Storage Tanks

ALL pressure tanks are built of best grade of open hearth steel sheets and plates. Longitudinal seams are riveted and electrical-welded. Heads are dished, and shell is flanged over it, and welded. Each tank is tested to pressure 50% greater than working pressure shown. Furnished with black finish, or galvanized.

| Capacity Gals. | Size In.—Ft. | Approximate Wt. | Size Openings | STANDARD | EXTRA HEAVY |
|----------------|--------------|-----------------|---------------|---|--|
| | | | | Tested to 100 lbs. and guaranteed for 65 lbs. working pressure. | Tested to 150 lbs. and guaranteed for 100 lbs. working pressure. |
| | | | | Approximate Wt. | Size Openings |
| 82 | 20 x 5 | 215 | 1 1/4" | 300 | 1 1/4" |
| 118 | 24 x 5 | 285 | 1 1/2" | 375 | 1 1/2" |
| 141 | 24 x 6 | 325 | 1 3/4" | 425 | 1 3/4" |
| 183 | 30 x 5 | 510 | 2" | 550 | 2" |
| 220 | 30 x 6 | 575 | 2" | 610 | 2" |
| 250 | 30 x 7 | 690 | 2" | 725 | 2" |
| 294 | 30 x 8 | 710 | 2" | 750 | 2" |
| 318 | 36 x 6 | 725 | 2" | 950 | 2" |
| 423 | 36 x 8 | 875 | 2" | 1250 | 2" |
| 504 | 42 x 7 | 1125 | 2" | 1400 | 2" |
| 576 | 42 x 8 | 1175 | 2" | 1550 | 2" |
| 720 | 42 x 10 | 1350 | 2" | 1700 | 2" |
| 1008 | 42 x 14 | 1825 | 2" | 2300 | 2" |
| 940 | 48 x 10 | 1900 | 3" | 2000 | 3" |
| 1128 | 48 x 12 | 2200 | 3" | 2300 | 3" |
| 1316 | 48 x 14 | 2600 | 3" | 2700 | 3" |
| 1504 | 48 x 16 | 2900 | 3" | 3000 | 3" |
| 1880 | 48 x 20 | 3425 | 3" | 3550 | 3" |
| 1480 | 54 x 12 | 2750 | 3" | 3300 | 3" |
| 1600 | 54 x 13 | 2900 | 3" | 3500 | 3" |
| 1720 | 54 x 14 | 3050 | 3" | 3700 | 3" |
| 2130 | 60 x 14 | 3650 | 3" | 4200 | 3" |
| 2275 | 60 x 15 | 3825 | 3" | 4225 | 3" |
| 2425 | 60 x 16 | 4000 | 3" | 4650 | 3" |
| 2625 | 60 x 17' 6" | 4275 | 3" | 4950 | 3" |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

Arrow Manholes, Handholes and Flanged Openings

MANHOLE in shell adds to weight of tank 150 lbs. —in Head 100 lbs.

If manholes are ordered in tanks of diameters 48" and less, they will be placed in the head unless otherwise specified.

Handhole can be placed in head or shell of any tank. Standard manhole can be placed in shell of any 36" or larger diameter tank, or in head of any 20" or larger diameter tank.

Orders for tanks with coils, manholes, handholes, and special openings are special and not subject to cancellation after work has been started. Change in size of openings to those shown below can be made at additional cost.

Flanges 2" or 2½", 3" or 3½", 4"

Spuds 2", 2½", 3", 3½", 4"

Handhole (4" x 6") in head or shell — Manhole (11" x 15") in head
Manhole (11" x 15") in shell

Coils for Storage Tanks

Inlet and Outlet pipes enter tank through couplings which are securely welded to the tank head.


Coils listed below are of four pipe return bend type for horizontal installation furnished in galvanized, black, copper or brass. Spiral coils for vertical installation quoted on application.

| Tank Size In.—Ft. | Coil Size | Tank Size In.—Ft. | Coil Size | Tank Size In.—Ft. | Coil Size |
|----------------------|--------------|----------------------|--------------|----------------------|--------------|
| 20 x 5 | 1" | 36 x 8 | 1½" | 48 x 20 | 2" |
| 24 x 5 | 1¼" | 42 x 7 | 1½" | 54 x 12 | 2" |
| 24 x 6 | 1¼" | 42 x 8 | 1½" | 54 x 13 | 2" |
| 30 x 5 | 1¼" | 42 x 10 | 1½" | 54 x 14 | 2" |
| 30 x 6 | 1¼" | 42 x 14 | 1½" | 60 x 14 | 2" |
| 30 x 7 | 1¼" | 48 x 10 | 2" | 60 x 15 | 2" |
| 30 x 8 | 1¼" | 48 x 12 | 2" | 60 x 16 | 2" |
| 36 x 6 | 1½" | 48 x 14 | 2" | 60 x 17' 6" | 2" |
| | | 48 x 16 | 2" | | |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

National Floor and Ceiling Plates



These plates are made of cold rolled steel, heavily coppered and nickel plated. Springs are strong and resilient, and will not lose their temper under steam temperatures.

Plates may be used for either floor or ceiling work, and are hinged, so they may be applied at completion of job.

Size, inches ½ ¾ 1 1¼ 1½ 2 2½ 3 3½ 4


National Hot Water Thermometers

Accurate temperature recorders, each individually calibrated in factory before shipment. Bulb rests in mercury bath. Ranges from 60° to 260°. A small set screw permits the removal of the tube without taking out the well, which would necessitate draining system. Threaded for ½-inch tapping. National Hot Water Thermometers can also be furnished in angle pattern upon request.




National Steam Gauge

This gauge is finely made, and accurately calibrated. Has oven baked white enamel case. Operates on the Bourdon-tube principle. Has siphon, to clear tube of condensate, and non-glare dial, with large, legible graduations. Registers by pounds 0 to 30 limits. Sizes 3½"




and 4½". Larger sizes, up to 6", may be secured on special order.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES



National Altitude Gauge


This gauge accurately records height of water from 0 to 70 ft. by feet, in hot water system. Provided with dial reading in pounds for use with closed systems. Has oven baked white enamel case. Operates on Bourdon-tube principle; has red master hand, which is set to column height to be maintained, and assures accurate filling of system.

These gauges can also be furnished graduated for both altitude and water pressure in pounds, for use on either open or closed systems. Legible figures, non-glare dial. Sizes $3\frac{1}{2}$ " and $4\frac{1}{2}$ ".


Larger sizes, up to 6", may be secured on special order.

National Low Pressure Retard Gauge

Has all good features of standard steam gauge, and in addition reads by ounces up to 10 pounds pressure, and by 5 pounds graduations from this point up to 30 pounds. Highly accurate, and gives exact knowledge of the pressure within the boiler. Oven baked white enamel dial and case. Furnished regularly in $3\frac{1}{2}$ " or $4\frac{1}{2}$ " sizes. Larger sizes, up to 6", may be secured on special order.




NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL HEATING ACCESSORIES


National Compound Gauge

Not only reads pressures, but vacuum. Graduations to right of top center of dial are in ounces up to 5 pounds, then 5-pound graduation up to 30 pounds. Graduations to left of top center are in inches of vacuum, by $\frac{1}{2}$ -inch graduations up to 10 inches. Has oven baked white enamel dial and case. Furnished regularly in $3\frac{1}{2}$ " and $4\frac{1}{2}$ " sizes. Larger sizes, up to 6", may be secured on special order.



No. 335 National Brass Expansion Tank Water Gauges


These gauges are self-cleaning. They are low pressure equipped with iron hand wheels to cut off water when replacing glass. There is a cock at bottom to drain off sediment, and to check glass. Equipped with two guards. Every expansion tank should be fitted with a gauge. Furnished in $\frac{1}{2}$ " size with 12" glass and $\frac{3}{4}$ " size with



16" glass.


No. 425 National Draw-Off Cocks

Sturdy and well made, with hand wheel valve. Discharge is threaded so hose may be attached. Removable washer. Sizes $\frac{1}{2}$ " and $\frac{3}{4}$ ".



NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




National Novus Spud Wrench

This is an exceptionally durable tool, that should be in every fitter's kit. Graduated sizes, to fit 2, 1½, 1¼, 1 and ¾ spuds.

Pin Handle Socket Wrench

Another tool without which no fitter's kit is complete, for tightening nuts on radiator rods. Made of forged steel, finely finished, and is strong and durable. Tapered on the outside, to allow wrench to be inserted between columns. Size ⅜" or ½".



Screw Nipple Radiator Wrenches

Made with machined end, to fit radiator screw nipples with 2 lugs on inside.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES



Radiator Cleaning Brushes

These brushes were especially designed to clean dust from the interior portions of radiators, ordinarily difficult to reach. The stiff bristles are held on a wire shaft, firmly secured in a wooden handle.

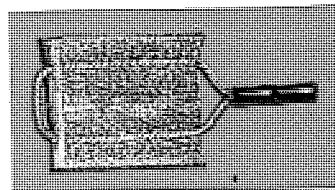

No. 7

National Novus Boiler Brushes

Soot may decrease the efficiency of a boiler as much as 25%—a potent argument for frequent cleaning with Novus brushes. Strong, springy, wire bristles, that last out the season, firmly secured on a threaded shank. This shank will fit any standard flue-brush handle.


Dimensions

| Number | Shape | Width | Breadth |
|--------|--------|-------|---------|
| 3 | oval | 4" | 2" |
| 7 | double | 4" | 1¾" |
| 8 | " | 6" | 2½" |




National Bronze Brush

High Grade, with Fitch bristles, firmly held to prevent shedding. For applying bronze finishes to radiators.

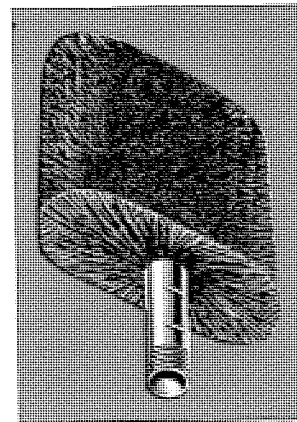


No. 3



No. 8

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES




National Bronze
A HIGH grade bronze, furnished in Aluminum, Antique copper, light green, mahogany, chestnut, walnut, and oak finishes. The quality of bronze is not dependent on the nature of the material, but on the fineness of the pulverizing. National Aluminum is ground very fine, while the brass is pulverized by pounding it through a screen, the process taking from 12 to 14 hours. The resulting flakes are polished, resulting in a thin, brilliant coating, over which the liquid will flow, keeping it permanently bright. The table below shows the amounts of bronze, and bronzing liquid (furnished in gallon and half-gallon patent stoppered cans) required for a given amount of radiation.



dependent on the nature of the material, but on the fineness of the pulverizing. National Aluminum is ground very fine, while the brass is pulverized by pounding it through a screen, the process taking from 12 to 14 hours. The resulting flakes are polished, resulting in a thin, brilliant coating, over which the liquid will flow, keeping it permanently bright. The table below shows the amounts of bronze, and bronzing liquid (furnished in gallon and half-gallon patent stoppered cans) required for a given amount of radiation.


| Type | Bronze | Liquid | Rad. Covered |
|---------------|--------|--------|--------------|
| Gold "X" | 3¾ lb. | 1-gal. | 1100 sq. ft. |
| Gold "XX" | 3 lb. | 1-gal. | 1250 sq. ft. |
| Aluminum "XX" | 1½ lb. | 1-gal. | 1100 sq. ft. |



Novus Black Asphaltum

Before an installation is considered completed, all exposed piping in the cellar should be given a coat or two of black asphaltum, to add a finishing touch. Will not crack or flake off. It insulates, protects, and beautifies.

NATIONAL HEATING ACCESSORIES




National Solder Seal

A scientifically prepared material that, placed in the boiler, will search out any leaks in the system and seal them. Solidifies only when exposed to air; material in system remains in suspension, and circulates with water. One can (1 pound) recommended for 1750 feet of radiation.

Boiler Se-Ment-Ol

Used for the same purpose as is Solder-Seal, but it is in a liquid form. One can (one quart) should be used for each 150 to 250 feet of radiation.



Vinco Cleaner

More than 75 per cent of ordinary domestic heating troubles come from dirty boilers. Dirt and oil decrease efficiency, and cut down heat furnished. Vinco cleaner is guaranteed to put the system back in first-class shape, and correct foaming, surging, priming and slow steaming. Ask for free laboratory service on feed water analysis. Vinco is packed in 1½, 3, 5, and 10 pound cans.




Quantity of Vinco Required for the First Clean-Out*

| Up to | 350 sq. ft. of radiation | 3 lb. |
|-------|--------------------------|-------|
| 351 | 600 | 5 " |
| 601 | 1100 | 8 " |
| 1101 | 1400 | 10 " |
| 1401 | 1800 | 13 " |
| 1801 | 2100 | 15 " |
| 2101 | 2700 | 20 " |
| 2701 | 3100 | 23 " |
| 3101 | 3700 | 26 " |
| 3701 | 4200 | 28 " |
| 4201 | 4600 | 28 " |
| 4601 | 5000 | 30 " |

*Hot Water Systems and Old Systems need half these quantities.

NATIONAL HEATING ACCESSORIES

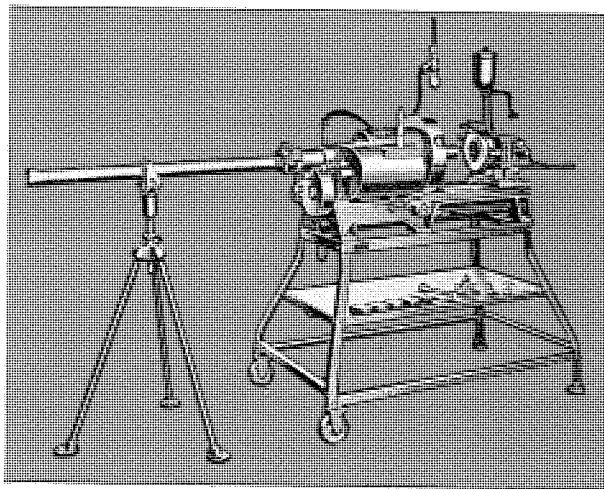

Rogaco Portable Electric Pipe Machines

THE Rogaco Portable Electric Pipe Machine is designed for cutting off, reaming, threading and making on fittings. It is suitable as a bolt, bar or pipe machine. The bar or pipe is held in the universal chuck, and is centered at the rear end of the spindle by a special centering device. The pipe at the cut-off tool is centered by hardened V jaws. This gives three centering points. The machine cuts threads which are straight and true to gauge.

It is equipped with a gear shift which gives two right hand spindle speeds and two left hand. A vertical lever controls the speed changes. A horizontal lever operating on the side controls the direction in which spindle revolves.

The standard equipment of the Rogaco Pipe Machine includes a special motor, enclosed in a dirt and grease-proof case, single and double engineer's wrenches, electric

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL HEATING ACCESSORIES

cable with lamp socket connections, and a full set of right-hand dies $\frac{3}{8}$ to 2 inches, or a Rogaco quick opening die complete with chasers $\frac{1}{2}$ to 2 inches, whichever is desired.

All controls are within easy reach of the operator. The motor can be started or stopped instantly by turning a snap switch. The carriage is controlled by a lever operating through a rack and pinion. There are special cut-outs on the carriage which throw it out of mesh automatically.

This machine will thread pieces of pipe as short as $3\frac{1}{2}$ inches end to end. Close nipples or thread to thread nipples can be cut by use of the Rogaco nipple chuck, which is furnished as an accessory when desired.


With the Rogaco reversible power drive attachment and hand geared stocks, such as Beaver or Toledo, the capacity of the machine can be increased to 8 inches in diameter, or even up to 12 inches. With this attachment it is not necessary to back off by hand; the machine is reversed and it backs off by power.

| Description | Approx. Shipping Wt., Lbs. |
|---|----------------------------|
| Machine Complete with Right-Hand Solid Dies $\frac{3}{8}$ to 2-Inch, or Rogaco Quick Opening Die with Chasers $\frac{1}{2}$ to 2-Inch, and Either an A. C. or D. C. Motor of Standard Current Characteristics | 600 |
| Angle Iron Truck Stand | 100 |
| Rogaco Reversible Power Drive | 30 |
| Roller Bearing Tripod Pipe Support | 30 |
| Rogaco Nipple Chuck with Bushings $\frac{3}{8}$ to 2-Inch | 20 |
| Extra Motor, Either A. C. or D. C. | 100 |
| Extra Sets of Chasers for Opening Die Sizes $\frac{1}{2}$ to 2-Inch, Six Sets, Four Chasers to a Set, per set | 1 |
| Extra Solid Dies, Sizes $\frac{3}{8}$ to 2-Inch, Seven Dies, per set | 14 |
| Extra Bushings for Nipple Chuck, $\frac{3}{8}$ to 2-Inch, Seven Sizes per set | 1 |
| Rogaco Quick Opening Die Complete with Chasers $\frac{1}{2}$ to 2-Inch | 38 |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL ENGINEERING DATA



Compiled by

SAMUEL E. DIBBLE

Past President American Society
of Heating and Ventilating En-
gineers; Professor and Head of
the Heating and Ventilating De-
partment of Carnegie Institute
of Technology.



NATIONAL ENGINEERING DATA

INDEX

Foreword..... 294

Important Points a Heating Contractor Should Recommend..... 296

Determining Radiation Requirements..... 297

The National *Made-to-Measure* Method..... 298

Building Construction Diagrams..... 300-307

 Brick Exterior Walls, Diagrams 1, 4, 7, 10, 13, 16..... 300, 301, 302

 Concrete Exterior Walls, Diagrams 2, 5, 8, 11, 14, 17..... 300, 301, 302

 Hollow Tile Exterior Walls, Diagrams 3, 6, 9, 12, 15, 18..... 300, 301, 302

 Frame Exterior Walls, Diagrams 19 to 26..... 303, 304

 Frame Interior Walls Diagram 27..... 304

 Windows and Skylights, Diagrams 28, 29..... 304

 Infiltration Through Window and Door Cracks, Diagram 30..... 304

 Floors, Diagrams 31 to 33..... 305

 Floors and Ceilings, Diagrams 34 to 39..... 305, 306

 Roofs, Diagrams 40 to 48..... 306, 307

National Direct Reading Radiation Tables..... 308, 309

National Conversion Factors for Various Temperatures and Wind Velocities..... 310

National *Made-to-Measure* Heating Factors..... 311

Climatic Conditions in Cities Throughout the Country..... 312, 313

Application of the National *Made-to-Measure* Method..... 314

How to Select the Proper Size and Type of Radiation..... 318

National *Made-to-Measure* Radiation Charts..... 320-325

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL ENGINEERING DATA

INDEX (continued)

Proving Temperature Guarantees in Warm Weather..... 326

Selecting the Right Boiler for the Job..... 327

Radiator Heating Systems..... 328

Hot Water Heating Systems..... 329

Hot Water Pipe Connections..... 336

Hot Water Pipe Sizes..... 338, 340

Steam Heating Systems..... 341

Causes and Prevention of Water Line Trouble..... 350

Hartford Return Connections..... 352

Recommended Steam Connections..... 353

Expansion of Pipe..... 360

Length of Expansion Offsets or Bends..... 360

Square Feet of Surface per Lineal Foot of Pipe..... 361

Losses from Horizontal Bare Iron Pipes..... 362

Domestic Hot Water Heating..... 364

Swimming Pool Installations..... 366

Selection and Installation of Taco Heaters..... 368

Minimum Allowable Sizes of Safety Valves..... 372

Chimneys—Provisions of Underwriters Code..... 373

Dimensions of Fire Clay Flue Linings..... 376

Determining Sizes of Chimneys, Cubical Content Method..... 377

Determining Sizes of Chimneys, Heat Demand Method..... 378

Psychrometric Chart..... 380

Greenhouse Heating Systems..... 381

Sizes of Heating Fuels..... 388

Weights of Various Fuels..... 389

Firing Various Types of Fuels..... 389

Average Fuel Consumption by Months..... 393

Pipe Welding..... 394

Directions for Cleaning Boilers..... 395

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



FOREWORD

THE purpose of National Engineering Data is to provide facilities for ready reference in connection with problems having to do with the installation of National *Made-to-Measure* Heating Systems. By descriptive text, charts, tables, diagrams, etc., pertinent information is cataloged and made available to National Heating Specialists to enable them to install a modern heating system of exact specifications in such a manner that they can stand unqualifiedly in back of the job. No attempt has been made to incorporate tables dealing with matters largely of an academic nature as these same tables are available in various government books, text books and hand books. However, a very sincere



attempt has been made to handle the problems of correct boiler type and style, correct radiation type and size, and correct technique in combining them to give the customer meritorious results. Thus the heating contractor may win new friends and secure an ever-increasing volume of business because of the high quality of his work and the happiness and contentment his customers enjoy from their National *Made-to-Measure* Heating Systems.

Acknowledgement is gratefully made to the American Society of Heating and Ventilating Engineers, and the Heating and Piping Contractor's National Association for research and engineering data referred to or used.



NATIONAL ENGINEERING DATA

Points a Heating Contractor Should Recommend

ALL too often the heating plant is blamed for failure to properly warm a building, when the fault is entirely due to incorrect building construction. While this is not primarily the business of the heating contractor, he can do effective missionary work for better construction. Economies resulting from such construction will build good-will for him.

It is suggested, therefore, that heating contractors make the following recommendations:

- (1) Provide chimney of proper dimensions; tile lined to prevent leakage.
A good chimney is essential to proper combustion and satisfactory plant operation.
- (2) Cover boiler and piping with insulation.
This saves fuel by reducing heat loss and also greatly improves the appearance of the installation.
- (3) Install a room thermostat.
It saves labor by automatically regulating the drafts, maintains uniform room temperature, and builds good will.
- (4) Weatherstrip doors and windows, and install storm sash and doors.
This saves sufficient fuel to justify its being strongly urged.
- (5) Insulate walls and roofs.
This cuts down heat losses, saves fuel, makes a more comfortable home in summer as well as in winter.



NATIONAL ENGINEERING DATA

Determining Radiation Requirements

THE first step in planning a heating system is the determination of the correct amount of radiation required to properly heat each individual room. In order to do this it is necessary to compute the heat loss through walls, glass, etc., and the loss due to infiltration. This involves many calculations and is perhaps one of the reasons why approximate rules are still used. When it is desired to quickly and roughly determine the approximate amount of radiation required for a house, the 2-20-200 method given below may be of help.

Each 2 Square Feet of glass requires 1 square foot of steam radiation (Square feet of opening divided by 2)

Each 20 square feet of exposed wall requires 1 square foot of steam radiation (Net exposed wall divided by 20)

Each 200 cubic feet of room volume requires 1 square foot of steam radiation (Cubical content divided by 200)

The above rule is simple and quick and can be used to determine the approximate amount of radiation for a building, but, because of widely varying conditions, it is not accurate, as it fails to properly take into account the various types of construction, exposures, wind velocity, infiltration and temperature differences.

The tendency in recent years has been to depart from old time methods of rule-of-thumb "guesses" as to the apportionment of radiation and to endeavor to determine by more scientific procedure the correct amount of radiation to be installed. To arrive at a scientific basis considerable laboratory and research work has been done and as a result, a vast amount of valuable data has been published. Much of this data, however, is beyond the requirements of the heating contractor and it has been difficult for him to make practical use of it.



NATIONAL ENGINEERING DATA

Determining Radiation Requirements (continued)

FEELING the need for a simplified but nevertheless scientific method of determining radiation requirements, the Engineers of the National Radiator Corporation, in collaboration with other authorities on the subject, have selected the pertinent facts and have classified them in readily usable form.

The commonly used types of building construction are clearly illustrated in colored diagrams on pages 300 to 307. Accompanying each diagram is a table showing, in column "S" the varying sizes of construction; in column "K" the coefficient of heat transmission, and in column "T" the number of the National Direct-Reading Radiation Table applying to it. The heat transmission coefficients are taken from the latest American Society of Heating & Ventilating Engineers' Guide and were used as a basis in compiling the Direct-Reading Radiation Tables. This value "K" (B.T.U. loss per square foot of surface per hour for 1° temperature) is indicated as a 2-place decimal for the convenience of those who may desire to compute the total B.T.U. loss for a given building. The coefficients of transmission in column "K" need not be considered by the heating contractor in using the Direct-Reading Radiation Tables.

Walls, roofs and partitions may consist of more than a thousand different combinations of building materials. Many of these, however, have approximately the same



NATIONAL ENGINEERING DATA

Determining Radiation Requirements (continued)







coefficient of heat transmission and it is not, therefore, necessary to have a separate table for each kind of construction. There are twenty Direct-Reading Radiation Tables on pages 308 and 309; these take care of all commonly used types of construction. These tables show the amount of steam radiation required for 5 to 1,000 square feet of surface or lineal feet of crack.

As an illustration; to find the square feet of steam radiation for a quantity of wall surface of the construction shown in Diagram No. 22, page 303, note under "T" that Table No. 6 on page 308 is indicated. Assume that the amount of wall surface is 328 square feet. Opposite 300 in Table 6, Page 308 will be found "23," and opposite 30 (the figure nearest 28) is "2". The total of these, which requires only a mental calculation, is 25 square feet, which is the amount of steam radiation required for 328 square feet of wall surface of the construction shown in Diagram No. 22. For hot water radiation the usual 60% is to be added.

In the same manner the amount of radiation for infiltration through any number of lineal feet of crack around windows and doors may be quickly determined by selecting the proper table shown in Diagram 30.

Factors to correct for varying wind velocities and temperatures are shown on page 310. Factors to correct for room temperatures other than 70° are shown on page 311.

NATIONAL ENGINEERING DATA







| WALLS - BRICK PLAIN | | WALLS - BRICK PLASTER 1 SIDE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|---|------------------------------|---|---|----|-----|----|-----|-----|----|-----|-----|----|---|--|---|--|---|----|-----|---|-----|-----|----|-----|-----|----|-----|-----|----|-----|-----|---|
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.39</td> <td>10</td> </tr> <tr> <td>12"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>16"</td> <td>.24</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .39 | 10 | 12" | .30 | 7 | 16" | .24 | 5 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.36</td> <td>9</td> </tr> <tr> <td>12"</td> <td>.28</td> <td>7</td> </tr> <tr> <td>16"</td> <td>.23</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .36 | 9 | 12" | .28 | 7 | 16" | .23 | 5 | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .39 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .24 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .36 | 9 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .28 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.51</td> <td>13</td> </tr> <tr> <td>10"</td> <td>.46</td> <td>12</td> </tr> <tr> <td>12"</td> <td>.41</td> <td>11</td> </tr> <tr> <td>16"</td> <td>.34</td> <td>9</td> </tr> </tbody> </table> | S | K | T | 8" | .51 | 13 | 10" | .46 | 12 | 12" | .41 | 11 | 16" | .34 | 9 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.46</td> <td>12</td> </tr> <tr> <td>10"</td> <td>.42</td> <td>11</td> </tr> <tr> <td>12"</td> <td>.38</td> <td>10</td> </tr> <tr> <td>16"</td> <td>.32</td> <td>8</td> </tr> </tbody> </table> | S | K | T | 8" | .46 | 12 | 10" | .42 | 11 | 12" | .38 | 10 | 16" | .32 | 8 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .51 | 13 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .46 | 12 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .41 | 11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .34 | 9 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .46 | 12 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .42 | 11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .38 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .32 | 8 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.32</td> <td>8</td> </tr> <tr> <td>10"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.24</td> <td>6</td> </tr> <tr> <td>16"</td> <td>.20</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .32 | 8 | 10" | .30 | 7 | 12" | .24 | 6 | 16" | .20 | 4 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>10"</td> <td>.29</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.23</td> <td>5</td> </tr> <tr> <td>16"</td> <td>.19</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .30 | 7 | 10" | .29 | 7 | 12" | .23 | 5 | 16" | .19 | 4 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .32 | 8 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .24 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .20 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .29 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .19 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| WALLS - BRICK FURRING, LATH & PLASTER | | $\frac{1}{2}$ " WALLS - BRICK INSULATION & PLASTER | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|--|--|---|---|----|-----|---|-----|-----|---|-----|-----|---|---|--|---|--|--|----|-----|---|-----|-----|---|-----|-----|---|-----|-----|---|-----|-----|---|
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.25</td> <td>6</td> </tr> <tr> <td>12"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>16"</td> <td>.18</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .25 | 6 | 12" | .21 | 5 | 16" | .18 | 4 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.19</td> <td>4</td> </tr> <tr> <td>12"</td> <td>.17</td> <td>3</td> </tr> <tr> <td>16"</td> <td>.15</td> <td>3</td> </tr> </tbody> </table> | S | K | T | 8" | .19 | 4 | 12" | .17 | 3 | 16" | .15 | 3 | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .25 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .19 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .17 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>10"</td> <td>.28</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.26</td> <td>6</td> </tr> <tr> <td>16"</td> <td>.23</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .30 | 7 | 10" | .28 | 7 | 12" | .26 | 6 | 16" | .23 | 5 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.22</td> <td>5</td> </tr> <tr> <td>10"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>12"</td> <td>.20</td> <td>4</td> </tr> <tr> <td>16"</td> <td>.18</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .22 | 5 | 10" | .21 | 5 | 12" | .20 | 4 | 16" | .18 | 4 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .28 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .26 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .22 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .20 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.22</td> <td>5</td> </tr> <tr> <td>10"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>12"</td> <td>.18</td> <td>4</td> </tr> <tr> <td>16"</td> <td>.15</td> <td>3</td> </tr> </tbody> </table> | S | K | T | 8" | .22 | 5 | 10" | .21 | 5 | 12" | .18 | 4 | 16" | .15 | 3 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.17</td> <td>4</td> </tr> <tr> <td>10"</td> <td>.17</td> <td>3</td> </tr> <tr> <td>12"</td> <td>.15</td> <td>3</td> </tr> <tr> <td>16"</td> <td>.13</td> <td>2</td> </tr> </tbody> </table> | S | K | T | 8" | .17 | 4 | 10" | .17 | 3 | 12" | .15 | 3 | 16" | .13 | 2 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .22 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .17 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .17 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .13 | 2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| WALLS - BRICK 1" INSULATION & PLASTER | | WALLS - BRICK 2" INSULATION & PLASTER | | | | | |
|--|-----|--|---|--|-----|-----|---|
|  | S | K | T |  | S | K | T |
| | 8" | .15 | 3 | | 8" | .11 | 2 |
| | 12" | .13 | 2 | | 12" | .10 | 1 |
| | 16" | .12 | 2 | | 16" | .09 | 1 |
| WALLS - CONCRETE 1" INSULATION & PLASTER | | WALLS - CONCRETE 2" INSULATION & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | 8" | .16 | 3 | | 8" | .11 | 2 |
| | 10" | .16 | 3 | | 10" | .11 | 2 |
| | 12" | .15 | 3 | | 12" | .11 | 2 |
| | 16" | .14 | 3 | | 16" | .10 | 1 |
| WALLS - HOLLOW TILE 1" INSULATION & PLASTER | | WALLS - HOLLOW TILE 2" INSULATION & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | 8" | .14 | 3 | | 8" | .10 | 1 |
| | 10" | .13 | 2 | | 10" | .10 | 1 |
| | 12" | .12 | 2 | | 12" | .09 | 1 |
| | 16" | .11 | 2 | | 16" | .08 | 1 |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No.(pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

| WALLS - FRAME CORRUGATED OR FLAT IRON ON STUDS | | WALLS - FRAME CLAPBOARDS, 1" SHEATHING, STUDS, LATH & PLASTER | | | | | |
|--|---|---|----|--|---|-----|---|
|  | S | K | T |  | S | K | T |
| | | .15 | 17 | | | .26 | 6 |
| | | | | | | | |
| WALLS - FRAME CORRUGATED OR FLAT IRON, 1" SHEATHING ON STUDS | | WALLS - FRAME BRICK VENEER, 1" SHEATHING, STUDS, LATH & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | | .78 | 15 | | | .25 | 6 |
| | | | | | | | |
| WALLS - FRAME STUCCO, 1" SHEATHING, STUDS, LATH & PLASTER | | WALLS - FRAME STUCCO, 1" SHEATHING, STUDS, 1/2" INSULATION, PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | | .30 | 7 | | | .22 | 5 |
| | | | | | | | |


BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No.(pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA


WALLS-FRAME
STUCCO, 1" SHEATHING,
STUDS, 1" INSULATION, PLASTER



| S | K | T |
|---|-----|---|
| | .17 | 3 |
| | | |
| | | |

(25)


DOORS, WINDOWS & SKYLIGHTS
SINGLE GLASS



| S | K | T |
|---|------|----|
| | 1.13 | 16 |
| | | |
| | | |

(28)


WALLS-FRAME
STUCCO, 1" SHEATHING,
STUDS, 2" INSULATION, PLASTER



| S | K | T |
|---|-----|---|
| 3 | .10 | 1 |
| | | |
| | | |

(26)


DOORS, WINDOWS & SKYLIGHTS
DOUBLE GLASS



| S | K | T |
|---|-----|----|
| | .45 | 12 |
| | | |
| | | |

(29)


WALLS-INTERIOR
STUDS, LATH & PLASTER, 1 SIDE



| S | K | T |
|---|-----|---|
| | .10 | 1 |
| | | |
| | | |

(27)

STUDS, L & P, 2 SIDES



| S | K | T |
|---|-----|---|
| | .10 | 1 |
| | | |
| | | |

(27)

INFILTRATION

| | T |
|-----------------------------|----|
| PLAIN WINDOWS | 18 |
| WEATHERSTRIPPED WINDOWS | 11 |
| PLAIN RESIDENCE DOORS | 19 |
| WEATHERSTRIPPED DOORS | 18 |
| PLAIN STORE DOORS | 20 |
| WEATHERSTRIPPED STORE DOORS | 19 |

(30)


BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA


FLOORS
CONCRETE ON SOIL



| S | K | T |
|----|-----|----|
| 4" | .56 | 14 |
| 6" | .49 | 13 |

(31)


FLOORS & CEILINGS
1" SHEATHING ON JOISTS



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .44 | 30° | 4 |
| | 50° | 8 |

(34)


FLOORS
WOOD ON CONCRETE



| S | K | T |
|----|-----|----|
| 4" | .39 | 10 |
| 6" | .36 | 9 |

(32)


FLOORS & CEILINGS
1" SHEATHING ON JOISTS
LATH & PLASTER BELOW



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .27 | 30° | 2 |
| | 50° | 4 |

(35)


FLOORS
REINFORCED CONCRETE



| S | K | TEMP. DIFF. | T |
|----|-----|-------------|---|
| 4" | .51 | 30° | 5 |
| | | 50° | 9 |
| 6" | .45 | 30° | 4 |
| | | 50° | 8 |

(33)

FLOORS & CEILINGS
DOUBLE FLOORING
& PAPER ON JOISTS



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .34 | 30° | 3 |
| | 50° | 6 |







(36)

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| <p>FLOORS & CEILINGS DOUBLE FLOORING & PAPER LATH & PLASTER BELOW</p>  <table border="1" data-bbox="511 432 647 541"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.23</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>3</td> </tr> </tbody> </table> <p>(37)</p> | K | TEMP DIFF. | T | .23 | 30° | 1 | | 50° | 3 | <p>ROOFS SHINGLES ON WOOD STRIPS</p>  <table border="1" data-bbox="859 432 975 555"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.48</td> <td>13</td> </tr> </tbody> </table> <p>(40)</p> | S | K | T | | .48 | 13 |
|--|------------|------------|---|-----|-----|---|--|-----|---|---|---|---|---|--|-----|----|
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .23 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 3 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .48 | 13 | | | | | | | | | | | | | | |
| <p>FLOORS & CEILINGS DOUBLE FLOORING & PAPER $\frac{1}{2}$" INSULATION & PLASTER BELOW</p>  <table border="1" data-bbox="511 734 647 843"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.18</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>2</td> </tr> </tbody> </table> <p>(38)</p> | K | TEMP DIFF. | T | .18 | 30° | 1 | | 50° | 2 | <p>ROOFS SHINGLES ON WOOD STRIPS & $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="859 740 975 857"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.21</td> <td>5</td> </tr> </tbody> </table> <p>(41)</p> | S | K | T | | .21 | 5 |
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .18 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 2 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .21 | 5 | | | | | | | | | | | | | | |
| <p>FLOORS & CEILING DOUBLE FLOORING & PAPER 1" INSULATION & PLASTER BELOW</p>  <table border="1" data-bbox="511 1035 647 1145"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.11</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>1</td> </tr> </tbody> </table> <p>(39)</p> | K | TEMP DIFF. | T | .11 | 30° | 1 | | 50° | 1 | <p>ROOFS SHINGLES ON WOOD STRIPS & 1" INSULATION</p>  <table border="1" data-bbox="859 1042 975 1159"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.12</td> <td>2</td> </tr> </tbody> </table> <p>(42)</p> | S | K | T | | .12 | 2 |
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .11 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 1 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .12 | 2 | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING</p>  <table border="1" data-bbox="1246 439 1381 562"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.52</td> <td>13</td> </tr> </tbody> </table> <p>(43)</p> | S | K | T | | .52 | 13 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING</p>  <table border="1" data-bbox="1584 439 1719 562"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.55</td> <td>14</td> </tr> </tbody> </table> <p>(46)</p> | S | K | T | | .55 | 14 |
|--|-----|----|---|--|-----|----|---|---|---|---|--|-----|----|
| S | K | T | | | | | | | | | | | |
| | .52 | 13 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .55 | 14 | | | | | | | | | | | |
| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="1246 747 1381 871"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.22</td> <td>5</td> </tr> </tbody> </table> <p>(44)</p> | S | K | T | | .22 | 5 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="1584 747 1719 871"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.22</td> <td>5</td> </tr> </tbody> </table> <p>(47)</p> | S | K | T | | .22 | 5 |
| S | K | T | | | | | | | | | | | |
| | .22 | 5 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .22 | 5 | | | | | | | | | | | |
| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING 1" INSULATION</p>  <table border="1" data-bbox="1246 1049 1381 1173"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.16</td> <td>3</td> </tr> </tbody> </table> <p>(45)</p> | S | K | T | | .16 | 3 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING 1" INSULATION</p>  <table border="1" data-bbox="1584 1049 1719 1173"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.17</td> <td>3</td> </tr> </tbody> </table> <p>(48)</p> | S | K | T | | .17 | 3 |
| S | K | T | | | | | | | | | | | |
| | .16 | 3 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .17 | 3 | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL DIRECT READING RADIATION TABLES

| SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK | SQUARE FEET OF STEAM RADIATION REQUIRED | | | | | | | | | | SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK |
|--|---|----|----|----|----|----|----|----|-----|-----|--|
| | TABLE NO. | | | | | | | | | | |
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | |
| 5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 1 | 5 |
| 10 | 0 | 0 | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 10 |
| 15 | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 15 |
| 20 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 2 | 2 | 2 | 20 |
| 25 | 1 | 1 | 1 | 1 | 2 | 2 | 2 | 2 | 3 | 3 | 25 |
| 30 | 1 | 1 | 1 | 2 | 2 | 2 | 3 | 3 | 3 | 3 | 30 |
| 35 | 1 | 1 | 2 | 2 | 2 | 3 | 3 | 3 | 4 | 4 | 35 |
| 40 | 1 | 1 | 2 | 2 | 3 | 3 | 3 | 4 | 4 | 5 | 40 |
| 45 | 1 | 2 | 2 | 2 | 3 | 3 | 4 | 4 | 5 | 5 | 45 |
| 50 | 1 | 2 | 2 | 3 | 3 | 4 | 4 | 5 | 5 | 6 | 50 |
| 55 | 1 | 2 | 2 | 3 | 4 | 4 | 5 | 5 | 6 | 6 | 55 |
| 60 | 2 | 2 | 3 | 3 | 4 | 5 | 5 | 6 | 6 | 7 | 60 |
| 65 | 2 | 2 | 3 | 4 | 4 | 5 | 6 | 6 | 7 | 7 | 65 |
| 70 | 2 | 2 | 3 | 4 | 5 | 5 | 6 | 7 | 7 | 8 | 70 |
| 75 | 2 | 3 | 3 | 4 | 5 | 6 | 6 | 7 | 8 | 9 | 75 |
| 80 | 2 | 3 | 4 | 4 | 5 | 6 | 7 | 8 | 8 | 9 | 80 |
| 85 | 2 | 3 | 4 | 5 | 6 | 6 | 7 | 8 | 9 | 10 | 85 |
| 90 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 9 | 10 | 90 |
| 95 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 95 |
| 100 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 100 |
| 200 | 5 | 7 | 9 | 11 | 13 | 15 | 17 | 19 | 21 | 23 | 200 |
| 300 | 8 | 11 | 14 | 17 | 20 | 23 | 26 | 29 | 32 | 35 | 300 |
| 400 | 10 | 14 | 18 | 22 | 25 | 30 | 34 | 38 | 42 | 46 | 400 |
| 500 | 13 | 18 | 23 | 28 | 33 | 38 | 43 | 48 | 53 | 58 | 500 |
| 600 | 15 | 21 | 27 | 33 | 39 | 45 | 51 | 57 | 63 | 69 | 600 |
| 700 | 18 | 25 | 32 | 39 | 46 | 53 | 60 | 67 | 74 | 81 | 700 |
| 800 | 20 | 28 | 36 | 44 | 52 | 60 | 68 | 76 | 84 | 92 | 800 |
| 900 | 23 | 32 | 41 | 50 | 59 | 68 | 77 | 86 | 95 | 104 | 900 |
| 1000 | 25 | 35 | 45 | 55 | 65 | 75 | 85 | 95 | 105 | 115 | 1000 |

Above tables refer to diagrams pages 300-307.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL DIRECT READING RADIATION TABLES

| SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK | SQUARE FEET OF STEAM RADIATION REQUIRED | | | | | | | | | | | | | | | | | | | | SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK |
|--|---|-----|-----|-----|-----|-----|-----|-----|------|------|------|--|--|--|--|--|--|--|--|--|--|
| | TABLE NO. | | | | | | | | | | | | | | | | | | | | |
| | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | | | | | | | | | | | |
| 5 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 3 | 7 | 13 | 5 | | | | | | | | | | |
| 10 | 1 | 1 | 1 | 2 | 2 | 3 | 4 | 7 | 13 | 26 | 10 | | | | | | | | | | |
| 15 | 2 | 2 | 2 | 2 | 3 | 5 | 7 | 10 | 20 | 39 | 15 | | | | | | | | | | |
| 20 | 3 | 3 | 3 | 3 | 5 | 7 | 9 | 13 | 26 | 52 | 20 | | | | | | | | | | |
| 25 | 3 | 3 | 4 | 4 | 6 | 8 | 11 | 16 | 33 | 65 | 25 | | | | | | | | | | |
| 30 | 4 | 4 | 4 | 5 | 7 | 10 | 13 | 20 | 39 | 78 | 30 | | | | | | | | | | |
| 35 | 4 | 5 | 5 | 6 | 8 | 12 | 15 | 23 | 46 | 91 | 35 | | | | | | | | | | |
| 40 | 5 | 5 | 6 | 7 | 9 | 13 | 18 | 26 | 52 | 104 | 40 | | | | | | | | | | |
| 45 | 6 | 6 | 7 | 7 | 10 | 15 | 20 | 29 | 59 | 117 | 45 | | | | | | | | | | |
| 50 | 6 | 7 | 7 | 8 | 11 | 16 | 22 | 33 | 65 | 130 | 50 | | | | | | | | | | |
| 55 | 7 | 7 | 8 | 9 | 13 | 18 | 24 | 36 | 72 | 143 | 55 | | | | | | | | | | |
| 60 | 8 | 8 | 9 | 10 | 14 | 20 | 26 | 39 | 79 | 157 | 60 | | | | | | | | | | |
| 65 | 8 | 9 | 9 | 11 | 15 | 21 | 28 | 43 | 85 | 170 | 65 | | | | | | | | | | |
| 70 | 9 | 9 | 10 | 12 | 16 | 23 | 31 | 46 | 92 | 183 | 70 | | | | | | | | | | |
| 75 | 9 | 10 | 11 | 12 | 17 | 25 | 33 | 49 | 98 | 196 | 75 | | | | | | | | | | |
| 80 | 10 | 11 | 12 | 13 | 18 | 26 | 35 | 52 | 105 | 209 | 80 | | | | | | | | | | |
| 85 | 11 | 11 | 12 | 14 | 19 | 28 | 37 | 56 | 111 | 222 | 85 | | | | | | | | | | |
| 90 | 11 | 12 | 13 | 15 | 21 | 30 | 39 | 59 | 118 | 235 | 90 | | | | | | | | | | |
| 95 | 12 | 13 | 14 | 16 | 22 | 31 | 42 | 62 | 124 | 248 | 95 | | | | | | | | | | |
| 100 | 13 | 14 | 15 | 17 | 23 | 33 | 44 | 65 | 131 | 261 | 100 | | | | | | | | | | |
| 200 | 25 | 27 | 29 | 33 | 46 | 66 | 88 | 131 | 262 | 522 | 200 | | | | | | | | | | |
| 300 | 38 | 41 | 44 | 50 | 68 | 99 | 131 | 196 | 393 | 783 | 300 | | | | | | | | | | |
| 400 | 50 | 54 | 58 | 66 | 91 | 132 | 175 | 262 | 524 | 1044 | 400 | | | | | | | | | | |
| 500 | 63 | 68 | 73 | 83 | 114 | 165 | 219 | 327 | 655 | 1305 | 500 | | | | | | | | | | |
| 600 | 75 | 81 | 87 | 99 | 137 | 197 | 263 | 392 | 785 | 1565 | 600 | | | | | | | | | | |
| 700 | 88 | 95 | 102 | 116 | 160 | 230 | 307 | 458 | 916 | 1826 | 700 | | | | | | | | | | |
| 800 | 100 | 108 | 116 | 132 | 182 | 263 | 350 | 523 | 1047 | 2087 | 800 | | | | | | | | | | |
| 900 | 113 | 122 | 131 | 149 | 205 | 296 | 394 | 589 | 1178 | 2348 | 900 | | | | | | | | | | |
| 1000 | 125 | 135 | 145 | 165 | 228 | 329 | 438 | 654 | 1309 | 2609 | 1000 | | | | | | | | | | |

Above tables refer to diagrams pages 300-307.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Conversion Factors for Various Temperatures and Wind Velocities

| Outside Temperature | Wind Velocities—Miles per Hour | | | | | |
|---------------------|--------------------------------|-----|-----|---------------------------|-----|-----|
| | Sides Exposed to Wind | | | Sides Not Exposed to Wind | | |
| | 15 | 20 | 30 | 15 | 20 | 30 |
| —30° | 1.7 | 2.2 | 3.3 | 1.5 | 1.9 | 2.9 |
| —20° | 1.6 | 2.1 | 3.1 | 1.4 | 1.8 | 2.7 |
| —15° | 1.4 | 1.9 | 2.9 | 1.3 | 1.7 | 2.5 |
| —10° | 1.3 | 1.8 | 2.6 | 1.2 | 1.5 | 2.3 |
| — 5° | 1.3 | 1.7 | 2.5 | 1.1 | 1.5 | 2.2 |
| — 0° | 1.2 | 1.6 | 2.3 | 1.0 | 1.4 | 2.0 |
| 5° | 1.1 | 1.4 | 2.2 | .95 | 1.3 | 1.9 |
| 10° | 1.0 | 1.3 | 2.0 | .85 | 1.2 | 1.7 |
| 15° | .90 | 1.2 | 1.8 | .80 | 1.1 | 1.6 |
| 20° | .80 | 1.1 | 1.7 | .70 | .95 | 1.5 |
| 25° | .75 | 1.0 | 1.5 | .65 | .85 | 1.3 |

The National Direct Reading Radiation Tables on Pages 308 and 309 are based on 15 mile wind velocity and outside temperature of 0° with an inside temperature of 70°. To correct for a different outside temperature and wind velocity the above conversion factors have been compiled. Multiplying the total radiation by the proper factor will give the amount of radiation needed for a locality where the wind velocity is more than 15 miles per hour and the outside temperature is other than 0.

NATIONAL ENGINEERING DATA

National *Made-to-Measure* Heating Factor

The amount of radiation required for a room is generally based on a room temperature of 70 degrees. Because this has been the practice, the National Direct Reading Radiation Tables are based on a 70 degree room temperature.

However, in line with the new vogue in heating and the desire to have temperatures other than 70 degrees in certain selected rooms, for certain personal reasons, the following National Made-to-Measure Factor Table has been computed.

| Room Temperature | Made-to-Measure Factor |
|------------------|------------------------|
| 60° | .80 |
| 65° | .90 |
| 68° | .96 |
| 70° | 1.00 |
| 72° | 1.04 |
| 74° | 1.09 |
| 76° | 1.13 |
| 78° | 1.18 |
| 80° | 1.23 |

To apply the above table, simply multiply the selected temperature factor by the square feet of radiation determined for 70 degrees.

NATIONAL ENGINEERING DATA

Climatic Conditions Compiled from
U. S. Weather Bureau Records

| State and City | | * Ave. Temp. Oct. 1 to May 1 | Lowest Temp. | * Ave. Wind Vel. | Direction of Prevailing Winds |
|----------------|----------------|--|-----------------|---------------------------|--|
| Ala. | Mobile | 57.7 | -1 | 8.3 | N |
| | Birmingham | 53.9 | -10 | 8.6 | N |
| Ariz. | Phoenix | 59.5 | 16 | 3.9 | E |
| | Flagstaff | 34.9 | -25 | 6.7 | SW |
| Ark. | Fort Smith | 49.5 | -15 | 8.0 | E |
| | Little Rock | 51.6 | -12 | 9.9 | NW |
| Cal. | San Francisco | 54.3 | 29 | | N |
| | Los Angeles | 58.6 | 28 | | NE |
| Colo. | Denver | 39.3 | -29 | 7.4 | S |
| | Grand Junction | 39.2 | -16 | 5.6 | SE |
| Conn. | New Haven | 38.0 | -14 | 9.3 | N |
| D. C. | Washington | 43.2 | -15 | 7.3 | NW |
| Fla. | Jacksonville | 61.9 | 10 | 8.2 | NE |
| Ga. | Atlanta | 51.4 | -8 | 11.8 | NW |
| | Savannah | 58.4 | 8 | 8.3 | NW |
| Idaho | Lewiston | 42.5 | -13 | 4.7 | E |
| | Pocatello | 36.4 | -20 | 9.3 | SE |
| Ill. | Chicago | 36.4 | -23 | 17.0 | SW |
| | Springfield | 39.9 | -24 | 10.2 | NW |
| Ind. | Indianapolis | 40.2 | -25 | 11.8 | S |
| | Evansville | 44.1 | -15 | 8.4 | S |
| Iowa | Dubuque | 33.9 | -32 | 6.1 | NW |
| | Sioux City | 32.1 | -35 | 12.2 | NW |
| Kans. | Concordia | 38.9 | -25 | 7.3 | N |
| | Dodge City | 40.2 | -26 | 10.4 | NW |
| Ky. | Louisville | 45.2 | -20 | 9.3 | SW |
| La. | New Orleans | 61.5 | 7 | 9.6 | N |
| | Shreveport | 56.2 | -5 | 7.7 | SE |
| Me. | Eastport | 31.1 | -23 | 13.8 | W |
| | Portland | 33.6 | -17 | 10.1 | NW |
| Md. | Baltimore | 43.6 | -7 | 7.2 | NW |
| Mass. | Boston | 37.6 | -13 | 11.7 | W |
| Mich. | Alpena | 29.1 | -27 | 11.3 | W |
| | Detroit | 35.4 | -24 | 13.1 | SW |
| | Marquette | 27.6 | -27 | 11.4 | NW |
| Minn. | Duluth | 25.1 | -41 | 11.1 | SW |
| | Minneapolis | 29.6 | -33 | 11.5 | NW |
| Miss. | Vicksburg | 56.0 | -1 | 7.6 | SE |
| Mo. | St. Joseph | 40.3 | -24 | 9.1 | NW |
| | St. Louis | 43.3 | -22 | 11.8 | NW |
| | Springfield | 43.0 | -29 | 11.3 | SE |
| Mont. | Billings | 34.7 | -49 | | W |
| | Havre | 27.7 | -57 | 8.7 | SW |
| Nebr. | Lincoln | 37.0 | -29 | 10.9 | N |
| | North Platte | 34.6 | -35 | 9.0 | W |

*Average temperatures and wind velocities. Heating plants are designed for more extreme conditions.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Climatic Conditions (continued)

| State and City | | * Ave. Temp. Oct. 1 to May 1 | Lowest Temp. | * Ave. Wind Vel. | Direction of Prevailing Winds |
|----------------|----------------|--|-----------------|---------------------------|--|
| Nev. | Tonopah | 39.6 | -7 | 9.9 | SE |
| | Winnemucca | 37.9 | -28 | 9.5 | NE |
| N. H. | Concord | 33.4 | -35 | 6.0 | NW |
| N. J. | Atlantic City | 41.6 | -7 | 10.6 | NW |
| N. Y. | Albany | 55.1 | -24 | 7.9 | S |
| | Buffalo | 34.7 | -14 | 17.7 | W |
| | New York | 40.3 | -6 | 13.3 | NW |
| N. M. | Santa Fe | 38.0 | -13 | 7.3 | NE |
| N. C. | Raleigh | 49.7 | -2 | 7.3 | SW |
| | Wilmington | 53.1 | 5 | 8.9 | SW |
| N. D. | Bismark | 24.5 | -45 | | NW |
| | Devil's Lake | 18.9 | -44 | 11.4 | W |
| Ohio | Cleveland | 36.9 | -17 | 14.5 | SW |
| | Columbus | 39.9 | -20 | 9.3 | SW |
| Okla. | Oklahoma City | 48.0 | -17 | 12.0 | N |
| Ore. | Baker | 34.1 | -20 | 6.0 | SE |
| | Portland | 45.9 | -2 | 6.5 | S |
| Pa. | Philadelphia | 41.9 | -6 | 11.0 | NW |
| | Pittsburgh | 40.8 | -20 | 13.7 | NW |
| R. I. | Providence | 37.6 | -9 | 14.6 | NW |
| S. C. | Charleston | 56.9 | 7 | 11.0 | N |
| | Columbia | 53.7 | -2 | 8.0 | NE |
| S. D. | Huron | 28.1 | -43 | 11.5 | NW |
| | Rapid City | 32.3 | -34 | 7.5 | W |
| Tenn. | Knoxville | 47.0 | -16 | 6.5 | SW |
| | Memphis | 50.9 | -9 | 9.6 | NW |
| Texas | El Paso | 53.0 | -2 | 10.5 | NW |
| | Fort Worth | 54.7 | -8 | 11.0 | NW |
| | San Antonio | 60.7 | 4 | 8.2 | N |
| Utah | Modena | 38.1 | -24 | 8.9 | W |
| | Salt Lake City | 40.0 | -20 | 4.9 | SE |
| Vt. | Burlington | 29.3 | -27 | 12.9 | S |
| Va. | Norfolk | 49.1 | 2 | 9.0 | N |
| | Lynchburg | 45.2 | -7 | 5.2 | NW |
| | Richmond | 47.4 | -3 | 7.4 | S |
| Wash. | Seattle | 45.3 | 3 | 9.1 | SE |
| | Spokane | 37.5 | -30 | | SW |
| W. Va. | Elkins | 38.9 | -21 | 4.8 | W |
| | Parkersburg | 41.9 | -27 | 6.6 | S |
| Wisc. | Green Bay | 28.6 | -36 | 12.8 | SW |
| | La Crosse | 31.2 | -43 | 5.6 | NW |
| | Milwaukee | 33.0 | -25 | 11.7 | W |
| Wyo. | Sheridan | 31.0 | -45 | 5.3 | NW |
| | Lander | 28.9 | -36 | 3.0 | NE |

*Average temperatures and wind velocities. Heating plants are designed for more extreme conditions.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Application of the National *Made-To-Measure* Method

The application of National Direct Reading Radiation Diagrams and Tables will be readily understood from the example of a typical room shown in plan below (Diagram No. 49). Desired room temperature 72°.

As shown on the plan, the room is 15' x 18', with 9' ceiling. Two weather-stripped windows, each 3' x 6', in north wall; and one 3' x 7' door, not weatherstripped, in west wall.

Wall construction is 8" brick, furred, lathed and plastered. Adjacent rooms are heated, so no heat loss need be considered through partitions, ceiling or floor.

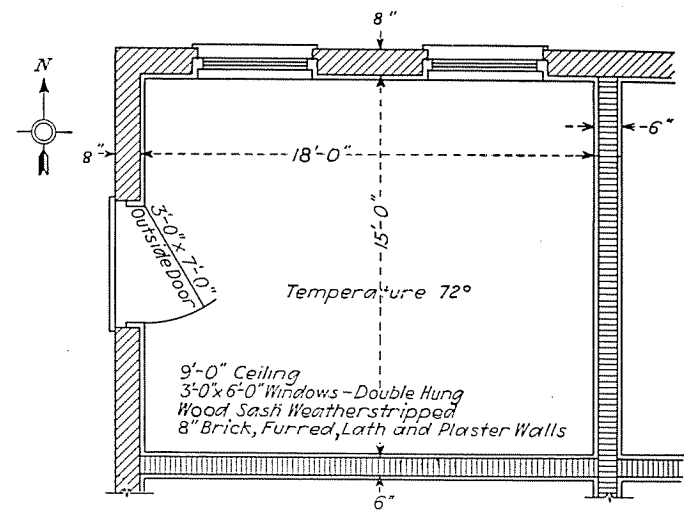


Diagram No. 49



NATIONAL ENGINEERING DATA

Application of the National *Made-To-Measure* Method (continued)

First compute the north wall and total window area;

$$18 \times 9 = 162 \text{ square feet of wall}$$

$$2 \times 3 \times 6 = 36 \text{ square feet of window}$$

$$\text{subtracting,} = 126 \text{ square feet of net brick wall construction}$$

Diagram No. 7, Page 301, covers brick wall, furring, lath and plaster. From this diagram it is seen that an 8" wall (column "S") indicates (in column "T") Table No. 6 (on page 308). Reading across from either column headed "square feet of surface" it will be noted that 100 square feet of surface in Table 6 calls for 8 square feet of steam radiation. Likewise 25 (the figure nearest 26) square feet of surface calls for 2 square feet of steam radiation, making a total of 10 square feet of radiation for 126 square feet of wall surface.

Diagram No. 28, Page 304, covers windows with single glass. From this diagram it is seen that Table 16, (page 309) is indicated. 35 square feet of surface (the figure nearest 36) calls for 12 square feet of steam radiation.

The lineal feet of infiltration is the distance around each window plus the crack in the meeting rail $(6 + 6 + 3 + 3 + 3) = 21$. For the two windows the total length of crack is 42 feet. Diagram No. 30, page 304, covers infiltration. From this diagram

Application of the National *Made-To-Measure* Method (continued)

it is seen that Table 11 (page 309) is indicated for weather stripped windows. Reading across from 40 (the figure nearest 42) 5 square feet of steam radiation is called for.

The total radiation for the north wall is 27 square feet, made up as follows:

| | | | |
|--------------------|----------------|---|---|
| Brick wall surface | 10 square feet | | |
| Window surface | 12 | " | " |
| Infiltration | 5 | " | " |
| Total | 27 | " | " |

In like manner, the west wall and door area are computed as follows:

| | | | |
|--------------|--------------------------------|--------------------------|-----------------|
| Wall | $15 \times 9 = 135$ | | |
| Door | $3 \times 7 = 21$ | = Diagram 28, Table 16 = | 7 sq. ft. rad. |
| Net wall | 114 | Diagram 7, Table 6 = | 9 sq. ft. rad. |
| Infiltration | $7 \times 2 + 3 \times 2 = 20$ | = Diagram 30, Table 19 = | 26 sq. ft. rad. |
| | | TOTAL AREA | 42 sq. ft. rad. |

Summarizing, total radiation required for north wall = 27 square feet
 total radiation required for west wall = 42 square feet
 Total square feet of steam radiation for 70° room = 69 square feet
 temperature, 0° outside temperature

Since, in this case, an inside temperature of 72° is to be maintained, the factor 1.04 as shown on page 311 must be considered. Therefore, the full amount of steam radiation required is 69×1.04 , or 72 square feet.

This installation is to be a National Made-to-Measure Hot Water System in place of steam. The total of 72

Application of the National *Made-To-Measure* Method (continued)

square feet is, therefore, to be increased 60%, making 115 square feet of Hot Water Radiation.

This problem assumes an outside temperature of 0° and a wind velocity of 15 miles per hour, the conditions on which National Direct-Reading Radiation Tables are based. The conversion factors on page 310, therefore, need not be considered. If the outside temperature were -10° and the wind velocity 20 miles per hour, the total radiation shown above would be multiplied by 1.5 for sides not exposed and 1.8 for sides exposed.

Selection of the Proper Radiator

This may readily be done by following the instructions on pages 318 and 319.

It is probable, in this example, that the radiator location selected would be against the north wall and below the windows; also that radiators 26" high will be used.

Since the total required radiation is 115 square feet, two radiators will be needed, each of $57\frac{1}{2}$ square feet capacity.

Referring to the Radiation Chart on page 323, it is seen that a 16-section 5-tube radiator 26" high has a capacity of 56 square feet, which is close enough for the purpose. Since this radiator is 40" long, and will extend but 2" on each side of the window opening, it may be considered satisfactory.



How to Select the Proper Type and Size of Radiation

The following charts show the number of square feet of National Aero Radiation in various lengths, widths and heights. Their use will facilitate determining the dimensions of a radiator that will conform to a given space and provide the desired number of square feet of radiation.

The procedure is simple.

1. Determine the number of square feet of radiation required for a given room.
2. Select desired location of radiators after considering exposure, and wall space required for furniture.
3. Decide the number of radiators required.
4. Decide the dimension or dimensions of the radiator which are limited by the space available. For example, suppose the height must not exceed 27 inches, the length 44 inches, and that the radiation must be not less than 40 square feet.



5. Refer to the radiation charts. Chart No. 1 "G" covers radiators 26 inches high—these are nearest to the permitted height.

6. Locate the desired length in column "B". At the point of intersection between the height group selected, and the length desired, you will find the number of square feet of radiation available in radiators with various numbers of tubes. In the case above, you will have a choice of:

(A.) a 3-tube, $42\frac{1}{2}$ inches long, with $39\frac{3}{4}$ sq. ft. of radiation.

(B.) a 4-tube, $37\frac{1}{2}$ inches long, with $41\frac{1}{4}$ sq. ft. of radiation.

(C.) a 5-tube, 30 inches long, with 42 sq. ft. of radiation.

(D.) a 6-tube, 25 inches long, with 40 sq. ft. of radiation.

(E.) a 7-tube, $22\frac{1}{2}$ inches long, with $42\frac{3}{4}$ sq. ft. of radiation.

7. Choose from these various possibilities the proportions that will present the most pleasing appearance.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1

| A Number of Sections | B Radiator Length in Inches | C | | D | |
|-------------------------|--------------------------------|-----------|-----|-----------|--|
| | | 13½" | | 16½" | |
| | | No. Tubes | | No. Tubes | |
| | | 7 | | 7 | |
| | | Sq. Ft. | | Sq. Ft. | |
| 1 | 2½ | 2½ | 3 | | |
| 2 | 5 | 5 | 6 | | |
| 3 | 7½ | 7½ | 9 | | |
| 4 | 10 | 10 | 12 | | |
| 5 | 12½ | 12½ | 15 | | |
| 6 | 15 | 15 | 18 | | |
| 7 | 17½ | 17½ | 21 | | |
| 8 | 20 | 20 | 24 | | |
| 9 | 22½ | 22½ | 27 | | |
| 10 | 25 | 25 | 30 | | |
| 11 | 27½ | 27½ | 33 | | |
| 12 | 30 | 30 | 36 | | |
| 13 | 32½ | 32½ | 39 | | |
| 14 | 35 | 35 | 42 | | |
| 15 | 37½ | 37½ | 45 | | |
| 16 | 40 | 40 | 48 | | |
| 17 | 42½ | 42½ | 51 | | |
| 18 | 45 | 45 | 54 | | |
| 19 | 47½ | 47½ | 57 | | |
| 20 | 50 | 50 | 60 | | |
| 21 | 52½ | 52½ | 63 | | |
| 22 | 55 | 55 | 66 | | |
| 23 | 57½ | 57½ | 69 | | |
| 24 | 60 | 60 | 72 | | |
| 25 | 62½ | 62½ | 75 | | |
| 26 | 65 | 65 | 78 | | |
| 27 | 67½ | 67½ | 81 | | |
| 28 | 70 | 70 | 84 | | |
| 29 | 72½ | 72½ | 87 | | |
| 30 | 75 | 75 | 90 | | |
| Width of Sections | | 12" | 12" | | |

*Height of Radiators.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| A Number of Sections | B Radiator Length in Inches | E 20" High Radiators | | | | |
|-------------------------|--------------------------------|-------------------------|--------------------|--------------------|---------|---------|
| | | No. of Tubes | | | | |
| | | 3 | 4 | 5 | 6 | 7 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 1¾ | 2¼ | 2⅔ | 3 | 3⅔ |
| 2 | 5 | 3½ | 4½ | 5⅓ | 6 | 7⅓ |
| 3 | 7½ | 5¼ | 6¾ | 8 | 9 | 11 |
| 4 | 10 | 7 | 9 | 10⅔ | 12 | 14⅔ |
| 5 | 12½ | 8¾ | 11¼ | 13⅓ | 15 | 18⅓ |
| 6 | 15 | 10½ | 13½ | 16 | 18 | 22 |
| 7 | 17½ | 12¼ | 15¾ | 18⅔ | 21 | 25⅔ |
| 8 | 20 | 14 | 18 | 21⅓ | 24 | 29⅓ |
| 9 | 22½ | 15¾ | 20¼ | 24 | 27 | 33 |
| 10 | 25 | 17½ | 22½ | 26⅔ | 30 | 36⅔ |
| 11 | 27½ | 19¼ | 24¾ | 29⅓ | 33 | 40⅓ |
| 12 | 30 | 21 | 27 | 32 | 36 | 44 |
| 13 | 32½ | 22¾ | 29¼ | 34⅔ | 39 | 47⅔ |
| 14 | 35 | 24½ | 31½ | 37⅓ | 42 | 51⅓ |
| 15 | 37½ | 26¼ | 33¾ | 40 | 45 | 55 |
| 16 | 40 | 28 | 36 | 42⅔ | 48 | 58⅔ |
| 17 | 42½ | 29¾ | 38¼ | 45⅓ | 51 | 62⅓ |
| 18 | 45 | 31½ | 40½ | 48 | 54 | 66 |
| 19 | 47½ | 33¼ | 42¾ | 50⅔ | 57 | 69⅔ |
| 20 | 50 | 35 | 45 | 53⅓ | 60 | 73⅓ |
| 21 | 52½ | 36¾ | 47¼ | 56 | 63 | 77 |
| 22 | 55 | 38½ | 49½ | 58⅔ | 66 | 80⅔ |
| 23 | 57½ | 40¼ | 51¾ | 61⅓ | 69 | 84⅓ |
| 24 | 60 | 42 | 54 | 64 | 72 | 88 |
| 25 | 62½ | 43¾ | 56¼ | 66⅔ | 75 | 91⅔ |
| 26 | 65 | 45½ | 58½ | 69⅓ | 78 | 95⅓ |
| 27 | 67½ | 47¼ | 60¾ | 72 | 81 | 99 |
| 28 | 70 | 49 | 63 | 74⅔ | 84 | 102⅔ |
| 29 | 72½ | 50¾ | 65¼ | 77⅓ | 87 | 106⅓ |
| 30 | 75 | 52½ | 67½ | 80 | 90 | 110 |
| Width of Sections | | 5⅛" | 6⅓ ₁₆ " | 8⅓ ₃₂ " | 9" | 12" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 23" High Radiators | | | |
|--------------------|---------------------------|--------------------|-----------------------------------|-----------------------------------|---------|
| | | No. of Tubes | | | |
| | | 3 | 4 | 5 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 2 | 2½ | 3 | 3½ |
| 2 | 5 | 4 | 5 | 6 | 7 |
| 3 | 7½ | 6 | 7½ | 9 | 10½ |
| 4 | 10 | 8 | 10 | 12 | 14 |
| 5 | 12½ | 10 | 12½ | 15 | 17½ |
| 6 | 15 | 12 | 15 | 18 | 21 |
| 7 | 17½ | 14 | 17½ | 21 | 24½ |
| 8 | 20 | 16 | 20 | 24 | 28 |
| 9 | 22½ | 18 | 22½ | 27 | 31½ |
| 10 | 25 | 20 | 25 | 30 | 35 |
| 11 | 27½ | 22 | 27½ | 33 | 38½ |
| 12 | 30 | 24 | 30 | 36 | 42 |
| 13 | 32½ | 26 | 32½ | 39 | 45½ |
| 14 | 35 | 28 | 35 | 42 | 49 |
| 15 | 37½ | 30 | 37½ | 45 | 52½ |
| 16 | 40 | 32 | 40 | 48 | 56 |
| 17 | 42½ | 34 | 42½ | 51 | 59½ |
| 18 | 45 | 36 | 45 | 54 | 63 |
| 19 | 47½ | 38 | 47½ | 57 | 66½ |
| 20 | 50 | 40 | 50 | 60 | 70 |
| 21 | 52½ | 42 | 52½ | 63 | 73½ |
| 22 | 55 | 44 | 55 | 66 | 77 |
| 23 | 57½ | 46 | 57½ | 69 | 80½ |
| 24 | 60 | 48 | 60 | 72 | 84 |
| 25 | 62½ | 50 | 62½ | 75 | 87½ |
| 26 | 65 | 52 | 65 | 78 | 91 |
| 27 | 67½ | 54 | 67½ | 81 | 94½ |
| 28 | 70 | 56 | 70 | 84 | 98 |
| 29 | 72½ | 58 | 72½ | 87 | 101½ |
| 30 | 75 | 60 | 75 | 90 | 105 |
| Width of Sections | | 5½" | 6 ¹³ / ₁₆ " | 8 ¹³ / ₃₂ " | 9" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 26" High Radiators | | | | |
|--------------------|---------------------------|--------------------|-----------------------------------|-----------------------------------|---------|---------|
| | | No. of Tubes | | | | |
| | | 3 | 4 | 5 | 6 | 7 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 2½ | 2¾ | 3½ | 4 | 4¾ |
| 2 | 5 | 4¾ | 5½ | 7 | 8 | 9½ |
| 3 | 7½ | 7 | 8¼ | 10½ | 12 | 14¼ |
| 4 | 10 | 9½ | 11 | 14 | 16 | 19 |
| 5 | 12½ | 11¾ | 13¾ | 17½ | 20 | 23¾ |
| 6 | 15 | 14 | 16½ | 21 | 24 | 28½ |
| 7 | 17½ | 16½ | 19¼ | 24½ | 28 | 33¼ |
| 8 | 20 | 18¾ | 22 | 28 | 32 | 38 |
| 9 | 22½ | 21 | 24¾ | 31½ | 36 | 42¾ |
| 10 | 25 | 23½ | 27½ | 35 | 40 | 47½ |
| 11 | 27½ | 25¾ | 30¼ | 38½ | 44 | 52¼ |
| 12 | 30 | 28 | 33 | 42 | 48 | 57 |
| 13 | 32½ | 30½ | 35¾ | 45½ | 52 | 61¾ |
| 14 | 35 | 32¾ | 38½ | 49 | 56 | 66½ |
| 15 | 37½ | 35 | 41¼ | 52½ | 60 | 71¼ |
| 16 | 40 | 37½ | 44 | 56 | 64 | 76 |
| 17 | 42½ | 39¾ | 46¾ | 59½ | 68 | 80¾ |
| 18 | 45 | 42 | 49½ | 63 | 72 | 85½ |
| 19 | 47½ | 44½ | 52¼ | 66½ | 76 | 90¼ |
| 20 | 50 | 46¾ | 55 | 70 | 80 | 95 |
| 21 | 52½ | 49 | 57¾ | 73½ | 84 | 99¾ |
| 22 | 55 | 51½ | 60½ | 77 | 88 | 104½ |
| 23 | 57½ | 53¾ | 63¼ | 80½ | 92 | 109¼ |
| 24 | 60 | 56 | 66 | 84 | 96 | 114 |
| 25 | 62½ | 58½ | 68¾ | 87½ | 100 | 118¾ |
| 26 | 65 | 60¾ | 71½ | 91 | 104 | 123½ |
| 27 | 67½ | 63 | 74¼ | 94½ | 108 | 128¼ |
| 28 | 70 | 65½ | 77 | 98 | 112 | 133 |
| 29 | 72½ | 67¾ | 79¾ | 101½ | 116 | 137¾ |
| 30 | 75 | 70 | 82½ | 105 | 120 | 142½ |
| Width of Sections | | 5½" | 6 ¹³ / ₁₆ " | 8 ¹³ / ₃₂ " | 9" | 12" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 30" High Radiators | | | | 32"* |
|--------------------|---------------------------|--------------------|---------|---------|---------|-----------|
| | | No. of Tubes | | | | No. Tubes |
| | | 3 | 4 | 5 | 7 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 3 | 3½ | 4½ | 5½ | 5 |
| 2 | 5 | 6 | 7 | 8½ | 11 | 10 |
| 3 | 7½ | 9 | 10½ | 13 | 16½ | 15 |
| 4 | 10 | 12 | 14 | 17½ | 22 | 20 |
| 5 | 12½ | 15 | 17½ | 21½ | 27½ | 25 |
| 6 | 15 | 18 | 21 | 26 | 33 | 30 |
| 7 | 17½ | 21 | 24½ | 30½ | 38½ | 35 |
| 8 | 20 | 24 | 28 | 34½ | 44 | 40 |
| 9 | 22½ | 27 | 31½ | 39 | 49½ | 45 |
| 10 | 25 | 30 | 35 | 43½ | 55 | 50 |
| 11 | 27½ | 33 | 38½ | 47½ | 60½ | 55 |
| 12 | 30 | 36 | 42 | 52 | 66 | 60 |
| 13 | 32½ | 39 | 45½ | 56½ | 71½ | 65 |
| 14 | 35 | 42 | 49 | 60½ | 77 | 70 |
| 15 | 37½ | 45 | 52½ | 65 | 82½ | 75 |
| 16 | 40 | 48 | 56 | 69½ | 88 | 80 |
| 17 | 42½ | 51 | 59½ | 73½ | 93½ | 85 |
| 18 | 45 | 54 | 63 | 78 | 99 | 90 |
| 19 | 47½ | 57 | 66½ | 82½ | 104½ | 95 |
| 20 | 50 | 60 | 70 | 86½ | 110 | 100 |
| 21 | 52½ | 63 | 73½ | 91 | 115½ | 105 |
| 22 | 55 | 66 | 77 | 95½ | 121 | 110 |
| 23 | 57½ | 69 | 80½ | 99½ | 126½ | 115 |
| 24 | 60 | 72 | 84 | 104 | 132 | 120 |
| 25 | 62½ | 75 | 87½ | 108½ | 137½ | 125 |
| 26 | 65 | 78 | 91 | 112½ | 143 | 130 |
| 27 | 67½ | 81 | 94½ | 117 | 148½ | 135 |
| 28 | 70 | 84 | 98 | 121½ | 154 | 140 |
| 29 | 72½ | 87 | 101½ | 125½ | 159½ | 145 |
| 30 | 75 | 90 | 105 | 130 | 165 | 150 |
| Width of Sections | | 5½" | 6½" | 8½" | 12" | 9" |

*Height of Radiators.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 36" High Radiators | | | | 38"* |
|--------------------|---------------------------|--------------------|---------|---------|---------|-----------|
| | | No. of Tubes | | | | No. Tubes |
| | | 3 | 4 | 5 | 7 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 3½ | 4½ | 5 | 6¾ | 6 |
| 2 | 5 | 7 | 8½ | 10 | 13½ | 12 |
| 3 | 7½ | 10½ | 12¾ | 15 | 20¼ | 18 |
| 4 | 10 | 14 | 17 | 20 | 27 | 24 |
| 5 | 12½ | 17½ | 21¼ | 25 | 33¾ | 30 |
| 6 | 15 | 21 | 25½ | 30 | 40½ | 36 |
| 7 | 17½ | 24½ | 29¾ | 35 | 47¼ | 42 |
| 8 | 20 | 28 | 34 | 40 | 54 | 48 |
| 9 | 22½ | 31½ | 38¼ | 45 | 60¾ | 54 |
| 10 | 25 | 35 | 42½ | 50 | 67½ | 60 |
| 11 | 27½ | 38½ | 46¾ | 55 | 74¼ | 66 |
| 12 | 30 | 42 | 51 | 60 | 81 | 72 |
| 13 | 32½ | 45½ | 55¼ | 65 | 87¾ | 78 |
| 14 | 35 | 49 | 59½ | 70 | 94½ | 84 |
| 15 | 37½ | 52½ | 63¾ | 75 | 101¼ | 90 |
| 16 | 40 | 56 | 68 | 80 | 108 | 96 |
| 17 | 42½ | 59½ | 72¼ | 85 | 114¾ | 102 |
| 18 | 45 | 63 | 76½ | 90 | 121½ | 108 |
| 19 | 47½ | 66½ | 80¾ | 95 | 128¼ | 114 |
| 20 | 50 | 70 | 85 | 100 | 135 | 120 |
| 21 | 52½ | 73½ | 89¼ | 105 | 141¾ | 126 |
| 22 | 55 | 77 | 93½ | 110 | 148½ | 132 |
| 23 | 57½ | 80½ | 97¾ | 115 | 155¼ | 138 |
| 24 | 60 | 84 | 102 | 120 | 162 | 144 |
| 25 | 62½ | 87½ | 106¼ | 125 | 168¾ | 150 |
| 26 | 65 | 91 | 110½ | 130 | 175½ | 156 |
| 27 | 67½ | 94½ | 114¾ | 135 | 182¼ | 162 |
| 28 | 70 | 98 | 119 | 140 | 189 | 168 |
| 29 | 72½ | 101½ | 123¼ | 145 | 195¾ | 174 |
| 30 | 75 | 105 | 127½ | 150 | 202½ | 180 |
| Width of Sections | | 5½" | 6½" | 8½" | 12" | 9" |

*Height of Radiators.



NATIONAL ENGINEERING DATA

Proving Temperature Guarantees in Warm Weather

National Heating Specialists may prove temperature guarantees during warm weather by using the following table prepared by R. C. Carpenter. It is arranged on the basis of proving a 70° house temperature guarantee.

| Outside Temperature at Time of Test | Inside Temperature at Time of Test | Outside Temperature at Time of Test | Inside Temperature at Time of Test |
|-------------------------------------|------------------------------------|-------------------------------------|------------------------------------|
| -10 | 64.7 | 35 | 89.8 |
| - 7.5 | 66.0 | 37.5 | 91.5 |
| - 5 | 67.3 | 40 | 93.1 |
| - 2.5 | 68.7 | 42.5 | 94.5 |
| 0 | 70 | 45 | 95.9 |
| 2.5 | 71.3 | 47.5 | 97.3 |
| 5 | 72.6 | 50 | 98.7 |
| 7.5 | 73.9 | 52.5 | 100.2 |
| 10 | 75.1 | 55 | 101.7 |
| 12.5 | 76.6 | 57.5 | 103.2 |
| 15 | 78 | 60 | 104.7 |
| 17.5 | 79.5 | 62.5 | 106.2 |
| 20 | 81 | 65 | 107.6 |
| 22.5 | 82.4 | 67.5 | 109.1 |
| 25 | 83.8 | 70 | 110.5 |
| 27.5 | 85.2 | 72.5 | 112.2 |
| 30 | 86.5 | 75 | 113.8 |
| 32.5 | 88.2 | 77.5 | 115.4 |
| | | 80 | 117.1 |

Heating tests made in warm weather should be conducted for a period not less than 24 hours.



NATIONAL ENGINEERING DATA

Selecting the Right Boiler for the Job

WHEN selecting a boiler, consideration should be given to the height of the boiler room, the location of inlet to the chimney and the draft intensity and fuel to be used.

If a steam or vapor heating system is to be installed, it is essential that a steam boiler be selected, the water line of which will be from 18 to 30 inches below the low point of the main to take care of the inequality in pressure in the system (see explanation, page 350). National Low Water Line Boilers are particularly well adapted for installation where headroom is at a premium.

If the draft intensity is below normal, a boiler should be selected which does not have an abnormally long fire travel. For instance, if a round boiler is to be installed under these conditions, it is advisable to select a boiler with sufficient rated capacity to carry the radiation and which has only one intermediate section.

If the opening to the chimney is low, and it is impossible to provide a new opening at a higher point, it is advisable to select a boiler, the smoke outlet of which is taken from the rear of the boiler instead of from the top, so that it will not be necessary to pitch the smoke pipe down, which is always bad practice.

If coke is to be used as fuel, a boiler with fire box at least 20" deep should be selected. If high volatile coal is to be used select a smokeless boiler.



NATIONAL ENGINEERING DATA

Radiator Heating Systems— Types and Applications

Generally speaking, there are six accepted types of radiator heating systems:

- (1) Hot water heating system closed—with or without tank.
- (2) Hot water heating system open—with tank.
- (3) One-Pipe Steam Heating System; same pipe carries steam to, and condensate from, the radiator.
- (4) Two-Pipe Steam Heating System; one pipe carries steam to radiator; other pipe carries condensate water from the radiator.
- (5) Vapor Heating System; similar to two-pipe steam system, but operates under very low pressure.
- (6) Vacuum Heating System; air is removed from radiators and piping, usually by means of a pump. System operates at below atmospheric pressure.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Hot Water Heating Systems

In hot water heating systems the boiler, radiators and pipes are kept filled with water. The expansion of water when heated sets up a circulation; consequently the warm water rises to the radiators, where the heat is given off. As the water cools, it returns to the boiler, being displaced in the radiator by the incoming hotter water.

Each pound of water in this system gives off one British Thermal Unit (usually written B. T. U., the unit of measurement of heat) for each degree the water cools.

Hot water heating systems differ from all other types of heating systems in that they depend on water to convey the heat from the boilers to the radiators. A hot water heating system consists of: the boiler, the main flow pipe and branches, the radiators, the return pipe and branches, and the expansion or pressure tank. (A relief valve is sometimes used on closed systems, instead of a tank.)

Since water expands when heated, it is necessary to provide for this expansion by attaching a tank or relief valve. The motive force which causes the water to circulate is very low, being equal only to the difference in the


NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

Hot Water Heating Systems (continued)

weight of the hotter water in the flow pipe and the weight of the cooler water in the return pipe.

A difference in temperature of 20 degrees produces a weight of less than one-half pound; consequently it is necessary to observe every precaution to reduce friction, avoid air pockets, provide an easy and free flow of water, and apportion the piping so that all radiators are equally supplied. In short, it is necessary to observe the utmost care in calculating pipe sizes (described later) so that the system will be "balanced", which is necessary for proper operation.


Hot water heating systems have been favorably looked upon because of their even heating qualities—that is, once the water is heated and in circulation, the radiators continue to give off warmth, even though the fire burns low. An added advantage is that in mild weather a light fire will keep the water in circulation at a temperature as low as 80° to 100°, thereby furnishing very mild warmth. The even heating qualities of hot water systems are further improved when automatic damper regulation is part of the equipment.

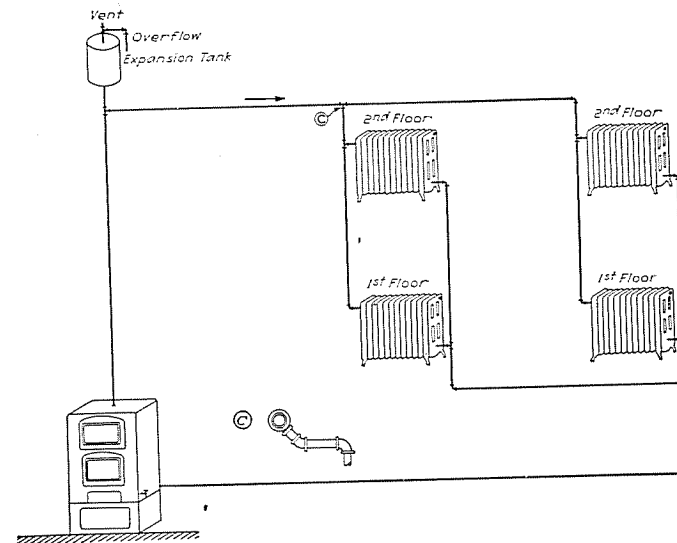

HOT WATER OPEN SYSTEM — 1 PIPE OVERHEAD

Hot Water Open System—
One-Pipe Overhead

ONE-PIPE overhead hot water open systems are used in buildings where there is limited cellar space and in installations where the boiler is placed on the same floor level as the lowest radiators. The supply main is then run to the roof space, and drop risers taken from this main to the radiators. An air valve is placed on high point of main, if the expansion tank is not located so that air will vent freely through the tank.

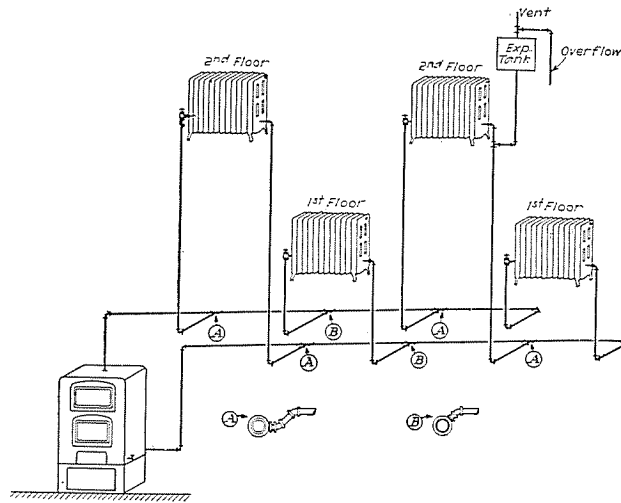


HOT WATER OPEN SYSTEM—2 PIPE UPFEED
SHOWING SEPARATE SETS OF RISERS TO EACH RADIATOR

Hot Water Open System—Two-Pipe Upfeed

TWO-PIPE upfeed hot water systems are used in most normal situations. They consist of a main feed pipe supplying hot water to radiators and a return main pipe which returns the cooler water to the boiler for re-heating. Air valves are placed on all radiators at the top of the return end.

These two diagrams show two methods of piping the radiators for an open hot water system.


Note that in these, and the other diagrams of Hot Water Heating Systems, recommended connections are shown, designated by a letter. The points at which these connections should be installed are indicated by corresponding letters. Complete descriptions of the connections, and reasons for their use, are given on pages 336-337.

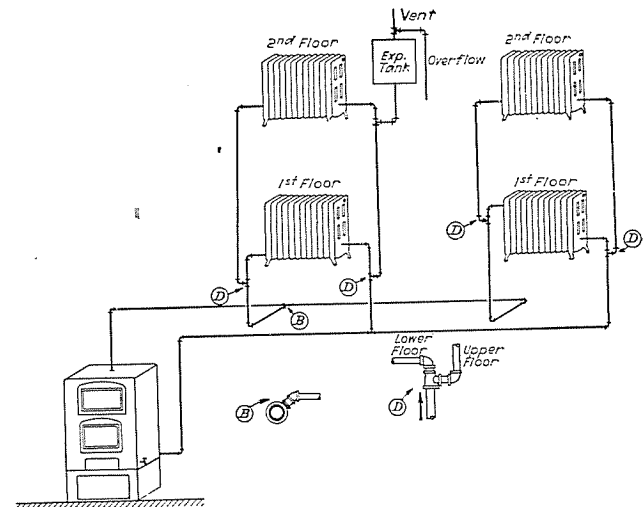

HOT WATER OPEN SYSTEM—2 PIPE UPFEED
SHOWING FIRST AND SECOND FLOOR RADIATORS CONNECTED TO THE SAME SUPPLY AND RETURN RISERS

Closed Hot Water Heating Systems

THE closed hot water heating system has no expansion tank open to the atmosphere. The entire system is so designed that the water has no access to the atmosphere except through a pressure relief valve. The purpose of such an arrangement is to provide a pressure (generally 10 pounds) greater than atmospheric pressure. The advantage of this pressure lies in the increased temperature secured before the boiling point is reached. Water at sea level atmospheric pressure boils at 212°, but at 10 pounds gauge pressure it does not boil until it reaches a temperature of 239.4°. This greater temperature provides greater heat for each pound of water. It permits installing smaller pipe sizes. The temperature of the hot water in radiators in a closed hot water heating system is generally higher than the temperature of the water in a gravity or open system.

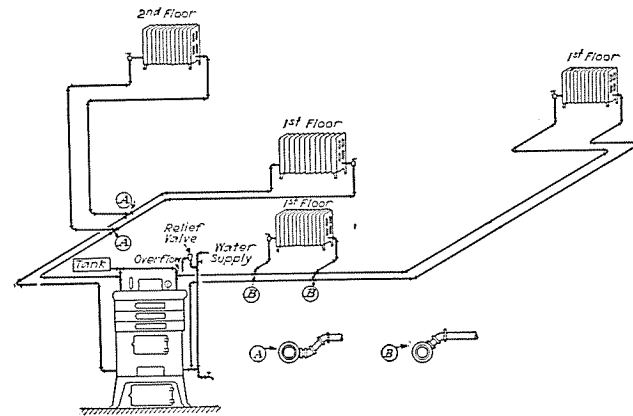

CLOSED HOT WATER HEATING SYSTEM WITH TANK IN BASEMENT

The diagram above shows a typical installation of this character.

Note that in these, and the other diagrams of Hot Water Heating Systems, recommended connections are shown, designated by a letter. The points at which these connections should be installed are indicated by corresponding letters. Complete descriptions of the connections, and reasons for their use, are given on pages 336-337.

Hot Water Pipe Connections

THE natural tendency of hot water is to flow upward, and if the same type of connections from the mains to the risers are used on first floor risers and upper floor risers, the upper floor radiators will be "favored"; that is, practically all of the flow will pass through the upper floor radiators, and there will be very little if any circulation through the first floor radiators.


To avoid this condition, riser connections to upper floor radiators are taken from side of main and lower floor radiators from the top of main. An exception to this is an unusually large radiator located near the boiler on the first floor, the connection to which is usually taken from the side of the main, to prevent this large radiator from taking the entire flow.

Especial care should be taken to ream the ends of all pipes, as burrs left on the inside of the pipe will reduce the pipe area, and restrict the circulation. Eccentric reducing fittings should be used when reducing the size of main. Care should be taken to have the straight side of the fitting on the upper side of the flow main, and on the bottom side of the return main.

The following connections are recommended for use with hot water heating systems and should be carefully studied and followed in laying out an installation:


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Connection A is used when supplying risers to upper floors and for large first-floor radiators. It should not be used after a reduction in the size of the main occurs, as an air pocket might be formed.




A

Connection B is used for the last riser before a main is reduced in size and for first-floor radiators located at some distance from the boiler. One of the objects of the B connection is to vent the main pipe when a reduction is made.




B

Connection C is used only when radiators are located below the main, as in overhead piping systems.




C

Connection D is the proper method of taking off branches from a riser when same is to be extended to a higher floor. The second floor radiator should be taken from the top opening of the tee and the third floor riser should connect to the side opening.



D

Connection E is the correct method of supplying from one riser two radiators that are located on the same floor. The connection to the larger radiator should be taken from the top opening of the tee, and the connection to the smaller radiator should be taken from the side.



E

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Balancing an Open Hot Water Heating System

It is important that a hot water heating system be carefully balanced in order that all radiators will be supplied with the proper amount of hot water. By using the following tables the proper sizes of risers and mains may be accurately determined. Chart No. 2 shows the required nominal riser pipe sizes in inches for radiators located varying distances, up to 100 feet, above the boiler. *Note:* Radiation figures given are maximum; that is, a $\frac{3}{4}$ inch pipe will supply 1 to 40 feet of radiation located 10 feet above boiler. A 1-inch pipe will supply 41 to 70 feet; and so on.

Chart No. 2 - Pipe Sizes for Open Hot Water Heating System

| Nominal Pipe Size Required—Inches | Distance of Radiators above boiler in feet. | | | | | | | | | |
|-----------------------------------|---|-----|-----|-----|-----|-----|-----|-----|-----|------|
| | 10' | 20' | 30' | 40' | 50' | 60' | 70' | 80' | 90' | 100' |
| | Square Feet of Radiation Allowable | | | | | | | | | |
| $\frac{3}{4}$ " | 40 | 50 | 60 | 70 | 80 | 90 | 100 | 110 | 120 | 135 |
| 1" | 70 | 80 | 90 | 100 | 110 | 120 | 130 | 140 | 150 | 160 |
| $1\frac{1}{4}$ " | 110 | 120 | 135 | 150 | 160 | 175 | 185 | 200 | 210 | 225 |
| $1\frac{1}{2}$ " | 180 | 195 | 210 | 230 | 250 | 265 | 285 | 300 | 315 | 330 |
| 2" | 300 | 350 | 400 | 500 | 575 | 625 | 700 | 775 | 825 | 900 |

Examples of application of chart. (Open Tank Hot Water Heating System).

Example: What size riser will be required to supply 120 square feet of hot water radiation on the 4th floor 60 feet above boiler?

Solution: In column headed 60 feet the second figure is 120; carry across to first column and 1" pipe is found to be the required size.

Example: If the above 120 sq. ft. of radiation is on the second floor 20 feet above boiler, what size riser will be required?

Solution: Opposite 120 in column headed 20 feet is noted $1\frac{1}{4}$ " pipe, the required size.

Determination of Correct Size of Main—Hot Water Heating System

To determine the size of main required to take care of various branches, select from the table below the factor for each branch; add them together; the total gives the factor for the main. The size of the required main is shown at the top of the column.

Chart No. 3

Factors to be Used in Proportioning Sizes of Mains

| Nominal Size of Pipe—Inches | $\frac{3}{4}$ | 1 | $1\frac{1}{4}$ | $1\frac{1}{2}$ | 2 | $2\frac{1}{2}$ | 3 | 4 | 5 | 6 | 8 |
|-----------------------------|---------------|---|----------------|----------------|----|----------------|-----|-----|-----|-----|------|
| | Factor | 5 | 10 | 20 | 30 | 60 | 110 | 175 | 380 | 650 | 1050 |

Example: What size main will be required to supply 5- $\frac{3}{4}$ " risers, 4-1" risers and 5- $1\frac{1}{4}$ " risers?

Solution: The factor for $\frac{3}{4}$ " is 5, there are 5 risers— $5 \times 5 = 25$

The factor for 1" is 10, there are 4 risers— $10 \times 4 = 40$


The factor for $1\frac{1}{4}$ " is 20, there are 5 risers— $20 \times 5 = 100$

Total 165

Follow across factor column until the number 165, or the next greater number (which is 175) is reached. The pipe size listed directly above—3 inches—is the size of main required.



NATIONAL ENGINEERING DATA



Compiled by

SAMUEL E. DIBBLE

Past President American Society
of Heating and Ventilating En-
gineers; Professor and Head of
the Heating and Ventilating De-
partment of Carnegie Institute
of Technology.



NATIONAL ENGINEERING DATA

INDEX

Foreword..... 294

Important Points a Heating Contractor Should Recommend..... 296

Determining Radiation Requirements..... 297

The National *Made-to-Measure* Method..... 298

Building Construction Diagrams..... 300-307

 Brick Exterior Walls, Diagrams 1, 4, 7, 10, 13, 16..... 300, 301, 302

 Concrete Exterior Walls, Diagrams 2, 5, 8, 11, 14, 17..... 300, 301, 302

 Hollow Tile Exterior Walls, Diagrams 3, 6, 9, 12, 15, 18..... 300, 301, 302

 Frame Exterior Walls, Diagrams 19 to 26..... 303, 304

 Frame Interior Walls Diagram 27..... 304

 Windows and Skylights, Diagrams 28, 29..... 304

 Infiltration Through Window and Door Cracks, Diagram 30..... 304

 Floors, Diagrams 31 to 33..... 305

 Floors and Ceilings, Diagrams 34 to 39..... 305, 306

 Roofs, Diagrams 40 to 48..... 306, 307

National Direct Reading Radiation Tables..... 308, 309

National Conversion Factors for Various Temperatures and Wind Velocities..... 310

National *Made-to-Measure* Heating Factors..... 311

Climatic Conditions in Cities Throughout the Country..... 312, 313

Application of the National *Made-to-Measure* Method..... 314

How to Select the Proper Size and Type of Radiation..... 318

National *Made-to-Measure* Radiation Charts..... 320-325

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL ENGINEERING DATA

INDEX (continued)

Proving Temperature Guarantees in Warm Weather..... 326

Selecting the Right Boiler for the Job..... 327

Radiator Heating Systems..... 328

Hot Water Heating Systems..... 329

Hot Water Pipe Connections..... 336

Hot Water Pipe Sizes..... 338, 340

Steam Heating Systems..... 341

Causes and Prevention of Water Line Trouble..... 350

Hartford Return Connections..... 352

Recommended Steam Connections..... 353

Expansion of Pipe..... 360

Length of Expansion Offsets or Bends..... 360

Square Feet of Surface per Lineal Foot of Pipe..... 361

Losses from Horizontal Bare Iron Pipes..... 362

Domestic Hot Water Heating..... 364

Swimming Pool Installations..... 366

Selection and Installation of Taco Heaters..... 368

Minimum Allowable Sizes of Safety Valves..... 372

Chimneys—Provisions of Underwriters Code..... 373

Dimensions of Fire Clay Flue Linings..... 376

Determining Sizes of Chimneys, Cubical Content Method..... 377

Determining Sizes of Chimneys, Heat Demand Method..... 378

Psychrometric Chart..... 380

Greenhouse Heating Systems..... 381

Sizes of Heating Fuels..... 388

Weights of Various Fuels..... 389

Firing Various Types of Fuels..... 389

Average Fuel Consumption by Months..... 393

Pipe Welding..... 394

Directions for Cleaning Boilers..... 395

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



FOREWORD

THE purpose of National Engineering Data is to provide facilities for ready reference in connection with problems having to do with the installation of National *Made-to-Measure* Heating Systems. By descriptive text, charts, tables, diagrams, etc., pertinent information is cataloged and made available to National Heating Specialists to enable them to install a modern heating system of exact specifications in such a manner that they can stand unqualifiedly in back of the job. No attempt has been made to incorporate tables dealing with matters largely of an academic nature as these same tables are available in various government books, text books and hand books. However, a very sincere



attempt has been made to handle the problems of correct boiler type and style, correct radiation type and size, and correct technique in combining them to give the customer meritorious results. Thus the heating contractor may win new friends and secure an ever-increasing volume of business because of the high quality of his work and the happiness and contentment his customers enjoy from their National *Made-to-Measure* Heating Systems.

Acknowledgement is gratefully made to the American Society of Heating and Ventilating Engineers, and the Heating and Piping Contractor's National Association for research and engineering data referred to or used.



Points a Heating Contractor Should Recommend

ALL too often the heating plant is blamed for failure to properly warm a building, when the fault is entirely due to incorrect building construction. While this is not primarily the business of the heating contractor, he can do effective missionary work for better construction. Economies resulting from such construction will build good-will for him.

It is suggested, therefore, that heating contractors make the following recommendations:

- (1) Provide chimney of proper dimensions; tile lined to prevent leakage.
A good chimney is essential to proper combustion and satisfactory plant operation.
- (2) Cover boiler and piping with insulation.
This saves fuel by reducing heat loss and also greatly improves the appearance of the installation.
- (3) Install a room thermostat.
It saves labor by automatically regulating the drafts, maintains uniform room temperature, and builds good will.
- (4) Weatherstrip doors and windows, and install storm sash and doors.
This saves sufficient fuel to justify its being strongly urged.
- (5) Insulate walls and roofs.
This cuts down heat losses, saves fuel, makes a more comfortable home in summer as well as in winter.



Determining Radiation Requirements

THE first step in planning a heating system is the determination of the correct amount of radiation required to properly heat each individual room. In order to do this it is necessary to compute the heat loss through walls, glass, etc., and the loss due to infiltration. This involves many calculations and is perhaps one of the reasons why approximate rules are still used. When it is desired to quickly and roughly determine the approximate amount of radiation required for a house, the 2-20-200 method given below may be of help.

Each 2 Square Feet of glass requires 1 square foot of steam radiation (Square feet of opening divided by 2)

Each 20 square feet of exposed wall requires 1 square foot of steam radiation (Net exposed wall divided by 20)

Each 200 cubic feet of room volume requires 1 square foot of steam radiation (Cubical content divided by 200)

The above rule is simple and quick and can be used to determine the approximate amount of radiation for a building, but, because of widely varying conditions, it is not accurate, as it fails to properly take into account the various types of construction, exposures, wind velocity, infiltration and temperature differences.

The tendency in recent years has been to depart from old time methods of rule-of-thumb "guesses" as to the apportionment of radiation and to endeavor to determine by more scientific procedure the correct amount of radiation to be installed. To arrive at a scientific basis considerable laboratory and research work has been done and as a result, a vast amount of valuable data has been published. Much of this data, however, is beyond the requirements of the heating contractor and it has been difficult for him to make practical use of it.



NATIONAL ENGINEERING DATA

Determining Radiation Requirements (continued)

FEELING the need for a simplified but nevertheless scientific method of determining radiation requirements, the Engineers of the National Radiator Corporation, in collaboration with other authorities on the subject, have selected the pertinent facts and have classified them in readily usable form.

The commonly used types of building construction are clearly illustrated in colored diagrams on pages 300 to 307. Accompanying each diagram is a table showing, in column "S" the varying sizes of construction; in column "K" the coefficient of heat transmission, and in column "T" the number of the National Direct-Reading Radiation Table applying to it. The heat transmission coefficients are taken from the latest American Society of Heating & Ventilating Engineers' Guide and were used as a basis in compiling the Direct-Reading Radiation Tables. This value "K" (B.T.U. loss per square foot of surface per hour for 1° temperature) is indicated as a 2-place decimal for the convenience of those who may desire to compute the total B.T.U. loss for a given building. The coefficients of transmission in column "K" need not be considered by the heating contractor in using the Direct-Reading Radiation Tables.

Walls, roofs and partitions may consist of more than a thousand different combinations of building materials. Many of these, however, have approximately the same



NATIONAL ENGINEERING DATA

Determining Radiation Requirements (continued)







coefficient of heat transmission and it is not, therefore, necessary to have a separate table for each kind of construction. There are twenty Direct-Reading Radiation Tables on pages 308 and 309; these take care of all commonly used types of construction. These tables show the amount of steam radiation required for 5 to 1,000 square feet of surface or lineal feet of crack.

As an illustration; to find the square feet of steam radiation for a quantity of wall surface of the construction shown in Diagram No. 22, page 303, note under "T" that Table No. 6 on page 308 is indicated. Assume that the amount of wall surface is 328 square feet. Opposite 300 in Table 6, Page 308 will be found "23," and opposite 30 (the figure nearest 28) is "2". The total of these, which requires only a mental calculation, is 25 square feet, which is the amount of steam radiation required for 328 square feet of wall surface of the construction shown in Diagram No. 22. For hot water radiation the usual 60% is to be added.

In the same manner the amount of radiation for infiltration through any number of lineal feet of crack around windows and doors may be quickly determined by selecting the proper table shown in Diagram 30.

Factors to correct for varying wind velocities and temperatures are shown on page 310. Factors to correct for room temperatures other than 70° are shown on page 311.

NATIONAL ENGINEERING DATA







| WALLS - BRICK PLAIN | | WALLS - BRICK PLASTER 1 SIDE | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|---|------------------------------|---|---|----|-----|----|-----|-----|----|-----|-----|----|---|--|---|--|---|----|-----|---|-----|-----|----|-----|-----|----|-----|-----|----|-----|-----|---|
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.39</td> <td>10</td> </tr> <tr> <td>12"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>16"</td> <td>.24</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .39 | 10 | 12" | .30 | 7 | 16" | .24 | 5 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.36</td> <td>9</td> </tr> <tr> <td>12"</td> <td>.28</td> <td>7</td> </tr> <tr> <td>16"</td> <td>.23</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .36 | 9 | 12" | .28 | 7 | 16" | .23 | 5 | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .39 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .24 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .36 | 9 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .28 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.51</td> <td>13</td> </tr> <tr> <td>10"</td> <td>.46</td> <td>12</td> </tr> <tr> <td>12"</td> <td>.41</td> <td>11</td> </tr> <tr> <td>16"</td> <td>.34</td> <td>9</td> </tr> </tbody> </table> | S | K | T | 8" | .51 | 13 | 10" | .46 | 12 | 12" | .41 | 11 | 16" | .34 | 9 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.46</td> <td>12</td> </tr> <tr> <td>10"</td> <td>.42</td> <td>11</td> </tr> <tr> <td>12"</td> <td>.38</td> <td>10</td> </tr> <tr> <td>16"</td> <td>.32</td> <td>8</td> </tr> </tbody> </table> | S | K | T | 8" | .46 | 12 | 10" | .42 | 11 | 12" | .38 | 10 | 16" | .32 | 8 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .51 | 13 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .46 | 12 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .41 | 11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .34 | 9 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .46 | 12 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .42 | 11 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .38 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .32 | 8 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.32</td> <td>8</td> </tr> <tr> <td>10"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.24</td> <td>6</td> </tr> <tr> <td>16"</td> <td>.20</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .32 | 8 | 10" | .30 | 7 | 12" | .24 | 6 | 16" | .20 | 4 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>10"</td> <td>.29</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.23</td> <td>5</td> </tr> <tr> <td>16"</td> <td>.19</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .30 | 7 | 10" | .29 | 7 | 12" | .23 | 5 | 16" | .19 | 4 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .32 | 8 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .24 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .20 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .29 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .19 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| WALLS - BRICK FURRING, LATH & PLASTER | | $\frac{1}{2}$ " WALLS - BRICK INSULATION & PLASTER | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|--|--|---|---|----|-----|---|-----|-----|---|-----|-----|---|---|--|---|--|--|----|-----|---|-----|-----|---|-----|-----|---|-----|-----|---|-----|-----|---|
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.25</td> <td>6</td> </tr> <tr> <td>12"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>16"</td> <td>.18</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .25 | 6 | 12" | .21 | 5 | 16" | .18 | 4 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.19</td> <td>4</td> </tr> <tr> <td>12"</td> <td>.17</td> <td>3</td> </tr> <tr> <td>16"</td> <td>.15</td> <td>3</td> </tr> </tbody> </table> | S | K | T | 8" | .19 | 4 | 12" | .17 | 3 | 16" | .15 | 3 | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .25 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .19 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .17 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.30</td> <td>7</td> </tr> <tr> <td>10"</td> <td>.28</td> <td>7</td> </tr> <tr> <td>12"</td> <td>.26</td> <td>6</td> </tr> <tr> <td>16"</td> <td>.23</td> <td>5</td> </tr> </tbody> </table> | S | K | T | 8" | .30 | 7 | 10" | .28 | 7 | 12" | .26 | 6 | 16" | .23 | 5 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.22</td> <td>5</td> </tr> <tr> <td>10"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>12"</td> <td>.20</td> <td>4</td> </tr> <tr> <td>16"</td> <td>.18</td> <td>4</td> </tr> </tbody> </table> | S | K | T | 8" | .22 | 5 | 10" | .21 | 5 | 12" | .20 | 4 | 16" | .18 | 4 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .30 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .28 | 7 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .26 | 6 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .23 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .22 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .20 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.22</td> <td>5</td> </tr> <tr> <td>10"</td> <td>.21</td> <td>5</td> </tr> <tr> <td>12"</td> <td>.18</td> <td>4</td> </tr> <tr> <td>16"</td> <td>.15</td> <td>3</td> </tr> </tbody> </table> | S | K | T | 8" | .22 | 5 | 10" | .21 | 5 | 12" | .18 | 4 | 16" | .15 | 3 |  | <table border="1"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>8"</td> <td>.17</td> <td>4</td> </tr> <tr> <td>10"</td> <td>.17</td> <td>3</td> </tr> <tr> <td>12"</td> <td>.15</td> <td>3</td> </tr> <tr> <td>16"</td> <td>.13</td> <td>2</td> </tr> </tbody> </table> | S | K | T | 8" | .17 | 4 | 10" | .17 | 3 | 12" | .15 | 3 | 16" | .13 | 2 |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .22 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .21 | 5 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .18 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8" | .17 | 4 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10" | .17 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12" | .15 | 3 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16" | .13 | 2 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| WALLS - BRICK 1" INSULATION & PLASTER | | WALLS - BRICK 2" INSULATION & PLASTER | | | | | |
|--|-----|--|---|--|-----|-----|---|
|  | S | K | T |  | S | K | T |
| | 8" | .15 | 3 | | 8" | .11 | 2 |
| | 12" | .13 | 2 | | 12" | .10 | 1 |
| | 16" | .12 | 2 | | 16" | .09 | 1 |
| WALLS - CONCRETE 1" INSULATION & PLASTER | | WALLS - CONCRETE 2" INSULATION & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | 8" | .16 | 3 | | 8" | .11 | 2 |
| | 10" | .16 | 3 | | 10" | .11 | 2 |
| | 12" | .15 | 3 | | 12" | .11 | 2 |
| | 16" | .14 | 3 | | 16" | .10 | 1 |
| WALLS - HOLLOW TILE 1" INSULATION & PLASTER | | WALLS - HOLLOW TILE 2" INSULATION & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | 8" | .14 | 3 | | 8" | .10 | 1 |
| | 10" | .13 | 2 | | 10" | .10 | 1 |
| | 12" | .12 | 2 | | 12" | .09 | 1 |
| | 16" | .11 | 2 | | 16" | .08 | 1 |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No.(pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

| WALLS - FRAME CORRUGATED OR FLAT IRON ON STUDS | | WALLS - FRAME CLAPBOARDS, 1" SHEATHING, STUDS, LATH & PLASTER | | | | | |
|--|---|---|----|--|---|-----|---|
|  | S | K | T |  | S | K | T |
| | | .15 | 17 | | | .26 | 6 |
| | | | | | | | |
| WALLS - FRAME CORRUGATED OR FLAT IRON, 1" SHEATHING ON STUDS | | WALLS - FRAME BRICK VENEER, 1" SHEATHING, STUDS, LATH & PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | | .78 | 15 | | | .25 | 6 |
| | | | | | | | |
| WALLS - FRAME STUCCO, 1" SHEATHING, STUDS, LATH & PLASTER | | WALLS - FRAME STUCCO, 1" SHEATHING, STUDS, 1/2" INSULATION, PLASTER | | | | | |
|  | S | K | T |  | S | K | T |
| | | .30 | 7 | | | .22 | 5 |
| | | | | | | | |


BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No.(pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA


WALLS-FRAME
STUCCO, 1" SHEATHING,
STUDS, 1" INSULATION, PLASTER



| S | K | T |
|---|-----|---|
| | .17 | 3 |
| | | |
| | | |

(25)


DOORS, WINDOWS & SKYLIGHTS
SINGLE GLASS



| S | K | T |
|---|------|----|
| | 1.13 | 16 |
| | | |
| | | |

(28)


WALLS-FRAME
STUCCO, 1" SHEATHING,
STUDS, 2" INSULATION, PLASTER



| S | K | T |
|---|-----|---|
| 3 | .10 | 1 |
| | | |
| | | |

(26)


DOORS, WINDOWS & SKYLIGHTS
DOUBLE GLASS



| S | K | T |
|---|-----|----|
| | .45 | 12 |
| | | |
| | | |

(29)


WALLS-INTERIOR
STUDS, LATH & PLASTER, 1 SIDE



| S | K | T |
|---|-----|---|
| | .10 | 1 |
| | | |
| | | |

(27)

STUDS, L & P, 2 SIDES



| S | K | T |
|---|-----|---|
| | .10 | 1 |
| | | |
| | | |

(27)

INFILTRATION

| | T |
|-----------------------------|----|
| PLAIN WINDOWS | 18 |
| WEATHERSTRIPPED WINDOWS | 11 |
| PLAIN RESIDENCE DOORS | 19 |
| WEATHERSTRIPPED DOORS | 18 |
| PLAIN STORE DOORS | 20 |
| WEATHERSTRIPPED STORE DOORS | 19 |

(30)


BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA


FLOORS
CONCRETE ON SOIL



| S | K | T |
|----|-----|----|
| 4" | .56 | 14 |
| 6" | .49 | 13 |

(31)


FLOORS & CEILINGS
1" SHEATHING ON JOISTS



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .44 | 30° | 4 |
| | 50° | 8 |

(34)


FLOORS
WOOD ON CONCRETE



| S | K | T |
|----|-----|----|
| 4" | .39 | 10 |
| 6" | .36 | 9 |

(32)


FLOORS & CEILINGS
1" SHEATHING ON JOISTS
LATH & PLASTER BELOW



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .27 | 30° | 2 |
| | 50° | 4 |

(35)


FLOORS
REINFORCED CONCRETE



| S | K | TEMP. DIFF. | T |
|----|-----|-------------|---|
| 4" | .51 | 30° | 5 |
| | | 50° | 9 |
| 6" | .45 | 30° | 4 |
| | | 50° | 8 |

(33)

FLOORS & CEILINGS
DOUBLE FLOORING
& PAPER ON JOISTS



| K | TEMP. DIFF. | T |
|-----|-------------|---|
| .34 | 30° | 3 |
| | 50° | 6 |







(36)

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA







| <p>FLOORS & CEILINGS DOUBLE FLOORING & PAPER LATH & PLASTER BELOW</p>  <table border="1" data-bbox="511 432 647 541"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.23</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>3</td> </tr> </tbody> </table> <p>(37)</p> | K | TEMP DIFF. | T | .23 | 30° | 1 | | 50° | 3 | <p>ROOFS SHINGLES ON WOOD STRIPS</p>  <table border="1" data-bbox="859 432 975 555"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.48</td> <td>13</td> </tr> </tbody> </table> <p>(40)</p> | S | K | T | | .48 | 13 |
|--|------------|------------|---|-----|-----|---|--|-----|---|---|---|---|---|--|-----|----|
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .23 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 3 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .48 | 13 | | | | | | | | | | | | | | |
| <p>FLOORS & CEILINGS DOUBLE FLOORING & PAPER $\frac{1}{2}$" INSULATION & PLASTER BELOW</p>  <table border="1" data-bbox="511 734 647 843"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.18</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>2</td> </tr> </tbody> </table> <p>(38)</p> | K | TEMP DIFF. | T | .18 | 30° | 1 | | 50° | 2 | <p>ROOFS SHINGLES ON WOOD STRIPS & $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="859 740 975 857"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.21</td> <td>5</td> </tr> </tbody> </table> <p>(41)</p> | S | K | T | | .21 | 5 |
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .18 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 2 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .21 | 5 | | | | | | | | | | | | | | |
| <p>FLOORS & CEILING DOUBLE FLOORING & PAPER 1" INSULATION & PLASTER BELOW</p>  <table border="1" data-bbox="511 1035 647 1145"> <thead> <tr> <th>K</th> <th>TEMP DIFF.</th> <th>T</th> </tr> </thead> <tbody> <tr> <td>.11</td> <td>30°</td> <td>1</td> </tr> <tr> <td></td> <td>50°</td> <td>1</td> </tr> </tbody> </table> <p>(39)</p> | K | TEMP DIFF. | T | .11 | 30° | 1 | | 50° | 1 | <p>ROOFS SHINGLES ON WOOD STRIPS & 1" INSULATION</p>  <table border="1" data-bbox="859 1042 975 1159"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.12</td> <td>2</td> </tr> </tbody> </table> <p>(42)</p> | S | K | T | | .12 | 2 |
| K | TEMP DIFF. | T | | | | | | | | | | | | | | |
| .11 | 30° | 1 | | | | | | | | | | | | | | |
| | 50° | 1 | | | | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | | | | |
| | .12 | 2 | | | | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING</p>  <table border="1" data-bbox="1246 439 1381 562"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.52</td> <td>13</td> </tr> </tbody> </table> <p>(43)</p> | S | K | T | | .52 | 13 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING</p>  <table border="1" data-bbox="1584 439 1719 562"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.55</td> <td>14</td> </tr> </tbody> </table> <p>(46)</p> | S | K | T | | .55 | 14 |
|--|-----|----|---|--|-----|----|---|---|---|---|--|-----|----|
| S | K | T | | | | | | | | | | | |
| | .52 | 13 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .55 | 14 | | | | | | | | | | | |
| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="1246 747 1381 871"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.22</td> <td>5</td> </tr> </tbody> </table> <p>(44)</p> | S | K | T | | .22 | 5 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING $\frac{1}{2}$" INSULATION</p>  <table border="1" data-bbox="1584 747 1719 871"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.22</td> <td>5</td> </tr> </tbody> </table> <p>(47)</p> | S | K | T | | .22 | 5 |
| S | K | T | | | | | | | | | | | |
| | .22 | 5 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .22 | 5 | | | | | | | | | | | |
| <p>ROOFS WOOD OR ASPHALT SHINGLES ON 1" SHEATHING 1" INSULATION</p>  <table border="1" data-bbox="1246 1049 1381 1173"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.16</td> <td>3</td> </tr> </tbody> </table> <p>(45)</p> | S | K | T | | .16 | 3 | <p>ROOFS SLATE OR TILE ON 1" SHEATHING 1" INSULATION</p>  <table border="1" data-bbox="1584 1049 1719 1173"> <thead> <tr> <th>S</th> <th>K</th> <th>T</th> </tr> </thead> <tbody> <tr> <td></td> <td>.17</td> <td>3</td> </tr> </tbody> </table> <p>(48)</p> | S | K | T | | .17 | 3 |
| S | K | T | | | | | | | | | | | |
| | .16 | 3 | | | | | | | | | | | |
| S | K | T | | | | | | | | | | | |
| | .17 | 3 | | | | | | | | | | | |

BRICK OR TILE STONE OR CONCRETE FRAME INSULATION

S—Size of material. K—Heat transmission coefficient. T—Table No. (pages 308, 309)

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL DIRECT READING RADIATION TABLES

| SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK | SQUARE FEET OF STEAM RADIATION REQUIRED | | | | | | | | | | SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK |
|--|---|----|----|----|----|----|----|----|-----|-----|--|
| | TABLE NO. | | | | | | | | | | |
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | |
| 5 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 1 | 1 | 1 | 5 |
| 10 | 0 | 0 | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 10 |
| 15 | 0 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 15 |
| 20 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 2 | 2 | 2 | 20 |
| 25 | 1 | 1 | 1 | 1 | 2 | 2 | 2 | 2 | 3 | 3 | 25 |
| 30 | 1 | 1 | 1 | 2 | 2 | 2 | 3 | 3 | 3 | 3 | 30 |
| 35 | 1 | 1 | 2 | 2 | 2 | 3 | 3 | 3 | 4 | 4 | 35 |
| 40 | 1 | 1 | 2 | 2 | 3 | 3 | 3 | 4 | 4 | 5 | 40 |
| 45 | 1 | 2 | 2 | 2 | 3 | 3 | 4 | 4 | 5 | 5 | 45 |
| 50 | 1 | 2 | 2 | 3 | 3 | 4 | 4 | 5 | 5 | 6 | 50 |
| 55 | 1 | 2 | 2 | 3 | 4 | 4 | 5 | 5 | 6 | 6 | 55 |
| 60 | 2 | 2 | 3 | 3 | 4 | 5 | 5 | 6 | 6 | 7 | 60 |
| 65 | 2 | 2 | 3 | 4 | 4 | 5 | 6 | 6 | 7 | 7 | 65 |
| 70 | 2 | 2 | 3 | 4 | 5 | 5 | 6 | 7 | 7 | 8 | 70 |
| 75 | 2 | 3 | 3 | 4 | 5 | 6 | 6 | 7 | 8 | 9 | 75 |
| 80 | 2 | 3 | 4 | 4 | 5 | 6 | 7 | 8 | 8 | 9 | 80 |
| 85 | 2 | 3 | 4 | 5 | 6 | 6 | 7 | 8 | 9 | 10 | 85 |
| 90 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 9 | 10 | 90 |
| 95 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 95 |
| 100 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 | 11 | 12 | 100 |
| 200 | 5 | 7 | 9 | 11 | 13 | 15 | 17 | 19 | 21 | 23 | 200 |
| 300 | 8 | 11 | 14 | 17 | 20 | 23 | 26 | 29 | 32 | 35 | 300 |
| 400 | 10 | 14 | 18 | 22 | 25 | 30 | 34 | 38 | 42 | 46 | 400 |
| 500 | 13 | 18 | 23 | 28 | 33 | 38 | 43 | 48 | 53 | 58 | 500 |
| 600 | 15 | 21 | 27 | 33 | 39 | 45 | 51 | 57 | 63 | 69 | 600 |
| 700 | 18 | 25 | 32 | 39 | 46 | 53 | 60 | 67 | 74 | 81 | 700 |
| 800 | 20 | 28 | 36 | 44 | 52 | 60 | 68 | 76 | 84 | 92 | 800 |
| 900 | 23 | 32 | 41 | 50 | 59 | 68 | 77 | 86 | 95 | 104 | 900 |
| 1000 | 25 | 35 | 45 | 55 | 65 | 75 | 85 | 95 | 105 | 115 | 1000 |

Above tables refer to diagrams pages 300-307.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL DIRECT READING RADIATION TABLES

| SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK | SQUARE FEET OF STEAM RADIATION REQUIRED | | | | | | | | | | | | | | | | | | | | SQUARE FEET OF SURFACE OR LINEAR FEET OF CRACK |
|--|---|-----|-----|-----|-----|-----|-----|-----|------|------|------|--|--|--|--|--|--|--|--|--|--|
| | TABLE NO. | | | | | | | | | | | | | | | | | | | | |
| | 11 | 12 | 13 | 14 | 15 | 16 | 17 | 18 | 19 | 20 | | | | | | | | | | | |
| 5 | 1 | 1 | 1 | 1 | 1 | 2 | 2 | 3 | 7 | 13 | 5 | | | | | | | | | | |
| 10 | 1 | 1 | 1 | 2 | 2 | 3 | 4 | 7 | 13 | 26 | 10 | | | | | | | | | | |
| 15 | 2 | 2 | 2 | 2 | 3 | 5 | 7 | 10 | 20 | 39 | 15 | | | | | | | | | | |
| 20 | 3 | 3 | 3 | 3 | 5 | 7 | 9 | 13 | 26 | 52 | 20 | | | | | | | | | | |
| 25 | 3 | 3 | 4 | 4 | 6 | 8 | 11 | 16 | 33 | 65 | 25 | | | | | | | | | | |
| 30 | 4 | 4 | 4 | 5 | 7 | 10 | 13 | 20 | 39 | 78 | 30 | | | | | | | | | | |
| 35 | 4 | 5 | 5 | 6 | 8 | 12 | 15 | 23 | 46 | 91 | 35 | | | | | | | | | | |
| 40 | 5 | 5 | 6 | 7 | 9 | 13 | 18 | 26 | 52 | 104 | 40 | | | | | | | | | | |
| 45 | 6 | 6 | 7 | 7 | 10 | 15 | 20 | 29 | 59 | 117 | 45 | | | | | | | | | | |
| 50 | 6 | 7 | 7 | 8 | 11 | 16 | 22 | 33 | 65 | 130 | 50 | | | | | | | | | | |
| 55 | 7 | 7 | 8 | 9 | 13 | 18 | 24 | 36 | 72 | 143 | 55 | | | | | | | | | | |
| 60 | 8 | 8 | 9 | 10 | 14 | 20 | 26 | 39 | 79 | 157 | 60 | | | | | | | | | | |
| 65 | 8 | 9 | 9 | 11 | 15 | 21 | 28 | 43 | 85 | 170 | 65 | | | | | | | | | | |
| 70 | 9 | 9 | 10 | 12 | 16 | 23 | 31 | 46 | 92 | 183 | 70 | | | | | | | | | | |
| 75 | 9 | 10 | 11 | 12 | 17 | 25 | 33 | 49 | 98 | 196 | 75 | | | | | | | | | | |
| 80 | 10 | 11 | 12 | 13 | 18 | 26 | 35 | 52 | 105 | 209 | 80 | | | | | | | | | | |
| 85 | 11 | 11 | 12 | 14 | 19 | 28 | 37 | 56 | 111 | 222 | 85 | | | | | | | | | | |
| 90 | 11 | 12 | 13 | 15 | 21 | 30 | 39 | 59 | 118 | 235 | 90 | | | | | | | | | | |
| 95 | 12 | 13 | 14 | 16 | 22 | 31 | 42 | 62 | 124 | 248 | 95 | | | | | | | | | | |
| 100 | 13 | 14 | 15 | 17 | 23 | 33 | 44 | 65 | 131 | 261 | 100 | | | | | | | | | | |
| 200 | 25 | 27 | 29 | 33 | 46 | 66 | 88 | 131 | 262 | 522 | 200 | | | | | | | | | | |
| 300 | 38 | 41 | 44 | 50 | 68 | 99 | 131 | 196 | 393 | 783 | 300 | | | | | | | | | | |
| 400 | 50 | 54 | 58 | 66 | 91 | 132 | 175 | 262 | 524 | 1044 | 400 | | | | | | | | | | |
| 500 | 63 | 68 | 73 | 83 | 114 | 165 | 219 | 327 | 655 | 1305 | 500 | | | | | | | | | | |
| 600 | 75 | 81 | 87 | 99 | 137 | 197 | 263 | 392 | 785 | 1565 | 600 | | | | | | | | | | |
| 700 | 88 | 95 | 102 | 116 | 160 | 230 | 307 | 458 | 916 | 1826 | 700 | | | | | | | | | | |
| 800 | 100 | 108 | 116 | 132 | 182 | 263 | 350 | 523 | 1047 | 2087 | 800 | | | | | | | | | | |
| 900 | 113 | 122 | 131 | 149 | 205 | 296 | 394 | 589 | 1178 | 2348 | 900 | | | | | | | | | | |
| 1000 | 125 | 135 | 145 | 165 | 228 | 329 | 438 | 654 | 1309 | 2609 | 1000 | | | | | | | | | | |

Above tables refer to diagrams pages 300-307.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Conversion Factors for Various Temperatures and Wind Velocities

| Outside Temperature | Wind Velocities—Miles per Hour | | | | | |
|---------------------|--------------------------------|-----|-----|---------------------------|-----|-----|
| | Sides Exposed to Wind | | | Sides Not Exposed to Wind | | |
| | 15 | 20 | 30 | 15 | 20 | 30 |
| —30° | 1.7 | 2.2 | 3.3 | 1.5 | 1.9 | 2.9 |
| —20° | 1.6 | 2.1 | 3.1 | 1.4 | 1.8 | 2.7 |
| —15° | 1.4 | 1.9 | 2.9 | 1.3 | 1.7 | 2.5 |
| —10° | 1.3 | 1.8 | 2.6 | 1.2 | 1.5 | 2.3 |
| — 5° | 1.3 | 1.7 | 2.5 | 1.1 | 1.5 | 2.2 |
| — 0° | 1.2 | 1.6 | 2.3 | 1.0 | 1.4 | 2.0 |
| 5° | 1.1 | 1.4 | 2.2 | .95 | 1.3 | 1.9 |
| 10° | 1.0 | 1.3 | 2.0 | .85 | 1.2 | 1.7 |
| 15° | .90 | 1.2 | 1.8 | .80 | 1.1 | 1.6 |
| 20° | .80 | 1.1 | 1.7 | .70 | .95 | 1.5 |
| 25° | .75 | 1.0 | 1.5 | .65 | .85 | 1.3 |

The National Direct Reading Radiation Tables on Pages 308 and 309 are based on 15 mile wind velocity and outside temperature of 0° with an inside temperature of 70°. To correct for a different outside temperature and wind velocity the above conversion factors have been compiled. Multiplying the total radiation by the proper factor will give the amount of radiation needed for a locality where the wind velocity is more than 15 miles per hour and the outside temperature is other than 0.

NATIONAL ENGINEERING DATA

National *Made-to-Measure* Heating Factor

The amount of radiation required for a room is generally based on a room temperature of 70 degrees. Because this has been the practice, the National Direct Reading Radiation Tables are based on a 70 degree room temperature.

However, in line with the new vogue in heating and the desire to have temperatures other than 70 degrees in certain selected rooms, for certain personal reasons, the following National Made-to-Measure Factor Table has been computed.

| Room Temperature | Made-to-Measure Factor |
|------------------|------------------------|
| 60° | .80 |
| 65° | .90 |
| 68° | .96 |
| 70° | 1.00 |
| 72° | 1.04 |
| 74° | 1.09 |
| 76° | 1.13 |
| 78° | 1.18 |
| 80° | 1.23 |

To apply the above table, simply multiply the selected temperature factor by the square feet of radiation determined for 70 degrees.

NATIONAL ENGINEERING DATA

Climatic Conditions Compiled from
U. S. Weather Bureau Records

| State and City | | * Ave. Temp. Oct. 1 to May 1 | Lowest Temp. | * Ave. Wind Vel. | Direction of Prevailing Winds |
|----------------|----------------|--|-----------------|---------------------------|--|
| Ala. | Mobile | 57.7 | -1 | 8.3 | N |
| | Birmingham | 53.9 | -10 | 8.6 | N |
| Ariz. | Phoenix | 59.5 | 16 | 3.9 | E |
| | Flagstaff | 34.9 | -25 | 6.7 | SW |
| Ark. | Fort Smith | 49.5 | -15 | 8.0 | E |
| | Little Rock | 51.6 | -12 | 9.9 | NW |
| Cal. | San Francisco | 54.3 | 29 | | N |
| | Los Angeles | 58.6 | 28 | | NE |
| Colo. | Denver | 39.3 | -29 | 7.4 | S |
| | Grand Junction | 39.2 | -16 | 5.6 | SE |
| Conn. | New Haven | 38.0 | -14 | 9.3 | N |
| D. C. | Washington | 43.2 | -15 | 7.3 | NW |
| Fla. | Jacksonville | 61.9 | 10 | 8.2 | NE |
| Ga. | Atlanta | 51.4 | -8 | 11.8 | NW |
| | Savannah | 58.4 | 8 | 8.3 | NW |
| Idaho | Lewiston | 42.5 | -13 | 4.7 | E |
| | Pocatello | 36.4 | -20 | 9.3 | SE |
| Ill. | Chicago | 36.4 | -23 | 17.0 | SW |
| | Springfield | 39.9 | -24 | 10.2 | NW |
| Ind. | Indianapolis | 40.2 | -25 | 11.8 | S |
| | Evansville | 44.1 | -15 | 8.4 | S |
| Iowa | Dubuque | 33.9 | -32 | 6.1 | NW |
| | Sioux City | 32.1 | -35 | 12.2 | NW |
| Kans. | Concordia | 38.9 | -25 | 7.3 | N |
| | Dodge City | 40.2 | -26 | 10.4 | NW |
| Ky. | Louisville | 45.2 | -20 | 9.3 | SW |
| La. | New Orleans | 61.5 | 7 | 9.6 | N |
| | Shreveport | 56.2 | -5 | 7.7 | SE |
| Me. | Eastport | 31.1 | -23 | 13.8 | W |
| | Portland | 33.6 | -17 | 10.1 | NW |
| Md. | Baltimore | 43.6 | -7 | 7.2 | NW |
| Mass. | Boston | 37.6 | -13 | 11.7 | W |
| Mich. | Alpena | 29.1 | -27 | 11.3 | W |
| | Detroit | 35.4 | -24 | 13.1 | SW |
| | Marquette | 27.6 | -27 | 11.4 | NW |
| Minn. | Duluth | 25.1 | -41 | 11.1 | SW |
| | Minneapolis | 29.6 | -33 | 11.5 | NW |
| Miss. | Vicksburg | 56.0 | -1 | 7.6 | SE |
| Mo. | St. Joseph | 40.3 | -24 | 9.1 | NW |
| | St. Louis | 43.3 | -22 | 11.8 | NW |
| | Springfield | 43.0 | -29 | 11.3 | SE |
| Mont. | Billings | 34.7 | -49 | | W |
| | Havre | 27.7 | -57 | 8.7 | SW |
| Nebr. | Lincoln | 37.0 | -29 | 10.9 | N |
| | North Platte | 34.6 | -35 | 9.0 | W |

*Average temperatures and wind velocities. Heating plants are designed for more extreme conditions.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Climatic Conditions (continued)

| State and City | | * Ave. Temp. Oct. 1 to May 1 | Lowest Temp. | * Ave. Wind Vel. | Direction of Prevailing Winds |
|----------------|----------------|--|-----------------|---------------------------|--|
| Nev. | Tonopah | 39.6 | -7 | 9.9 | SE |
| | Winnemucca | 37.9 | -28 | 9.5 | NE |
| N. H. | Concord | 33.4 | -35 | 6.0 | NW |
| N. J. | Atlantic City | 41.6 | -7 | 10.6 | NW |
| N. Y. | Albany | 55.1 | -24 | 7.9 | S |
| | Buffalo | 34.7 | -14 | 17.7 | W |
| | New York | 40.3 | -6 | 13.3 | NW |
| N. M. | Santa Fe | 38.0 | -13 | 7.3 | NE |
| N. C. | Raleigh | 49.7 | -2 | 7.3 | SW |
| | Wilmington | 53.1 | 5 | 8.9 | SW |
| N. D. | Bismark | 24.5 | -45 | | NW |
| | Devil's Lake | 18.9 | -44 | 11.4 | W |
| Ohio | Cleveland | 36.9 | -17 | 14.5 | SW |
| | Columbus | 39.9 | -20 | 9.3 | SW |
| Okla. | Oklahoma City | 48.0 | -17 | 12.0 | N |
| Ore. | Baker | 34.1 | -20 | 6.0 | SE |
| | Portland | 45.9 | -2 | 6.5 | S |
| Pa. | Philadelphia | 41.9 | -6 | 11.0 | NW |
| | Pittsburgh | 40.8 | -20 | 13.7 | NW |
| R. I. | Providence | 37.6 | -9 | 14.6 | NW |
| S. C. | Charleston | 56.9 | 7 | 11.0 | N |
| | Columbia | 53.7 | -2 | 8.0 | NE |
| S. D. | Huron | 28.1 | -43 | 11.5 | NW |
| | Rapid City | 32.3 | -34 | 7.5 | W |
| Tenn. | Knoxville | 47.0 | -16 | 6.5 | SW |
| | Memphis | 50.9 | -9 | 9.6 | NW |
| Texas | El Paso | 53.0 | -2 | 10.5 | NW |
| | Fort Worth | 54.7 | -8 | 11.0 | NW |
| | San Antonio | 60.7 | 4 | 8.2 | N |
| Utah | Modena | 38.1 | -24 | 8.9 | W |
| | Salt Lake City | 40.0 | -20 | 4.9 | SE |
| Vt. | Burlington | 29.3 | -27 | 12.9 | S |
| Va. | Norfolk | 49.1 | 2 | 9.0 | N |
| | Lynchburg | 45.2 | -7 | 5.2 | NW |
| | Richmond | 47.4 | -3 | 7.4 | S |
| Wash. | Seattle | 45.3 | 3 | 9.1 | SE |
| | Spokane | 37.5 | -30 | | SW |
| W. Va. | Elkins | 38.9 | -21 | 4.8 | W |
| | Parkersburg | 41.9 | -27 | 6.6 | S |
| Wisc. | Green Bay | 28.6 | -36 | 12.8 | SW |
| | La Crosse | 31.2 | -43 | 5.6 | NW |
| | Milwaukee | 33.0 | -25 | 11.7 | W |
| Wyo. | Sheridan | 31.0 | -45 | 5.3 | NW |
| | Lander | 28.9 | -36 | 3.0 | NE |

*Average temperatures and wind velocities. Heating plants are designed for more extreme conditions.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Application of the National *Made-To-Measure* Method

The application of National Direct Reading Radiation Diagrams and Tables will be readily understood from the example of a typical room shown in plan below (Diagram No. 49). Desired room temperature 72°.

As shown on the plan, the room is 15' x 18', with 9' ceiling. Two weather-stripped windows, each 3' x 6', in north wall; and one 3' x 7' door, not weatherstripped, in west wall.

Wall construction is 8" brick, furred, lathed and plastered. Adjacent rooms are heated, so no heat loss need be considered through partitions, ceiling or floor.

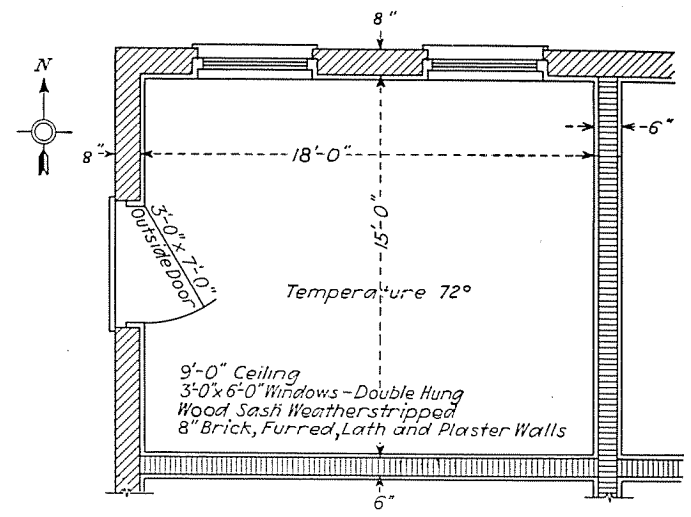


Diagram No. 49



NATIONAL ENGINEERING DATA

Application of the National *Made-To-Measure* Method (continued)

First compute the north wall and total window area;

$$18 \times 9 = 162 \text{ square feet of wall}$$

$$2 \times 3 \times 6 = 36 \text{ square feet of window}$$

$$\text{subtracting,} = 126 \text{ square feet of net brick wall construction}$$

Diagram No. 7, Page 301, covers brick wall, furring, lath and plaster. From this diagram it is seen that an 8" wall (column "S") indicates (in column "T") Table No. 6 (on page 308). Reading across from either column headed "square feet of surface" it will be noted that 100 square feet of surface in Table 6 calls for 8 square feet of steam radiation. Likewise 25 (the figure nearest 26) square feet of surface calls for 2 square feet of steam radiation, making a total of 10 square feet of radiation for 126 square feet of wall surface.

Diagram No. 28, Page 304, covers windows with single glass. From this diagram it is seen that Table 16, (page 309) is indicated. 35 square feet of surface (the figure nearest 36) calls for 12 square feet of steam radiation.

The lineal feet of infiltration is the distance around each window plus the crack in the meeting rail $(6 + 6 + 3 + 3 + 3) = 21$. For the two windows the total length of crack is 42 feet. Diagram No. 30, page 304, covers infiltration. From this diagram

Application of the National *Made-To-Measure* Method (continued)

it is seen that Table 11 (page 309) is indicated for weather stripped windows. Reading across from 40 (the figure nearest 42) 5 square feet of steam radiation is called for.

The total radiation for the north wall is 27 square feet, made up as follows:

| | | | |
|--------------------|----------------|---|---|
| Brick wall surface | 10 square feet | | |
| Window surface | 12 | " | " |
| Infiltration | 5 | " | " |
| Total | 27 | " | " |

In like manner, the west wall and door area are computed as follows:

| | | | |
|--------------|--------------------------------|--------------------------|-----------------|
| Wall | $15 \times 9 = 135$ | | |
| Door | $3 \times 7 = 21$ | = Diagram 28, Table 16 = | 7 sq. ft. rad. |
| Net wall | 114 | Diagram 7, Table 6 = | 9 sq. ft. rad. |
| Infiltration | $7 \times 2 + 3 \times 2 = 20$ | = Diagram 30, Table 19 = | 26 sq. ft. rad. |
| TOTAL AREA | | | 42 sq. ft. rad. |

Summarizing, total radiation required for north wall = 27 square feet
 total radiation required for west wall = 42 square feet
 Total square feet of steam radiation for 70° room = 69 square feet
 temperature, 0° outside temperature

Since, in this case, an inside temperature of 72° is to be maintained, the factor 1.04 as shown on page 311 must be considered. Therefore, the full amount of steam radiation required is 69×1.04 , or 72 square feet.

This installation is to be a National Made-to-Measure Hot Water System in place of steam. The total of 72

Application of the National *Made-To-Measure* Method (continued)

square feet is, therefore, to be increased 60%, making 115 square feet of Hot Water Radiation.

This problem assumes an outside temperature of 0° and a wind velocity of 15 miles per hour, the conditions on which National Direct-Reading Radiation Tables are based. The conversion factors on page 310, therefore, need not be considered. If the outside temperature were -10° and the wind velocity 20 miles per hour, the total radiation shown above would be multiplied by 1.5 for sides not exposed and 1.8 for sides exposed.

Selection of the Proper Radiator

This may readily be done by following the instructions on pages 318 and 319.

It is probable, in this example, that the radiator location selected would be against the north wall and below the windows; also that radiators 26" high will be used.

Since the total required radiation is 115 square feet, two radiators will be needed, each of $57\frac{1}{2}$ square feet capacity.

Referring to the Radiation Chart on page 323, it is seen that a 16-section 5-tube radiator 26" high has a capacity of 56 square feet, which is close enough for the purpose. Since this radiator is 40" long, and will extend but 2" on each side of the window opening, it may be considered satisfactory.



How to Select the Proper Type and Size of Radiation

The following charts show the number of square feet of National Aero Radiation in various lengths, widths and heights. Their use will facilitate determining the dimensions of a radiator that will conform to a given space and provide the desired number of square feet of radiation.

The procedure is simple.

1. Determine the number of square feet of radiation required for a given room.
2. Select desired location of radiators after considering exposure, and wall space required for furniture.
3. Decide the number of radiators required.
4. Decide the dimension or dimensions of the radiator which are limited by the space available. For example, suppose the height must not exceed 27 inches, the length 44 inches, and that the radiation must be not less than 40 square feet.



5. Refer to the radiation charts. Chart No. 1 "G" covers radiators 26 inches high—these are nearest to the permitted height.

6. Locate the desired length in column "B". At the point of intersection between the height group selected, and the length desired, you will find the number of square feet of radiation available in radiators with various numbers of tubes. In the case above, you will have a choice of:

(A.) a 3-tube, $42\frac{1}{2}$ inches long, with $39\frac{3}{4}$ sq. ft. of radiation.

(B.) a 4-tube, $37\frac{1}{2}$ inches long, with $41\frac{1}{4}$ sq. ft. of radiation.

(C.) a 5-tube, 30 inches long, with 42 sq. ft. of radiation.

(D.) a 6-tube, 25 inches long, with 40 sq. ft. of radiation.

(E.) a 7-tube, $22\frac{1}{2}$ inches long, with $42\frac{3}{4}$ sq. ft. of radiation.

7. Choose from these various possibilities the proportions that will present the most pleasing appearance.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1

| A Number of Sections | B Radiator Length in Inches | C | | D | |
|-------------------------|--------------------------------|-----------|-----|-----------|--|
| | | 13½" | | 16½" | |
| | | No. Tubes | | No. Tubes | |
| | | 7 | | 7 | |
| | | Sq. Ft. | | Sq. Ft. | |
| 1 | 2½ | 2½ | 3 | | |
| 2 | 5 | 5 | 6 | | |
| 3 | 7½ | 7½ | 9 | | |
| 4 | 10 | 10 | 12 | | |
| 5 | 12½ | 12½ | 15 | | |
| 6 | 15 | 15 | 18 | | |
| 7 | 17½ | 17½ | 21 | | |
| 8 | 20 | 20 | 24 | | |
| 9 | 22½ | 22½ | 27 | | |
| 10 | 25 | 25 | 30 | | |
| 11 | 27½ | 27½ | 33 | | |
| 12 | 30 | 30 | 36 | | |
| 13 | 32½ | 32½ | 39 | | |
| 14 | 35 | 35 | 42 | | |
| 15 | 37½ | 37½ | 45 | | |
| 16 | 40 | 40 | 48 | | |
| 17 | 42½ | 42½ | 51 | | |
| 18 | 45 | 45 | 54 | | |
| 19 | 47½ | 47½ | 57 | | |
| 20 | 50 | 50 | 60 | | |
| 21 | 52½ | 52½ | 63 | | |
| 22 | 55 | 55 | 66 | | |
| 23 | 57½ | 57½ | 69 | | |
| 24 | 60 | 60 | 72 | | |
| 25 | 62½ | 62½ | 75 | | |
| 26 | 65 | 65 | 78 | | |
| 27 | 67½ | 67½ | 81 | | |
| 28 | 70 | 70 | 84 | | |
| 29 | 72½ | 72½ | 87 | | |
| 30 | 75 | 75 | 90 | | |
| Width of Sections | | 12" | 12" | | |

*Height of Radiators.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| A Number of Sections | B Radiator Length in Inches | E 20" High Radiators | | | | |
|-------------------------|--------------------------------|-------------------------|--------------------|--------------------|---------|---------|
| | | No. of Tubes | | | | |
| | | 3 | 4 | 5 | 6 | 7 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 1¾ | 2¼ | 2⅔ | 3 | 3⅔ |
| 2 | 5 | 3½ | 4½ | 5⅓ | 6 | 7⅓ |
| 3 | 7½ | 5¼ | 6¾ | 8 | 9 | 11 |
| 4 | 10 | 7 | 9 | 10⅔ | 12 | 14⅔ |
| 5 | 12½ | 8¾ | 11¼ | 13⅓ | 15 | 18⅓ |
| 6 | 15 | 10½ | 13½ | 16 | 18 | 22 |
| 7 | 17½ | 12¼ | 15¾ | 18⅔ | 21 | 25⅔ |
| 8 | 20 | 14 | 18 | 21⅓ | 24 | 29⅓ |
| 9 | 22½ | 15¾ | 20¼ | 24 | 27 | 33 |
| 10 | 25 | 17½ | 22½ | 26⅔ | 30 | 36⅔ |
| 11 | 27½ | 19¼ | 24¾ | 29⅓ | 33 | 40⅓ |
| 12 | 30 | 21 | 27 | 32 | 36 | 44 |
| 13 | 32½ | 22¾ | 29¼ | 34⅔ | 39 | 47⅔ |
| 14 | 35 | 24½ | 31½ | 37⅓ | 42 | 51⅓ |
| 15 | 37½ | 26¼ | 33¾ | 40 | 45 | 55 |
| 16 | 40 | 28 | 36 | 42⅔ | 48 | 58⅔ |
| 17 | 42½ | 29¾ | 38¼ | 45⅓ | 51 | 62⅓ |
| 18 | 45 | 31½ | 40½ | 48 | 54 | 66 |
| 19 | 47½ | 33¼ | 42¾ | 50⅔ | 57 | 69⅔ |
| 20 | 50 | 35 | 45 | 53⅓ | 60 | 73⅓ |
| 21 | 52½ | 36¾ | 47¼ | 56 | 63 | 77 |
| 22 | 55 | 38½ | 49½ | 58⅔ | 66 | 80⅔ |
| 23 | 57½ | 40¼ | 51¾ | 61⅓ | 69 | 84⅓ |
| 24 | 60 | 42 | 54 | 64 | 72 | 88 |
| 25 | 62½ | 43¾ | 56¼ | 66⅔ | 75 | 91⅔ |
| 26 | 65 | 45½ | 58½ | 69⅓ | 78 | 95⅓ |
| 27 | 67½ | 47¼ | 60¾ | 72 | 81 | 99 |
| 28 | 70 | 49 | 63 | 74⅔ | 84 | 102⅔ |
| 29 | 72½ | 50¾ | 65¼ | 77⅓ | 87 | 106⅓ |
| 30 | 75 | 52½ | 67½ | 80 | 90 | 110 |
| Width of Sections | | 5⅛" | 6⅓ ₁₆ " | 8⅓ ₃₂ " | 9" | 12" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 23" High Radiators | | | |
|--------------------|---------------------------|--------------------|-----------------------------------|-----------------------------------|---------|
| | | No. of Tubes | | | |
| | | 3 | 4 | 5 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 2 | 2½ | 3 | 3½ |
| 2 | 5 | 4 | 5 | 6 | 7 |
| 3 | 7½ | 6 | 7½ | 9 | 10½ |
| 4 | 10 | 8 | 10 | 12 | 14 |
| 5 | 12½ | 10 | 12½ | 15 | 17½ |
| 6 | 15 | 12 | 15 | 18 | 21 |
| 7 | 17½ | 14 | 17½ | 21 | 24½ |
| 8 | 20 | 16 | 20 | 24 | 28 |
| 9 | 22½ | 18 | 22½ | 27 | 31½ |
| 10 | 25 | 20 | 25 | 30 | 35 |
| 11 | 27½ | 22 | 27½ | 33 | 38½ |
| 12 | 30 | 24 | 30 | 36 | 42 |
| 13 | 32½ | 26 | 32½ | 39 | 45½ |
| 14 | 35 | 28 | 35 | 42 | 49 |
| 15 | 37½ | 30 | 37½ | 45 | 52½ |
| 16 | 40 | 32 | 40 | 48 | 56 |
| 17 | 42½ | 34 | 42½ | 51 | 59½ |
| 18 | 45 | 36 | 45 | 54 | 63 |
| 19 | 47½ | 38 | 47½ | 57 | 66½ |
| 20 | 50 | 40 | 50 | 60 | 70 |
| 21 | 52½ | 42 | 52½ | 63 | 73½ |
| 22 | 55 | 44 | 55 | 66 | 77 |
| 23 | 57½ | 46 | 57½ | 69 | 80½ |
| 24 | 60 | 48 | 60 | 72 | 84 |
| 25 | 62½ | 50 | 62½ | 75 | 87½ |
| 26 | 65 | 52 | 65 | 78 | 91 |
| 27 | 67½ | 54 | 67½ | 81 | 94½ |
| 28 | 70 | 56 | 70 | 84 | 98 |
| 29 | 72½ | 58 | 72½ | 87 | 101½ |
| 30 | 75 | 60 | 75 | 90 | 105 |
| Width of Sections | | 5½" | 6 ¹³ / ₁₆ " | 8 ¹³ / ₃₂ " | 9" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 26" High Radiators | | | | |
|--------------------|---------------------------|--------------------|-----------------------------------|-----------------------------------|---------|---------|
| | | No. of Tubes | | | | |
| | | 3 | 4 | 5 | 6 | 7 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 2½ | 2¾ | 3½ | 4 | 4¾ |
| 2 | 5 | 4¾ | 5½ | 7 | 8 | 9½ |
| 3 | 7½ | 7 | 8¼ | 10½ | 12 | 14¼ |
| 4 | 10 | 9½ | 11 | 14 | 16 | 19 |
| 5 | 12½ | 11¾ | 13¾ | 17½ | 20 | 23¾ |
| 6 | 15 | 14 | 16½ | 21 | 24 | 28½ |
| 7 | 17½ | 16½ | 19¼ | 24½ | 28 | 33¼ |
| 8 | 20 | 18¾ | 22 | 28 | 32 | 38 |
| 9 | 22½ | 21 | 24¾ | 31½ | 36 | 42¾ |
| 10 | 25 | 23½ | 27½ | 35 | 40 | 47½ |
| 11 | 27½ | 25¾ | 30¼ | 38½ | 44 | 52¼ |
| 12 | 30 | 28 | 33 | 42 | 48 | 57 |
| 13 | 32½ | 30½ | 35¾ | 45½ | 52 | 61¾ |
| 14 | 35 | 32¾ | 38½ | 49 | 56 | 66½ |
| 15 | 37½ | 35 | 41¼ | 52½ | 60 | 71¼ |
| 16 | 40 | 37½ | 44 | 56 | 64 | 76 |
| 17 | 42½ | 39¾ | 46¾ | 59½ | 68 | 80¾ |
| 18 | 45 | 42 | 49½ | 63 | 72 | 85½ |
| 19 | 47½ | 44½ | 52¼ | 66½ | 76 | 90¼ |
| 20 | 50 | 46¾ | 55 | 70 | 80 | 95 |
| 21 | 52½ | 49 | 57¾ | 73½ | 84 | 99¾ |
| 22 | 55 | 51½ | 60½ | 77 | 88 | 104½ |
| 23 | 57½ | 53¾ | 63¼ | 80½ | 92 | 109¼ |
| 24 | 60 | 56 | 66 | 84 | 96 | 114 |
| 25 | 62½ | 58½ | 68¾ | 87½ | 100 | 118¾ |
| 26 | 65 | 60¾ | 71½ | 91 | 104 | 123½ |
| 27 | 67½ | 63 | 74¼ | 94½ | 108 | 128¼ |
| 28 | 70 | 65½ | 77 | 98 | 112 | 133 |
| 29 | 72½ | 67¾ | 79¾ | 101½ | 116 | 137¾ |
| 30 | 75 | 70 | 82½ | 105 | 120 | 142½ |
| Width of Sections | | 5½" | 6 ¹³ / ₁₆ " | 8 ¹³ / ₃₂ " | 9" | 12" |

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 30" High Radiators | | | | 32"* |
|--------------------|---------------------------|--------------------|---------|---------|---------|-----------|
| | | No. of Tubes | | | | No. Tubes |
| | | 3 | 4 | 5 | 7 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 3 | 3½ | 4½ | 5½ | 5 |
| 2 | 5 | 6 | 7 | 8½ | 11 | 10 |
| 3 | 7½ | 9 | 10½ | 13 | 16½ | 15 |
| 4 | 10 | 12 | 14 | 17½ | 22 | 20 |
| 5 | 12½ | 15 | 17½ | 21½ | 27½ | 25 |
| 6 | 15 | 18 | 21 | 26 | 33 | 30 |
| 7 | 17½ | 21 | 24½ | 30½ | 38½ | 35 |
| 8 | 20 | 24 | 28 | 34½ | 44 | 40 |
| 9 | 22½ | 27 | 31½ | 39 | 49½ | 45 |
| 10 | 25 | 30 | 35 | 43½ | 55 | 50 |
| 11 | 27½ | 33 | 38½ | 47½ | 60½ | 55 |
| 12 | 30 | 36 | 42 | 52 | 66 | 60 |
| 13 | 32½ | 39 | 45½ | 56½ | 71½ | 65 |
| 14 | 35 | 42 | 49 | 60½ | 77 | 70 |
| 15 | 37½ | 45 | 52½ | 65 | 82½ | 75 |
| 16 | 40 | 48 | 56 | 69½ | 88 | 80 |
| 17 | 42½ | 51 | 59½ | 73½ | 93½ | 85 |
| 18 | 45 | 54 | 63 | 78 | 99 | 90 |
| 19 | 47½ | 57 | 66½ | 82½ | 104½ | 95 |
| 20 | 50 | 60 | 70 | 86½ | 110 | 100 |
| 21 | 52½ | 63 | 73½ | 91 | 115½ | 105 |
| 22 | 55 | 66 | 77 | 95½ | 121 | 110 |
| 23 | 57½ | 69 | 80½ | 99½ | 126½ | 115 |
| 24 | 60 | 72 | 84 | 104 | 132 | 120 |
| 25 | 62½ | 75 | 87½ | 108½ | 137½ | 125 |
| 26 | 65 | 78 | 91 | 112½ | 143 | 130 |
| 27 | 67½ | 81 | 94½ | 117 | 148½ | 135 |
| 28 | 70 | 84 | 98 | 121½ | 154 | 140 |
| 29 | 72½ | 87 | 101½ | 125½ | 159½ | 145 |
| 30 | 75 | 90 | 105 | 130 | 165 | 150 |
| Width of Sections | | 5½" | 6½" | 8½" | 12" | 9" |

*Height of Radiators.

NATIONAL MADE-TO-MEASURE RADIATION CHARTS

Chart No. 1 (cont.)

| Number of Sections | Radiator Length in Inches | 36" High Radiators | | | | 38"* |
|--------------------|---------------------------|--------------------|---------|---------|---------|-----------|
| | | No. of Tubes | | | | No. Tubes |
| | | 3 | 4 | 5 | 7 | 6 |
| | | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. | Sq. Ft. |
| 1 | 2½ | 3½ | 4½ | 5 | 6¾ | 6 |
| 2 | 5 | 7 | 8½ | 10 | 13½ | 12 |
| 3 | 7½ | 10½ | 12¾ | 15 | 20¼ | 18 |
| 4 | 10 | 14 | 17 | 20 | 27 | 24 |
| 5 | 12½ | 17½ | 21¼ | 25 | 33¾ | 30 |
| 6 | 15 | 21 | 25½ | 30 | 40½ | 36 |
| 7 | 17½ | 24½ | 29¾ | 35 | 47¼ | 42 |
| 8 | 20 | 28 | 34 | 40 | 54 | 48 |
| 9 | 22½ | 31½ | 38¼ | 45 | 60¾ | 54 |
| 10 | 25 | 35 | 42½ | 50 | 67½ | 60 |
| 11 | 27½ | 38½ | 46¾ | 55 | 74¼ | 66 |
| 12 | 30 | 42 | 51 | 60 | 81 | 72 |
| 13 | 32½ | 45½ | 55¼ | 65 | 87¾ | 78 |
| 14 | 35 | 49 | 59½ | 70 | 94½ | 84 |
| 15 | 37½ | 52½ | 63¾ | 75 | 101¼ | 90 |
| 16 | 40 | 56 | 68 | 80 | 108 | 96 |
| 17 | 42½ | 59½ | 72¼ | 85 | 114¾ | 102 |
| 18 | 45 | 63 | 76½ | 90 | 121½ | 108 |
| 19 | 47½ | 66½ | 80¾ | 95 | 128¼ | 114 |
| 20 | 50 | 70 | 85 | 100 | 135 | 120 |
| 21 | 52½ | 73½ | 89¼ | 105 | 141¾ | 126 |
| 22 | 55 | 77 | 93½ | 110 | 148½ | 132 |
| 23 | 57½ | 80½ | 97¾ | 115 | 155¼ | 138 |
| 24 | 60 | 84 | 102 | 120 | 162 | 144 |
| 25 | 62½ | 87½ | 106¼ | 125 | 168¾ | 150 |
| 26 | 65 | 91 | 110½ | 130 | 175½ | 156 |
| 27 | 67½ | 94½ | 114¾ | 135 | 182¼ | 162 |
| 28 | 70 | 98 | 119 | 140 | 189 | 168 |
| 29 | 72½ | 101½ | 123¼ | 145 | 195¾ | 174 |
| 30 | 75 | 105 | 127½ | 150 | 202½ | 180 |
| Width of Sections | | 5½" | 6½" | 8½" | 12" | 9" |

*Height of Radiators.



NATIONAL ENGINEERING DATA

Proving Temperature Guarantees in Warm Weather

National Heating Specialists may prove temperature guarantees during warm weather by using the following table prepared by R. C. Carpenter. It is arranged on the basis of proving a 70° house temperature guarantee.

| Outside Temperature at Time of Test | Inside Temperature at Time of Test | Outside Temperature at Time of Test | Inside Temperature at Time of Test |
|-------------------------------------|------------------------------------|-------------------------------------|------------------------------------|
| -10 | 64.7 | 35 | 89.8 |
| - 7.5 | 66.0 | 37.5 | 91.5 |
| - 5 | 67.3 | 40 | 93.1 |
| - 2.5 | 68.7 | 42.5 | 94.5 |
| 0 | 70 | 45 | 95.9 |
| 2.5 | 71.3 | 47.5 | 97.3 |
| 5 | 72.6 | 50 | 98.7 |
| 7.5 | 73.9 | 52.5 | 100.2 |
| 10 | 75.1 | 55 | 101.7 |
| 12.5 | 76.6 | 57.5 | 103.2 |
| 15 | 78 | 60 | 104.7 |
| 17.5 | 79.5 | 62.5 | 106.2 |
| 20 | 81 | 65 | 107.6 |
| 22.5 | 82.4 | 67.5 | 109.1 |
| 25 | 83.8 | 70 | 110.5 |
| 27.5 | 85.2 | 72.5 | 112.2 |
| 30 | 86.5 | 75 | 113.8 |
| 32.5 | 88.2 | 77.5 | 115.4 |
| | | 80 | 117.1 |

Heating tests made in warm weather should be conducted for a period not less than 24 hours.



NATIONAL ENGINEERING DATA

Selecting the Right Boiler for the Job

WHEN selecting a boiler, consideration should be given to the height of the boiler room, the location of inlet to the chimney and the draft intensity and fuel to be used.

If a steam or vapor heating system is to be installed, it is essential that a steam boiler be selected, the water line of which will be from 18 to 30 inches below the low point of the main to take care of the inequality in pressure in the system (see explanation, page 350). National Low Water Line Boilers are particularly well adapted for installation where headroom is at a premium.

If the draft intensity is below normal, a boiler should be selected which does not have an abnormally long fire travel. For instance, if a round boiler is to be installed under these conditions, it is advisable to select a boiler with sufficient rated capacity to carry the radiation and which has only one intermediate section.

If the opening to the chimney is low, and it is impossible to provide a new opening at a higher point, it is advisable to select a boiler, the smoke outlet of which is taken from the rear of the boiler instead of from the top, so that it will not be necessary to pitch the smoke pipe down, which is always bad practice.

If coke is to be used as fuel, a boiler with fire box at least 20" deep should be selected. If high volatile coal is to be used select a smokeless boiler.



NATIONAL ENGINEERING DATA

Radiator Heating Systems— Types and Applications

Generally speaking, there are six accepted types of radiator heating systems:

- (1) Hot water heating system closed—with or without tank.
- (2) Hot water heating system open—with tank.
- (3) One-Pipe Steam Heating System; same pipe carries steam to, and condensate from, the radiator.
- (4) Two-Pipe Steam Heating System; one pipe carries steam to radiator; other pipe carries condensate water from the radiator.
- (5) Vapor Heating System; similar to two-pipe steam system, but operates under very low pressure.
- (6) Vacuum Heating System; air is removed from radiators and piping, usually by means of a pump. System operates at below atmospheric pressure.

NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Hot Water Heating Systems

In hot water heating systems the boiler, radiators and pipes are kept filled with water. The expansion of water when heated sets up a circulation; consequently the warm water rises to the radiators, where the heat is given off. As the water cools, it returns to the boiler, being displaced in the radiator by the incoming hotter water.

Each pound of water in this system gives off one British Thermal Unit (usually written B. T. U., the unit of measurement of heat) for each degree the water cools.

Hot water heating systems differ from all other types of heating systems in that they depend on water to convey the heat from the boilers to the radiators. A hot water heating system consists of: the boiler, the main flow pipe and branches, the radiators, the return pipe and branches, and the expansion or pressure tank. (A relief valve is sometimes used on closed systems, instead of a tank.)

Since water expands when heated, it is necessary to provide for this expansion by attaching a tank or relief valve. The motive force which causes the water to circulate is very low, being equal only to the difference in the


NATIONAL *MADE-TO-MEASURE* HEATING SYSTEMS

Hot Water Heating Systems (continued)

weight of the hotter water in the flow pipe and the weight of the cooler water in the return pipe.

A difference in temperature of 20 degrees produces a weight of less than one-half pound; consequently it is necessary to observe every precaution to reduce friction, avoid air pockets, provide an easy and free flow of water, and apportion the piping so that all radiators are equally supplied. In short, it is necessary to observe the utmost care in calculating pipe sizes (described later) so that the system will be "balanced", which is necessary for proper operation.


Hot water heating systems have been favorably looked upon because of their even heating qualities—that is, once the water is heated and in circulation, the radiators continue to give off warmth, even though the fire burns low. An added advantage is that in mild weather a light fire will keep the water in circulation at a temperature as low as 80° to 100°, thereby furnishing very mild warmth. The even heating qualities of hot water systems are further improved when automatic damper regulation is part of the equipment.

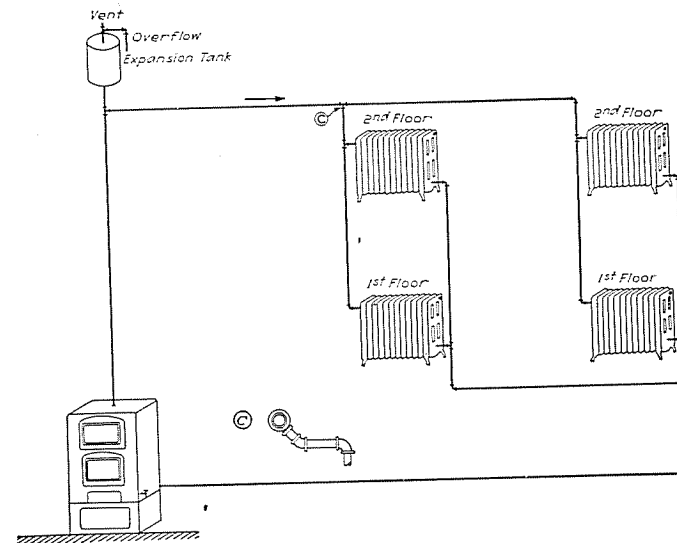

HOT WATER OPEN SYSTEM—1 PIPE OVERHEAD

Hot Water Open System— One-Pipe Overhead

ONE-PIPE overhead hot water open systems are used in buildings where there is limited cellar space and in installations where the boiler is placed on the same floor level as the lowest radiators. The supply main is then run to the roof space, and drop risers taken from this main to the radiators. An air valve is placed on high point of main, if the expansion tank is not located so that air will vent freely through the tank.

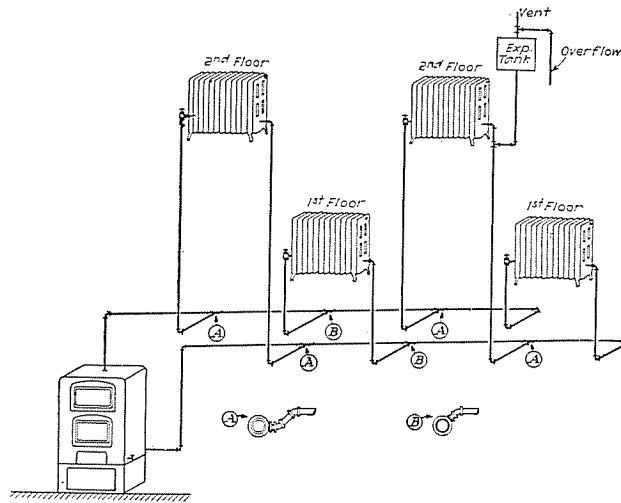


HOT WATER OPEN SYSTEM—2 PIPE UPFEED
SHOWING SEPARATE SETS OF RISERS TO EACH RADIATOR

Hot Water Open System—Two-Pipe Upfeed

TWO-PIPE upfeed hot water systems are used in most normal situations. They consist of a main feed pipe supplying hot water to radiators and a return main pipe which returns the cooler water to the boiler for re-heating. Air valves are placed on all radiators at the top of the return end.

These two diagrams show two methods of piping the radiators for an open hot water system.


Note that in these, and the other diagrams of Hot Water Heating Systems, recommended connections are shown, designated by a letter. The points at which these connections should be installed are indicated by corresponding letters. Complete descriptions of the connections, and reasons for their use, are given on pages 336-337.

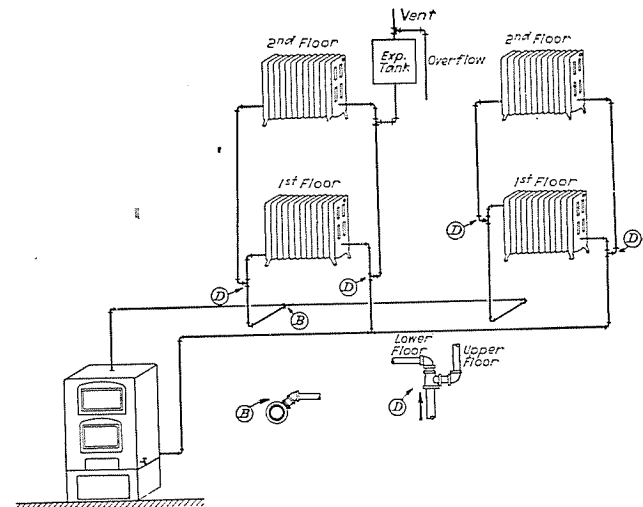

HOT WATER OPEN SYSTEM—2 PIPE UPFEED
SHOWING FIRST AND SECOND FLOOR RADIATORS CONNECTED TO THE SAME SUPPLY AND RETURN RISERS

Closed Hot Water Heating Systems

THE closed hot water heating system has no expansion tank open to the atmosphere. The entire system is so designed that the water has no access to the atmosphere except through a pressure relief valve. The purpose of such an arrangement is to provide a pressure (generally 10 pounds) greater than atmospheric pressure. The advantage of this pressure lies in the increased temperature secured before the boiling point is reached. Water at sea level atmospheric pressure boils at 212°, but at 10 pounds gauge pressure it does not boil until it reaches a temperature of 239.4°. This greater temperature provides greater heat for each pound of water. It permits installing smaller pipe sizes. The temperature of the hot water in radiators in a closed hot water heating system is generally higher than the temperature of the water in a gravity or open system.

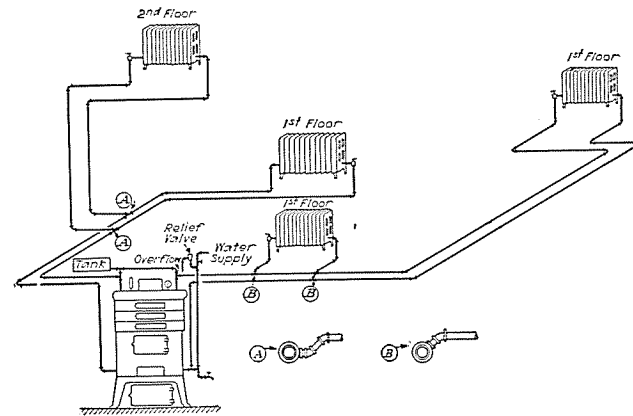

CLOSED HOT WATER HEATING SYSTEM WITH TANK IN BASEMENT

The diagram above shows a typical installation of this character.

Note that in these, and the other diagrams of Hot Water Heating Systems, recommended connections are shown, designated by a letter. The points at which these connections should be installed are indicated by corresponding letters. Complete descriptions of the connections, and reasons for their use, are given on pages 336-337.

Hot Water Pipe Connections

THE natural tendency of hot water is to flow upward, and if the same type of connections from the mains to the risers are used on first floor risers and upper floor risers, the upper floor radiators will be "favored"; that is, practically all of the flow will pass through the upper floor radiators, and there will be very little if any circulation through the first floor radiators.


To avoid this condition, riser connections to upper floor radiators are taken from side of main and lower floor radiators from the top of main. An exception to this is an unusually large radiator located near the boiler on the first floor, the connection to which is usually taken from the side of the main, to prevent this large radiator from taking the entire flow.

Especial care should be taken to ream the ends of all pipes, as burrs left on the inside of the pipe will reduce the pipe area, and restrict the circulation. Eccentric reducing fittings should be used when reducing the size of main. Care should be taken to have the straight side of the fitting on the upper side of the flow main, and on the bottom side of the return main.

The following connections are recommended for use with hot water heating systems and should be carefully studied and followed in laying out an installation:


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Connection A is used when supplying risers to upper floors and for large first-floor radiators. It should not be used after a reduction in the size of the main occurs, as an air pocket might be formed.




A

Connection B is used for the last riser before a main is reduced in size and for first-floor radiators located at some distance from the boiler. One of the objects of the B connection is to vent the main pipe when a reduction is made.




B

Connection C is used only when radiators are located below the main, as in overhead piping systems.




C

Connection D is the proper method of taking off branches from a riser when same is to be extended to a higher floor. The second floor radiator should be taken from the top opening of the tee and the third floor riser should connect to the side opening.



D

Connection E is the correct method of supplying from one riser two radiators that are located on the same floor. The connection to the larger radiator should be taken from the top opening of the tee, and the connection to the smaller radiator should be taken from the side.



E

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Balancing an Open Hot Water Heating System

It is important that a hot water heating system be carefully balanced in order that all radiators will be supplied with the proper amount of hot water. By using the following tables the proper sizes of risers and mains may be accurately determined. Chart No. 2 shows the required nominal riser pipe sizes in inches for radiators located varying distances, up to 100 feet, above the boiler. *Note:* Radiation figures given are maximum; that is, a $\frac{3}{4}$ inch pipe will supply 1 to 40 feet of radiation located 10 feet above boiler. A 1-inch pipe will supply 41 to 70 feet; and so on.

Chart No. 2 - Pipe Sizes for Open Hot Water Heating System

| Nominal Pipe Size Required—Inches | Distance of Radiators above boiler in feet. | | | | | | | | | |
|-----------------------------------|---|-----|-----|-----|-----|-----|-----|-----|-----|------|
| | 10' | 20' | 30' | 40' | 50' | 60' | 70' | 80' | 90' | 100' |
| | Square Feet of Radiation Allowable | | | | | | | | | |
| $\frac{3}{4}$ " | 40 | 50 | 60 | 70 | 80 | 90 | 100 | 110 | 120 | 135 |
| 1" | 70 | 80 | 90 | 100 | 110 | 120 | 130 | 140 | 150 | 160 |
| $1\frac{1}{4}$ " | 110 | 120 | 135 | 150 | 160 | 175 | 185 | 200 | 210 | 225 |
| $1\frac{1}{2}$ " | 180 | 195 | 210 | 230 | 250 | 265 | 285 | 300 | 315 | 330 |
| 2" | 300 | 350 | 400 | 500 | 575 | 625 | 700 | 775 | 825 | 900 |

Examples of application of chart. (Open Tank Hot Water Heating System).

Example: What size riser will be required to supply 120 square feet of hot water radiation on the 4th floor 60 feet above boiler?

Solution: In column headed 60 feet the second figure is 120; carry across to first column and 1" pipe is found to be the required size.

Example: If the above 120 sq. ft. of radiation is on the second floor 20 feet above boiler, what size riser will be required?

Solution: Opposite 120 in column headed 20 feet is noted $1\frac{1}{4}$ " pipe, the required size.

Determination of Correct Size of Main—Hot Water Heating System

To determine the size of main required to take care of various branches, select from the table below the factor for each branch; add them together; the total gives the factor for the main. The size of the required main is shown at the top of the column.

Chart No. 3

Factors to be Used in Proportioning Sizes of Mains

| Nominal Size of Pipe—Inches | $\frac{3}{4}$ | 1 | $1\frac{1}{4}$ | $1\frac{1}{2}$ | 2 | $2\frac{1}{2}$ | 3 | 4 | 5 | 6 | 8 |
|-----------------------------|---------------|----|----------------|----------------|----|----------------|-----|-----|-----|------|------|
| | 5 | 10 | 20 | 30 | 60 | 110 | 175 | 380 | 650 | 1050 | 2250 |
| | Factor | | | | | | | | | | |

Example: What size main will be required to supply 5- $\frac{3}{4}$ " risers, 4-1" risers and 5- $1\frac{1}{4}$ " risers?

Solution: The factor for $\frac{3}{4}$ " is 5, there are 5 risers— $5 \times 5 = 25$

The factor for 1" is 10, there are 4 risers— $10 \times 4 = 40$

The factor for $1\frac{1}{4}$ " is 20, there are 5 risers— $20 \times 5 = 100$

Total 165

Follow across factor column until the number 165, or the next greater number (which is 175) is reached. The pipe size listed directly above—3 inches—is the size of main required.

NATIONAL ENGINEERING DATA

Balancing a Closed Hot Water System

IT is essential that closed hot water systems be carefully balanced in order that all radiators be supplied with a proper amount of hot water. By using the following tables, the proper sizes of risers and mains may be accurately determined. In Chart No. 4 are shown the various pipe sizes for the various square feet of radiation for each floor of a four story building.

In order to determine the proper pipe size for each situation, simply locate the number of square feet of radiation under the proper floor location (or the number next greater). The figures in the first left hand column in the same line will indicate the pipe size to be used.

Chart No. 4—Pipe Sizes for Closed Hot Water Heating Systems

| Pipe Size—Inches | First Floor | Second Floor | Third Floor | Fourth Floor |
|------------------|----------------------|----------------------|----------------------|----------------------|
| | Sq. Ft. of Radiation | Sq. Ft. of Radiation | Sq. Ft. of Radiation | Sq. Ft. of Radiation |
| 1/2" | 30 | 40 | 50 | 60 |
| 3/4" | 60 | 75 | 90 | 110 |
| 1" | 110 | 120 | 135 | 150 |
| 1 1/4" | 165 | 180 | 200 | 225 |
| 1 1/2" | 270 | 290 | 315 | 350 |
| 2" | 450 | 525 | 600 | 750 |

Example: What size riser will be required to supply 120 square feet of hot water radiation on the 1st floor.

Solution: In column headed first floor, 120 does not appear. The next greater number is 165. Therefore, the pipe size corresponding to 165—1 1/4 inch—should be selected.

Example: If above radiation is on 2nd floor, what size pipe will be required?

Solution: Under column headed second floor and opposite 120, a 1" pipe is listed and will be required.


NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Steam Heating Systems

One-Pipe Steam System

A ONE-PIPE steam heating system is the least expensive type of radiator installation. Ordinarily a pressure of about 2 pounds is maintained. The pipe leading to the radiators is used also for a return for the condensate. Each radiator is equipped with an air and a steam valve. The mains should be pitched down, in the direction of the flow of steam, and all branches should pitch down toward riser or main to permit the return of condensate. Supply main should drop into a wet return. (A Wet Return is a pipe located below the boiler water line, usually at basement floor level, which returns the condensate to the boiler.) It is good practice to have the vent placed on the far end of the supply main so that any air in the system will be promptly expelled. A high grade air valve on each radiator will add materially to the proper functioning of the system. See pages 353 to 359 for recommended connections.

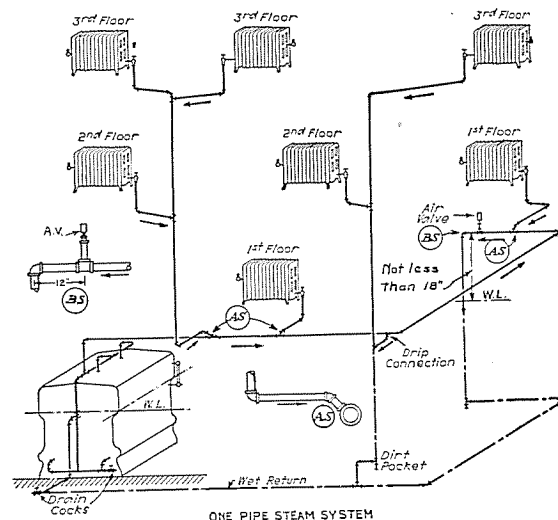

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

NATIONAL ENGINEERING DATA

Determination of Correct Size of Main—
One-Pipe Steam Systems

It is recommended that care be used in selecting the proper size and arrangement of piping. Chart No. 5, prepared and copyrighted by the American Society of Heating and Ventilating Engineers and the Heating and Piping Contractors National Association, shows the various pipe sizes for meeting various one-pipe gravity low pressure steam heating system requirements.

Chart No. 5 shows correct pipe sizes for one-pipe gravity low pressure steam heating systems where equivalent length of run from boiler or source of supply to the farthest radiator does not exceed 200 feet. The capacities in square feet of equivalent radiation are shown in columns B to G inclusive opposite the correct pipe sizes for the various conditions encountered.

Chart No. 5

| Pipe Size Inches | Supply Main Dripped and Branches to Risers Dripped Steam and Condensate Flowing in the same direction | Supply Risers Up-Feed | Branches to Supply Risers and Radiators Not Dripped | Wet Return Main | Dry Return Main | Radiator Valve Sizes and Vertical Connections |
|------------------|---|-----------------------|---|-----------------|-----------------|---|
| A | B | C | D* | E | F | G |
| 3/4 | .. | 25 | .. | .. | .. | .. |
| 1 | 56 | 45 | 20 | 700 | 320 | 20 |
| 1 1/4 | 122 | 98 | 55 | 1200 | 670 | 55 |
| 1 1/2 | 190 | 152 | 81 | 1900 | 1053 | 81 |
| 2 | 386 | 288 | 165 | 4000 | 2300 | 165 |
| 2 1/2 | 635 | 464 | 260 | 6700 | 3800 | .. |
| 3 | 1163 | 799 | 475 | 10,700 | 7000 | .. |
| 4 | 2457 | 1520 | 1110 | .. | .. | .. |
| 5 | 4546 | .. | 2180 | .. | .. | .. |
| 6 | 7462 | .. | .. | .. | .. | .. |

Copyright, 1927 } American Society of Heating & Ventilating Engineers—
Heating & Piping Contractors National Association
Not to be reprinted without special permission.

*Radiator branches more than 8 feet in length should be one size larger than shown in Column D.

Note 1—These tables apply where pipes are properly reamed. No allowances for defective material or workmanship have been made.

Note 2—Capacities based on 1/4 lb. condensation per square foot per hour equivalent radiation and on actual diameter of standard pipe.

Note 3—Extra length to be added to straight run of pipe, for various fittings and valves to determine equivalent length. (See chart 9.)

Note 4—Where it is necessary to drip a steam main, branch to riser, or risers, same should be dripped separately into wet return.


Note 5—Pitch of mains should be not less than 1/4 inch in 10 feet; on horizontal branches to radiators and risers should pitch at least 1/2 inch in 10 feet.

NATIONAL ENGINEERING DATA

Two-Pipe Steam System

The two-pipe steam heating system employs two pipes—one pipe leading from the boiler supplying steam to the radiator, and one pipe leading from the radiator returning condensate to the boiler. The return line drops into a wet return. A pressure of 2 to 5 pounds is generally carried. The radiator branches should pitch downward from the radiators. The riser branches should pitch downward toward the main. Each radiator is equipped with a valve on both supply and return ends; also with an air valve on the return end. It is good practice to place an air valve on the far end of the main for the expulsion of any air in the main.

The diagram below shows a typical two-pipe steam heating system. See pages 353 to 359 for recommended connections.

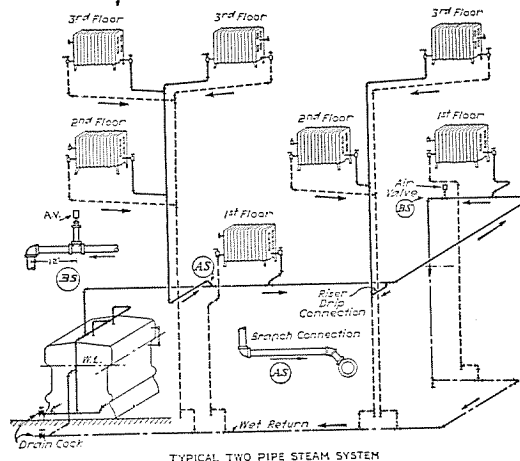

TYPICAL TWO PIPE STEAM SYSTEM

NATIONAL ENGINEERING DATA

Determination of Correct Size of Main

Two-Pipe Steam Heating System

Care must also be exercised in selecting the proper size and arrangement of piping in the two-pipe system. Chart No. 6 shows the correct pipe sizes for two-pipe gravity low pressure steam heating systems where equivalent length of run from boiler or source of supply to the farthest radiator does not exceed 200 feet. The capacities in square feet of equivalent radiation are shown in columns B to I inclusive opposite the correct pipe sizes for the various conditions encountered.

Chart No. 6

| Pipe Sizes Inches | Supply Main Dripped and Branches to Risers Dripped Steam and Condensate Flowing in same Direction | Supply Risers Up-Feed | Branches to Supply Risers and Radiators Not Dripped | Return Risers | Wet Return Main | Dry Return Main | Radiator Supply Valve | Radiator Return Valve |
|-------------------|---|-----------------------|---|---------------|-----------------|-----------------|-----------------------|-----------------------|
| A | B | C | D* | E | F | G | H | I |
| 3/4 | ... | 30 | ... | 122 | ... | ... | 30 | 122 |
| 1 | 56 | 56 | 26 | 320 | 700 | 320 | 56 | 190 |
| 1 1/4 | 122 | 122 | 58 | 670 | 1200 | 670 | 122 | 386 |
| 1 1/2 | 190 | 190 | 95 | 1058 | 1900 | 1058 | 190 | ... |
| 2 | 386 | 386 | 195 | 2300 | 4000 | 2300 | 386 | ... |
| 2 1/2 | 635 | 635 | 395 | 3800 | 6700 | 3800 | ... | ... |
| 3 | 1163 | 1129 | 700 | 7000 | 10,700 | 7000 | ... | ... |
| 4 | 2457 | 2042 | 1700 | ... | ... | ... | ... | ... |
| 5 | 4546 | ... | 3150 | ... | ... | ... | ... | ... |
| 6 | 7462 | ... | ... | ... | ... | ... | ... | ... |

Copyright, 1927 (American Society of Heating & Ventilating Engineers—
Heating & Piping Contractors National Association
Not to be reprinted without special permission.)

*Radiator branches more than 8 feet in length should be one size larger than shown in Column D.

Note 1—These tables apply where pipes are properly reamed. No allowances for defective material or workmanship have been made.

Note 2—Capacities based on 1/4 lb. condensation per square foot per hour equivalent radiation and on actual diameter of standard pipe.

Note 3—Extra length to be added to straight run of pipe for various fittings and valves to determine equivalent length. (See chart 9, page 349.)

Note 4—Where it is necessary to drip a supply main, supply riser or branch to a supply riser, same should be dripped separately into a wet return or through an adequate seal into a dry return. Never drip a supply pipe into a dry return except through an adequate seal.


Note 5—Pitch of main should not be less than 1/4 inch in 10 feet; on horizontal branches to radiators, and risers at least 1/2 inch in 10 feet.

NATIONAL ENGINEERING DATA

Vapor Heating Systems

Two-Pipe Gravity Vapor System

The vapor system is similar to the two-pipe steam system only so far as the supply and return lines are concerned. Each radiator is supplied through a graduating valve, attached to the top connection of the radiator. A trap is connected on the return side at the bottom. The return risers and branches are collected into a dry return. (A dry return is a pipe located preferably 18 inches or more above the boiler water line, which returns the condensate to the receiver.) This dry return connects to a receiver near the boiler. This receiver eliminates air, and allows the condensate to drop into the wet return. This system operates at atmospheric pressure, or under a slight vacuum. There are no air valves on the radiators. The air in the system is eliminated through air valves placed on the receiver and mains.

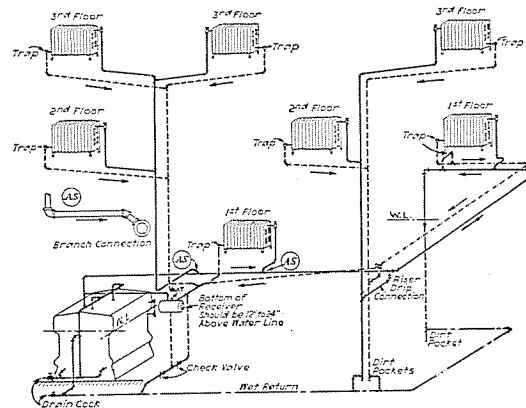

TYPICAL TWO PIPE GRAVITY VAPOR SYSTEM WITH RECEIVER

Determination of Correct Sizes of Risers and Main Two-Pipe Gravity Vapor Heating Systems

Care must be used in selecting the proper size and arrangement of piping in this installation. Chart No. 7 shows the correct pipe sizes for two-pipe gravity type vapor heating systems where equivalent length of run from boiler or source of supply to the farthest radiator does not exceed 200 feet. The capacities in square feet of equivalent radiation are shown opposite the correct pipe sizes for the various conditions encountered.

Chart No. 7

| Pipe Size Inches | Supply Main Dripped and Branches to Risers Dripped Steam and Condensate flowing in same direction | Supply Risers Up-Feed | Branches to Supply Risers and Radiators Not Dripped | Return Risers | Wet Return Main | Dry Return Main |
|------------------|---|-----------------------|---|---------------|-----------------|-----------------|
| A | B | C | D* | E | F | G |
| 3/4 | .. | 30 | .. | 190 | .. | .. |
| 1 | 56 | 56 | 26 | 450 | 700 | 320 |
| 1 1/4 | 122 | 122 | 58 | 990 | 1200 | 670 |
| 1 1/2 | 190 | 190 | 95 | 1500 | 1900 | 1058 |
| 2 | 386 | 386 | 195 | 3000 | 4000 | 2300 |
| 2 1/2 | 635 | 635 | 395 | .. | 6700 | 3800 |
| 3 | 1163 | 1129 | 700 | .. | 10,700 | 7000 |
| 4 | 2457 | 2042 | 1700 | .. | .. | .. |
| 5 | 4546 | .. | 3150 | .. | .. | .. |
| 6 | 7462 | .. | .. | .. | .. | .. |

Different makes of supply and return valves, steam traps, and other specialties vary as to capacity, therefore use size as recommended by manufacturer for any particular make. Vertical connections to be of same size as valve and trap used. Return horizontal runout to be not less than 3/4 inch.

Copyright, 1927 } American Society of Heating and Ventilating Engineers—
Heating and Piping Contractors National Assn.
Not to be reprinted without special permission.

*Radiator branches more than 8 feet in length should be one size larger than shown in Column D.

This table is for systems which are open to atmosphere or operate under slight pressure or partial vacuum without use of vacuum pumps.

Note 1—These tables apply where pipes are properly reamed. No allowances for defective material or workmanship have been made.

Note 2—Capacities based on 1/4 lb. condensation per square foot per hour equivalent radiation and on actual diameter of standard pipe.

Note 3—Extra length to be added to straight run of pipe for various fittings and valves to determine equivalent length. (See chart 9, page 349.)

Note 4—Where it is necessary to drip a supply main, supply riser or branch to a supply riser, same should be dripped separately into a wet return. The drip for a vapor or vacuum system may be taken into a dry return through a steam trap.

Note 5—Pitch of mains should be not less than 1/4 inch in 10 feet; on horizontal branches to radiators and risers should pitch at least 1/2 inch in 10 feet.

Vacuum Heating System with Pump

The vacuum heating system employing a pump is very similar to the vapor system, except that the receiver above the water line is omitted. A vacuum pump located below the water line receives all condensate, forces it back into the boiler, and at the same time eliminates air from the system. The pump creates and maintains a vacuum on the return line. Each radiator is supplied with an inlet valve on one end and a trap on the opposite end. Vacuum heating systems are generally used on large installations.

The diagram below shows a typical vacuum heating system installation with pump.

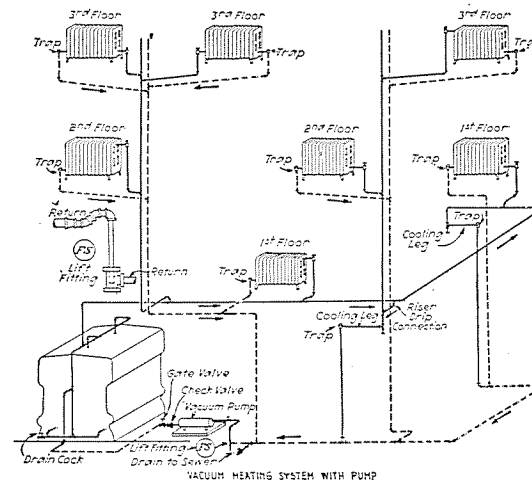


Chart No. 8—Determination of Correct Sizes of Riser and Main Vacuum Heating System with Pump

Core must be used in selecting the proper size and arrangement of piping in installations of this type. This chart shows the correct pipe sizes for a vacuum heating system with pump where equivalent length of run from boiler or source of supply to the farthest radiator does not exceed 600 feet. The capacities in square feet of equivalent radiation for supply mains are shown in columns B to G inclusive opposite the correct pipe sizes for the various conditions encountered.

| Pipe Size In. | Equivalent Length of Pipe from Boiler to Farthest Radiator, Including Main and Riser. (See Note 4) | | | | | | Maximum Capacities | | Pipe Size Inches | | Return Mains and Risers | | | | | | |
|---------------|---|---------|---------|---------|---------|---------|-----------------------|---|------------------|--------|-------------------------|--------|--------|-------|-------|-------|---|
| | Supply Main Dripped and Branches to Risers Dripped—Steam and Condensate flowing in same direction. Based on 4 oz. Total Pressure Drop** | | | | | | Supply Risers Up Feed | Branches to Supply Risers and Radiators Not Dripped | Riser/Main | J | K | L | M | N | O | P | Q |
| | 100 Ft. | 200 Ft. | 300 Ft. | 400 Ft. | 500 Ft. | 600 Ft. | H | I# | J | K | L | M | N | O | P | Q | |
| | A | B | C | D | E | F | G | | | | | | | | | | |
| 3/4" | 111 | 79 | 65 | 56 | 49 | 46 | 56 | 26 | 3/4 | 800 | 568 | 462 | 400 | 358 | 326 | 306 | |
| 1" | 245 | 173 | 141 | 122 | 110 | 100 | 122 | 58 | 1 1/4 | 1400 | 994 | 810 | 700 | 626 | 570 | 526 | |
| 1 1/4" | 380 | 269 | 220 | 190 | 165 | 152 | 180 | 85 | 1 1/2 | 2400 | 1704 | 1387 | 1200 | 1073 | 976 | 906 | |
| 2" | 771 | 546 | 446 | 386 | 348 | 318 | 385 | 195 | 2 1/2 | 3800 | 2696 | 2195 | 1900 | 1698 | 1547 | 1436 | |
| 2 1/2" | 1270 | 898 | 734 | 633 | 560 | 518 | 595 | 395 | 3 | 8000 | 5680 | 4622 | 4000 | 3575 | 3256 | 3006 | |
| 3" | 2326 | 1648 | 1362 | 1197 | 1059 | 978 | 1150 | 700 | 3 1/2 | 13400 | 9510 | 7745 | 6700 | 5990 | 5453 | 5016 | |
| 3 1/2" | 3714 | 2757 | 2302 | 1977 | 1757 | 1592 | 1848 | 1150 | 4 | 21400 | 15190 | 12460 | 10700 | 9565 | 8710 | 8020 | |
| 4" | 5092 | 3744 | 3157 | 2828 | 2457 | 2211 | 2042 | 1700 | 4 1/2 | 32000 | 22710 | 18490 | 16000 | 14300 | 13020 | 12020 | |
| 5" | 9024 | 6553 | 5459 | 4566 | 4069 | 3714 | 3150 | 3150 | 5 | 44000 | 31220 | 25430 | 22000 | 19660 | 17910 | 16410 | |
| 6" | 12666 | 9267 | 7635 | 6333 | 5566 | 5094 | 4304 | 4304 | 6 | 60000 | 42810 | 34620 | 30000 | 26660 | 24310 | 22410 | |
| 8" | 21666 | 15667 | 12915 | 10833 | 9566 | 8694 | 7304 | 7304 | 8 | 100000 | 69810 | 56620 | 48000 | 42660 | 39310 | 36410 | |
| 10" | 31666 | 22667 | 18915 | 16033 | 14266 | 13094 | 11004 | 11004 | 10 | 140000 | 97810 | 79620 | 67000 | 59660 | 54310 | 50410 | |
| 12" | 41666 | 30667 | 25415 | 21433 | 18966 | 17294 | 14704 | 14704 | 12 | 180000 | 129810 | 105620 | 89000 | 78660 | 72310 | 67410 | |
| 14" | 51666 | 38667 | 31915 | 26933 | 23666 | 21694 | 18104 | 18104 | 14 | 220000 | 159810 | 129620 | 109000 | 95660 | 88310 | 82410 | |

#Radiator branches more than 8 feet in length should be one size larger than shown in Column I.
 **It is not generally considered good practice to greatly exceed 1 ounce drop in pressure in each 100 feet equivalent length of run nor to exceed 1 pound total pressure drop in any system.
 Note 1—These tables apply where pipes are properly reamed. No allowances for defective material or workmanship have been made.
 Note 2—Capacities based on 1/4 pound condensation per square foot per hour equivalent radiation and on actual diameter of standard pipe.
 Note 3—Extra length to be added to straight run of pipe, for various fittings and valves to determine equivalent length. See chart 9, below.
 Note 4—Mains are to be proportioned according to the equivalent length of run from the boiler or source of supply to the farthest radiators supplied by the main.
 Determine equivalent length of run, then use figures in corresponding Column (B to G) for sizing the entire run.
 Supply risers are to be proportioned according to the equivalent length of run from the boiler or source of supply to the farthest radiator on each riser. Determine the distance to the farthest radiator, then use figures in that corresponding Column (B to G) for sizing each riser; provided the amount of radiation for that riser does not exceed amounts shown in Column H. Where riser capacities are found to be in excess of amounts shown in Column H, step up to necessary size indicated in that column.
 Note 5—Return mains and risers are to be proportioned according to the equivalent distance in feet, from farthest radiator to the vacuum pump, using capacities in that corresponding column (L to Q) for sizing entire return riser (Column J) and return main (Column K). The return pipe sizes are conservative and are subject to revision, upon the completion of pending research investigations.
 Note 6—Where it is necessary to drip a supply main, supply riser or branch to a supply riser, same should be dripped separately through a steam trap into vacuum return. Never drip a supply riser into a vacuum return except through a steam trap.
 Note 7—Lift fittings. See page 356.

Notes—Vacuum Heating System with Pump


**It is not generally considered good practice to greatly exceed 1 ounce drop in pressure in each 100 feet equivalent length of run nor to exceed 1 pound total pressure drop in any system.

Note 1—These tables apply where pipes are properly reamed. No allowances for defective material or workmanship have been made.
 Note 2—Capacities based on 1/4 pound condensation per square foot per hour equivalent radiation and on actual diameter of standard pipe.
 Note 3—Extra length to be added to straight run of pipe, for various fittings and valves to determine equivalent length. See chart 9, below.
 Note 4—Mains are to be proportioned according to the equivalent length of run from the boiler or source of supply to the farthest radiators supplied by the main.
 Determine equivalent length of run, then use figures in corresponding Column (B to G) for sizing the entire run.
 Supply risers are to be proportioned according to the equivalent length of run from the boiler or source of supply to the farthest radiator on each riser. Determine the distance to the farthest radiator, then use figures in that corresponding Column (B to G) for sizing each riser; provided the amount of radiation for that riser does not exceed amounts shown in Column H. Where riser capacities are found to be in excess of amounts shown in Column H, step up to necessary size indicated in that column.
 Note 5—Return mains and risers are to be proportioned according to the equivalent distance in feet, from farthest radiator to the vacuum pump, using capacities in that corresponding column (L to Q) for sizing entire return riser (Column J) and return main (Column K). The return pipe sizes are conservative and are subject to revision, upon the completion of pending research investigations.
 Note 6—Where it is necessary to drip a supply main, supply riser or branch to a supply riser, same should be dripped separately through a steam trap into vacuum return. Never drip a supply riser into a vacuum return except through a steam trap.
 Note 7—Lift fittings. See page 356.

Chart No. 9

Length in Feet of Pipe to be Added to Actual Length of Run to Obtain Equivalent Length

| Size of Pipe | St'd Elbow | Side Outlet Tee | Length in Feet to be Added in Run | | |
|--------------|------------|-----------------|-----------------------------------|-------------|-------------|
| | | | Gate Valve | Globe Valve | Angle Valve |
| 2" | 5 | 16 | 2 | 18 | 9 |
| 2 1/2" | 7 | 20 | 3 | 25 | 12 |
| 3" | 10 | 26 | 3 | 33 | 16 |
| 4" | 14 | 35 | 5 | 45 | 22 |
| 5" | 18 | 44 | 7 | 57 | 28 |
| 6" | 22 | 50 | 9 | 70 | 32 |
| 7" | 26 | 55 | 10 | 82 | 37 |
| 8" | 31 | 63 | 12 | 94 | 42 |
| 9" | 35 | 69 | 13 | 105 | 47 |
| 10" | 39 | 76 | 15 | 118 | 52 |
| 12" | 47 | 90 | 18 | 140 | 63 |
| 14" | 53 | 105 | 20 | 160 | 72 |

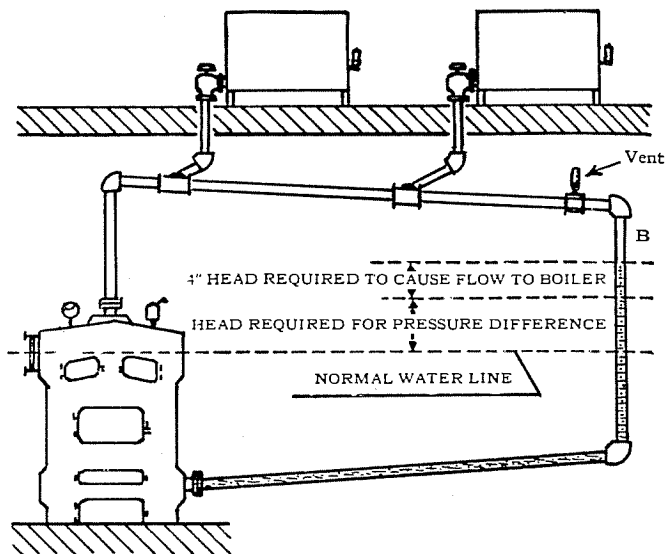

Causes and Prevention of Water Line Trouble

A frequent cause of trouble in a steam system is insufficient distance between the water line in the boiler and the low point of the main. The end of the supply main should be at least 18 inches above the normal water line of the boiler and in vapor systems 24 to 30 inches is recommended.

The diagram above represents a typical system. Assume that two pounds gauge pressure is developed at the boiler. If there were no pressure loss in the piping, the pressure would be two pounds at end of main "B", as well as at the boiler, and the water level at these points would be the same. But in all steam systems there is a loss in pressure between the boiler and the end of the supply main, due to friction, heat loss in the piping, and steam consumed by radiators. This loss results in a

lower pressure at "B" than in the boiler. The condensation will therefore build up in the piping above the water level in the boiler until it reaches a height where the difference in "head," or level, is sufficient to compensate for the difference in pressure existing in the boiler and at point "B". A difference in level of approximately 28 inches will compensate for 1 pound difference in pressure (1.732 inches per ounce). Therefore, the height the water will rise at any point in the piping system will be equal to the difference in pressure in pounds multiplied by 28 inches (or ounces multiplied by 1.732 inches.)


In the typical example, assume that the pressure at the boiler is 2 pounds and that at "B" it is $1\frac{1}{2}$ pounds. The pressure difference at "B" will then be $2 - 1\frac{1}{2} = \frac{1}{2}$ pound. The resulting head which will build up at this point will then be $\frac{1}{2} \times 28" = 14$ inches. This head of 14 inches merely compensates for the pressure difference at the boiler and at end of main or point "B", and an additional head of at least 4 inches is required to establish a flow of water back into the boiler.

Since a pressure difference of $\frac{1}{2}$ pound is not at all unusual and since this difference in pressure requires a water head of 14 inches to equalize, it is obviously important to have the end of the supply main or any drip points in a steam system at least 18 inches ($14 + 4$) above the normal water line of the boiler, otherwise, the end of the supply main or drip points may be flooded, and steam distribution to some of the radiators prevented.

In a vapor system, as there is no steam pressure in the returns (due to the closing of the thermostatic traps when steam strikes them) the difference between the pressure in the boiler and the pressure in the return at the end of the steam main is proportionately greater, and the water will build up to a higher level.

It is therefore advisable to have a difference of from 24 to 30 inches between the low end of the steam main and the normal water level in the boiler.

Hartford Return Connections as Applied to Two Boilers in a Battery, and as Applied to a Single Boiler

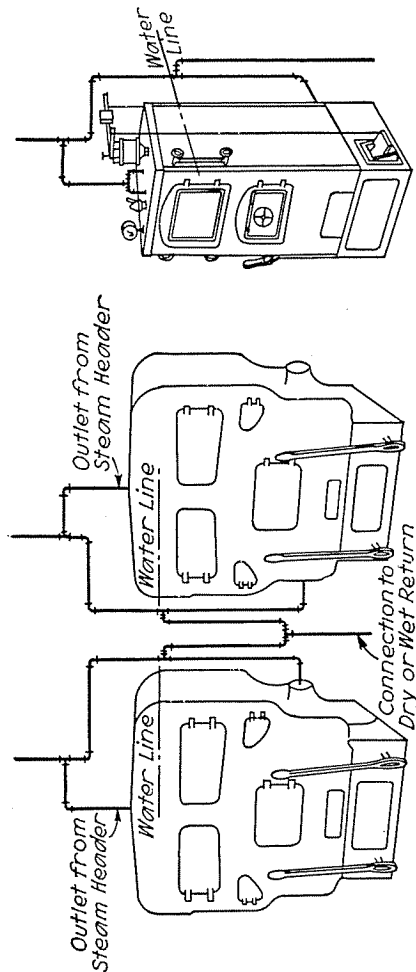

This method of connecting the return with the boiler eliminates the necessity for check valves, and is recommended by the insurance companies. It is rapidly becoming standard practice.

Note: The top of the connection from wet return into the equalizer and drip pipe should be one inch below the water line of the boiler.

Recommended Steam Connections


Radiators—Risers—Mains

For a smoothly operating steam system, the connections between mains, return and equipment are extremely important. The following diagrams will be of value in helping to make the systems work smoothly.

Angle Fittings

To find pipe measurements when angle and one side are known.

To find center of hole and length of pipe—center to center—when angle of fitting (Col. 1) is known, and one side or offset.

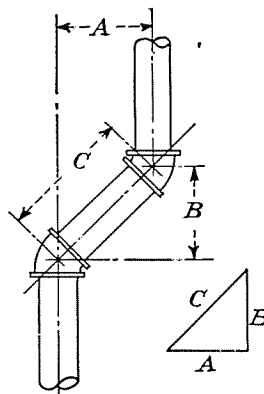


| Fitting Used—Degrees | Length of "B" When A=1. | Length of "A" When B=1. | Length of "C" When offset=1. |
|----------------------|-------------------------|-------------------------|------------------------------|
| 67½ | 0.4142 | 2.414 | 1.0824 |
| 60 | 0.5773 | 1.732 | 1.1547 |
| 45 | 1.0000 | 1.000 | 1.4142 |
| 30 | 1.732 | 0.5773 | 2.0000 |
| 22½ | 2.414 | 0.4142 | 2.6131 |
| 11¼ | 5.027 | 0.1989 | 5.1258 |
| 5⅝ | 10.168 | 0.0983 | 10.2170 |

Example: With 30° fittings, how long must "C" be to give an offset (A) of 15 inches.


Solution: In last column, opposite the 30° fitting, length of "C" when offset is 1 is 2.00. Since offset is 15", "C" equals 15 x 2 = 30 in.

NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)

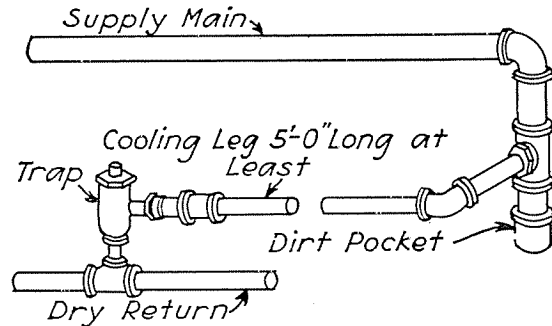



DRIPPING END OF MAIN INTO DRY RETURN

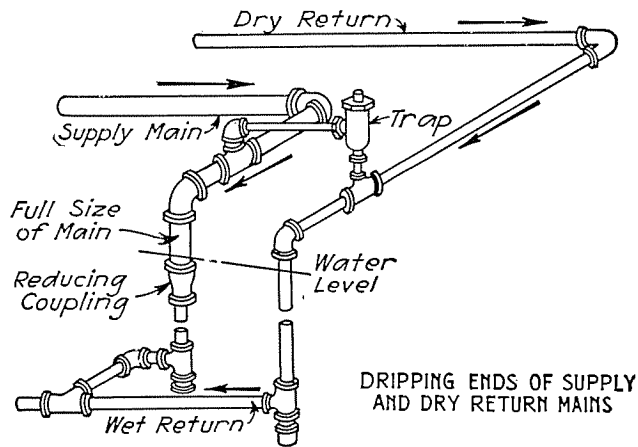



DRIPPING ENDS OF SUPPLY AND DRY RETURN MAINS

NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)
TAKING BRANCH FROM STEAM MAIN

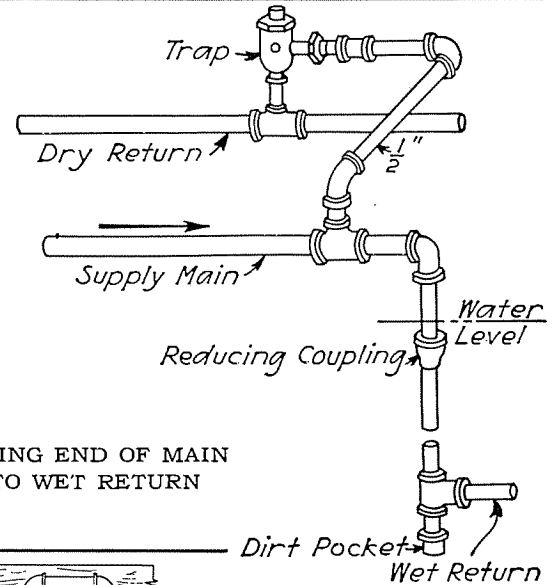
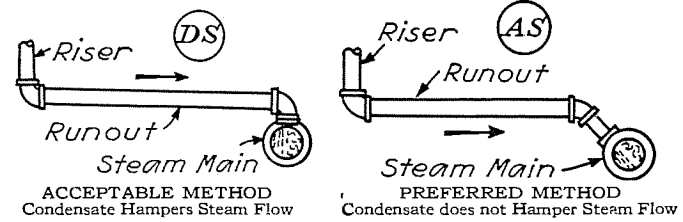


DRIPPING END OF MAIN INTO WET RETURN

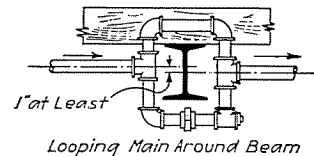


NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)

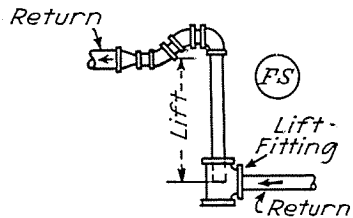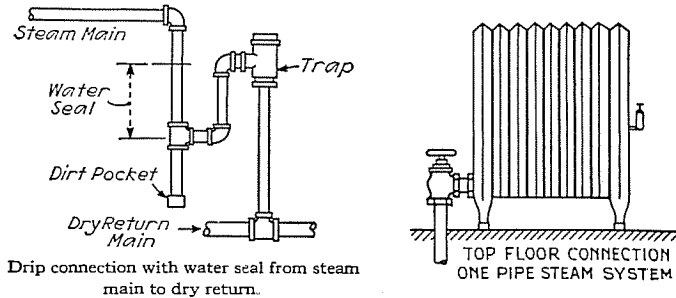


(Left) Detail of lift fitting and connections in return line to vacuum pump.

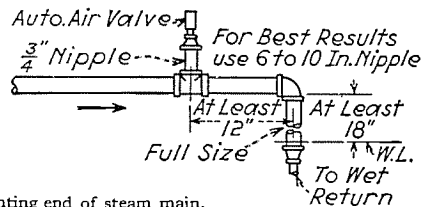

Method of venting end of steam main. Note location of automatic air valve.


NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)

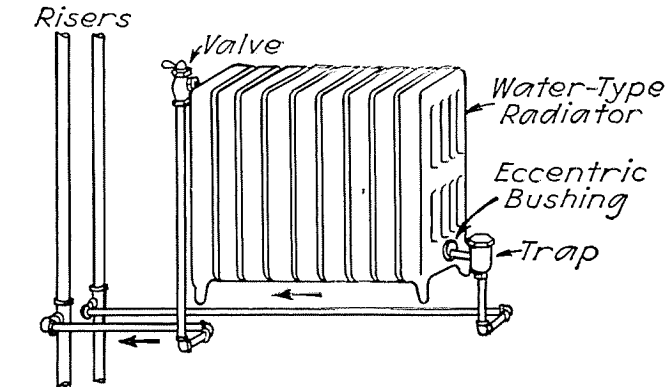


TOP AND BOTTOM OPPOSITE END RADIATOR CONNECTIONS FROM UP OR DOWN FEED RISERS

METHOD OF CONNECTING CEILING RADIATORS

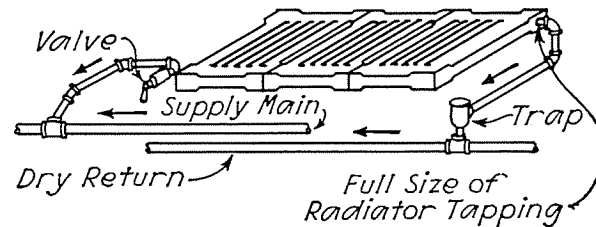


NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)

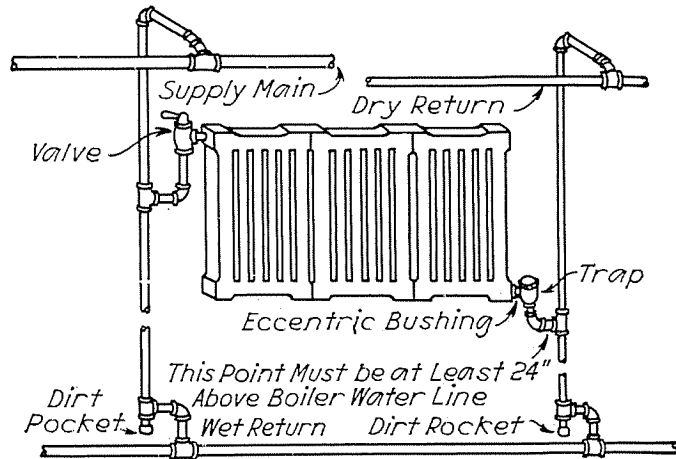

CONNECTIONS TO RADIATOR HUNG ON WALL
BELOW DRY RETURN

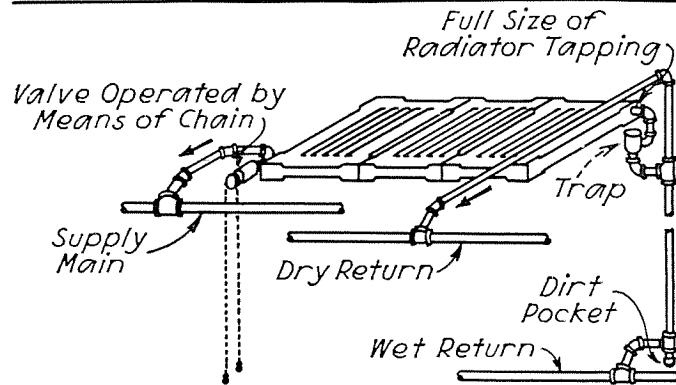

METHOD OF CONNECTING
CEILING RADIATORS

NATIONAL ENGINEERING DATA

Recommended Steam Connections (cont.)

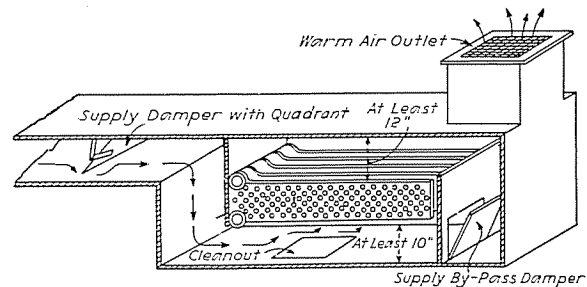


DIAGRAM NO. 15
TYPICAL ARRANGEMENT OF INDIRECT CASING
WITH CLEANOUT AND DAMPERS

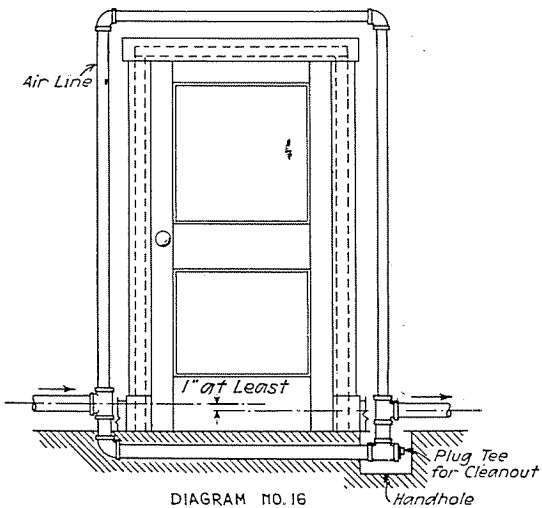


DIAGRAM NO. 16
LOOPING AIR LINE AROUND OPENING TO PREVENT
AIR BINDING WHEN RETURN DROPS BELOW OPENING

NATIONAL ENGINEERING DATA

Chart No. 10 Expansion of Pipe in Inches per 100 Feet

| Temperature Rise Deg. Fahr. | Expansion in Inches per 100 Feet | |
|--------------------------------|----------------------------------|----------------|
| | B Wrought Iron or Steel | C Cast Iron |
| 0 | 0.00 | 0.00 |
| 10 | 0.08 | 0.05 |
| 20 | 0.15 | 0.10 |
| 30 | 0.23 | 0.15 |
| 40 | 0.30 | 0.25 |
| 50 | 0.38 | 0.36 |
| 100 | 0.76 | 0.72 |
| 150 | 1.15 | 1.10 |
| 200 | 1.57 | 1.50 |
| 250 | 1.99 | 1.90 |
| 300 | 2.47 | 2.35 |
| 350 | 2.94 | 2.80 |
| 400 | 3.46 | 3.30 |

Chart No. 11 Length of Expansion Offsets or Bends for Proper Expansion of Pipe

| E Total Expansion in Inches* | F Feet of Pipe and Offset or U-Bend for Different Diameters of Pipe | | | | | | | | | |
|------------------------------------|---|----|----|----|----|----|-----|-----|-----|-----|
| | F | | G | | H | | I | | O | |
| | 2" | 3" | 4" | 5" | 6" | 8" | 10" | 12" | 14" | 16" |
| 1 | 11 | 13 | 15 | 17 | 19 | 21 | 23 | 25 | 27 | 30 |
| 2 | 15 | 18 | 21 | 23 | 26 | 29 | 32 | 35 | 38 | 42 |
| 3 | 18 | 22 | 26 | 29 | 32 | 36 | 40 | 43 | 48 | 52 |
| 4 | 21 | 26 | 30 | 34 | 37 | 42 | 47 | 50 | 56 | 58 |
| 5 | 24 | 30 | 34 | 38 | 41 | 47 | 53 | 57 | 63 | 65 |
| 6 | 27 | 33 | 37 | 41 | 45 | 52 | 58 | 63 | 69 | 71 |
| 7 | 30 | 36 | 40 | 44 | 48 | 56 | 62 | 68 | 74 | .. |
| 8 | 32 | 39 | 43 | 47 | 52 | 60 | 66 | 72 | .. | .. |

*This column shows the total expansion the offset will take care of without a cold strain. In general these amounts can be increased 40 per cent which increase can be taken up in cold strain of the pipe on being made up.

The total length of pipe in the expansion member should be the same whether in the form of a single right-angle offset or double offset or U-Bend.

The lengths of arms figured for 12,000 lb. per square inch tension for wrought iron pipe. If steel pipe is used this is good for 16,000 lb. per inch so that the arm will take care of 1/3 more expansion.

Example: (A) How much expansion will take place in 400 feet of steel pipe if it is installed at 12 above zero, and steam at 212° is passed through it?

Solution: Temperature range = 212 - 12 = 200. Find 200 degrees in column "A" above. Opposite, in Column "B", appears 1.57 inches—the expansion per hundred feet. In 400 feet, the expansion is 4 x 1.57 = 6.28 inches.

Example (B) If the pipe is 3" diameter, what length of offset is required? In column "E" find the expansion equal to, or next greater than, the required expansion; in this case, 7 inches. Opposite, in column "G", appears 36 feet—the length required to form an offset that will take care of the expansion without cold strain in the pipe.

NATIONAL ENGINEERING DATA

Chart No. 12 Square Feet of Surface per Lineal Foot of Pipe
On all lengths over 1 ft., fractions less than tenths are added to or dropped.

| Length of pipe in ft. | Nominal Size of Standard Weight Pipe | | | | | | | |
|-----------------------|--------------------------------------|------|--------|--------|-------|--------|-------|--------|
| | 3/4" | 1" | 1 1/4" | 1 1/2" | 2" | 2 1/2" | 3" | 4" |
| 1 | .275 | .346 | .434 | .494 | .622 | .753 | .916 | 1.175 |
| 2 | .55 | .69 | .868 | .988 | 1.244 | 1.506 | 1.832 | 2.350 |
| 3 | .83 | 1.03 | 1.302 | 1.482 | 1.866 | 2.259 | 2.748 | 3.525 |
| 4 | 1.11 | 1.37 | 1.736 | 1.976 | 2.488 | 2.997 | 3.664 | 4.699 |
| 5 | 1.4 | 1.75 | 2.215 | 2.56 | 3.233 | 3.897 | 4.796 | 6.124 |
| 6 | 1.68 | 2.1 | 2.67 | 3.06 | 3.854 | 4.616 | 5.656 | 7.194 |
| 7 | 1.96 | 2.42 | 3.08 | 3.51 | 4.376 | 5.238 | 6.416 | 8.191 |
| 8 | 2.24 | 2.8 | 3.56 | 4.03 | 5.008 | 5.96 | 7.296 | 9.278 |
| 9 | 2.52 | 3.15 | 3.93 | 4.44 | 5.44 | 6.48 | 7.968 | 10.166 |
| 10 | 2.7 | 3.3 | 4.1 | 4.66 | 5.88 | 7.02 | 8.604 | 10.954 |
| 11 | 2.9 | 3.5 | 4.3 | 4.88 | 6.1 | 7.26 | 8.94 | 11.542 |
| 12 | 3.1 | 3.7 | 4.5 | 5.1 | 6.34 | 7.56 | 9.28 | 12.13 |
| 13 | 3.3 | 3.9 | 4.7 | 5.3 | 6.58 | 7.86 | 9.62 | 12.72 |
| 14 | 3.5 | 4.1 | 4.9 | 5.5 | 6.82 | 8.14 | 9.96 | 13.31 |
| 15 | 3.8 | 4.3 | 5.1 | 5.7 | 7.06 | 8.38 | 10.3 | 13.9 |
| 16 | 4.1 | 4.5 | 5.3 | 5.9 | 7.3 | 8.62 | 10.66 | 14.49 |
| 17 | 4.4 | 4.7 | 5.5 | 6.1 | 7.56 | 8.86 | 11.02 | 15.08 |
| 18 | 4.7 | 5.0 | 5.7 | 6.3 | 7.8 | 9.1 | 11.38 | 15.67 |
| 19 | 5.0 | 5.2 | 5.9 | 6.5 | 8.04 | 9.34 | 11.74 | 16.26 |
| 20 | 5.3 | 5.6 | 6.1 | 6.7 | 8.28 | 9.58 | 12.1 | 16.85 |
| 21 | 5.6 | 5.9 | 6.3 | 6.9 | 8.52 | 9.82 | 12.46 | 17.44 |
| 22 | 5.9 | 6.2 | 6.5 | 7.1 | 8.76 | 10.06 | 12.82 | 18.03 |
| 23 | 6.2 | 6.5 | 6.7 | 7.3 | 9.0 | 10.3 | 13.18 | 18.62 |
| 24 | 6.5 | 6.8 | 7.0 | 7.5 | 9.24 | 10.54 | 13.54 | 19.21 |
| 25 | 6.9 | 7.1 | 7.3 | 7.7 | 9.48 | 10.78 | 13.9 | 19.8 |
| 30 | 8.3 | 8.6 | 8.9 | 9.2 | 10.92 | 11.52 | 15.16 | 23.04 |
| 35 | 9.6 | 10.0 | 10.4 | 10.8 | 12.6 | 13.44 | 17.4 | 27.36 |
| 40 | 11.1 | 11.6 | 12.1 | 12.6 | 14.76 | 15.72 | 20.58 | 32.4 |
| 45 | 12.4 | 13.0 | 13.6 | 14.1 | 16.92 | 18.18 | 24.06 | 38.16 |
| 50 | 13.8 | 14.4 | 15.0 | 15.6 | 19.14 | 20.76 | 27.9 | 44.4 |

Chart No. 13 Showing Losses From Horizontal Bare Iron Pipes Containing Hot Water for 24 Hours a Day. Per 100 lineal feet of pipe per month of 30 days.

| Pipe Size | Temperatures—Hot Water | | | | | | | | | | | |
|-----------|------------------------|-----------|--|----------------|-----------|--|----------------|-----------|--|----------------|-----------|--|
| | 120 Deg. Fahr. | | | 150 Deg. Fahr. | | | 180 Deg. Fahr. | | | 210 Deg. Fahr. | | |
| | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. |
| 1/2" | 0.53 | 215 | 0.543 | 0.00 | 363 | 0.573 | 1.32 | 526 | 0.605 | 1.77 | 707 | 0.638 |
| 3/4" | 0.65 | 261 | 0.660 | 1.09 | 437 | 0.690 | 1.58 | 635 | 0.729 | 2.11 | 845 | 0.762 |
| 1" | 0.78 | 313 | 0.791 | 1.31 | 525 | 0.820 | 1.91 | 763 | 0.878 | 2.55 | 1020 | 0.920 |
| 1 1/4" | 0.97 | 388 | 0.979 | 1.61 | 708 | 1.02 | 2.36 | 947 | 1.087 | 3.19 | 1275 | 1.15 |
| 1 1/2" | 1.08 | 452 | 1.09 | 1.84 | 886 | 1.10 | 2.65 | 1060 | 1.220 | 3.57 | 1430 | 1.29 |
| 2" | 1.32 | 530 | 1.34 | 2.21 | 1086 | 1.37 | 3.24 | 1297 | 1.491 | 4.37 | 1750 | 1.58 |
| 2 1/2" | 1.56 | 625 | 1.58 | 2.64 | 1286 | 1.45 | 3.86 | 1545 | 1.778 | 5.18 | 2075 | 1.87 |
| 3" | 1.86 | 744 | 1.88 | 3.13 | 1419 | 1.59 | 4.56 | 1824 | 2.100 | 6.12 | 2460 | 2.22 |
| 3 1/2" | 2.11 | 883 | 2.13 | 3.54 | 1580 | 1.74 | 5.18 | 2070 | 2.380 | 6.95 | 2780 | 2.51 |
| 4" | 2.33 | 934 | 2.36 | 3.75 | 1740 | 1.89 | 5.78 | 2305 | 2.650 | 7.70 | 3080 | 2.78 |
| 4 1/2" | 2.57 | 1030 | 2.60 | 4.27 | 1910 | 2.02 | 6.35 | 2540 | 2.920 | 8.53 | 3420 | 3.08 |
| 5" | 2.84 | 1135 | 2.87 | 4.77 | 2070 | 2.16 | 6.95 | 2780 | 3.200 | 9.36 | 3750 | 3.38 |
| 6" | 3.35 | 1352 | 3.37 | 5.62 | 2350 | 2.36 | 8.20 | 3280 | 3.775 | 11.10 | 4450 | 4.01 |
| 7" | 3.83 | 1533 | 3.87 | 6.40 | 2680 | 2.56 | 9.40 | 3760 | 4.325 | 12.70 | 5080 | 4.58 |
| 8" | 4.27 | 1710 | 4.30 | 7.20 | 2980 | 2.75 | 11.00 | 4398 | 5.050 | 14.24 | 5700 | 5.14 |
| 9" | 4.75 | 1900 | 4.80 | 8.06 | 3200 | 2.95 | 12.62 | 4650 | 5.350 | 15.80 | 6330 | 5.71 |
| 10" | 5.26 | 2100 | 5.32 | 10.00 | 3550 | 3.15 | 14.68 | 5065 | 5.925 | 17.55 | 7030 | 6.34 |
| 12" | 6.18 | 2495 | 6.25 | 12.00 | 4190 | 3.62 | 18.00 | 6000 | 6.995 | 20.65 | 8270 | 7.46 |
| 14" | 7.14 | 2795 | 7.22 | 14.00 | 4570 | 3.92 | 21.00 | 6635 | 7.625 | 22.40 | 8980 | 8.10 |
| 16" | 8.06 | 3065 | 8.14 | 16.00 | 5100 | 4.20 | 24.00 | 7525 | 8.650 | 25.50 | 10,200 | 9.20 |
| 18" | 8.58 | 3440 | 8.68 | 18.00 | 5820 | 4.50 | 27.00 | 8400 | 9.650 | 28.60 | 11,450 | 10.33 |

In these tables coal has been figured at \$4.00 per ton of 2000 lb.—13,000 B.T.U. per lb. of coal—labor, boiler room expense, etc., taken at \$1.00 per ton, making total value of coal fired \$5.00 per ton. Boiler efficiency taken at 70 per cent. Air temperature 70 deg. Fahr. Experimental data obtained at the *Mellon Institute*.

Chart No. 14 Showing Losses From Horizontal Bare Iron Pipes Containing Steam for 24 Hours a Day. Per 100 lineal feet of pipe per month of 30 days.

| Pipe Size | Gauge Pressures | | | | | | | | | | | |
|-----------|-----------------|-----------|--|------------|-----------|--|----------------|-----------|--|------------|-----------|--|
| | 10 Lbs. | | | 80 Lbs. | | | 324 Deg. Fahr. | | | 120 Lbs. | | |
| | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. | Doll. Loss | Lbs. Coal | B.T.U. per Lincal Ft. per Deg. Fahr. Diff. |
| 1/2" | 2.24 | 897 | 0.670 | 3.92 | 1566 | 0.779 | 4.51 | 1805 | 0.815 | 4.51 | 1805 | 0.815 |
| 3/4" | 2.70 | 1083 | 0.809 | 4.74 | 1895 | 0.943 | 5.48 | 2190 | 0.990 | 5.48 | 2190 | 0.990 |
| 1" | 3.26 | 1305 | 0.973 | 5.74 | 2290 | 1.14 | 6.25 | 2601 | 1.18 | 6.25 | 2601 | 1.18 |
| 1 1/4" | 4.00 | 1610 | 1.20 | 7.08 | 2860 | 1.42 | 8.18 | 3280 | 1.48 | 8.18 | 3280 | 1.48 |
| 1 1/2" | 4.54 | 1818 | 1.35 | 7.98 | 3190 | 1.58 | 9.28 | 3710 | 1.67 | 9.28 | 3710 | 1.67 |
| 2" | 5.36 | 2142 | 1.60 | 11.66 | 4660 | 2.32 | 13.66 | 4549 | 2.05 | 13.66 | 4549 | 2.05 |
| 2 1/2" | 6.65 | 2660 | 1.98 | 13.88 | 5550 | 2.76 | 16.31 | 5460 | 2.46 | 16.31 | 5460 | 2.46 |
| 3" | 8.24 | 3292 | 2.46 | 15.82 | 6325 | 3.14 | 18.14 | 6450 | 2.91 | 18.14 | 6450 | 2.91 |
| 3 1/2" | 8.89 | 3554 | 2.65 | 17.70 | 7075 | 3.52 | 22.60 | 7322 | 3.30 | 22.60 | 7322 | 3.30 |
| 4" | 9.87 | 4370 | 3.29 | 19.48 | 7790 | 3.82 | 25.50 | 8025 | 3.70 | 25.50 | 8025 | 3.70 |
| 4 1/2" | 11.97 | 4790 | 3.74 | 21.25 | 8500 | 4.23 | 28.60 | 8850 | 4.45 | 28.60 | 8850 | 4.45 |
| 5" | 14.21 | 5680 | 4.24 | 23.10 | 9530 | 5.02 | 33.70 | 9850 | 5.29 | 33.70 | 9850 | 5.29 |
| 6" | 18.25 | 7300 | 5.47 | 29.10 | 13,030 | 6.78 | 46.70 | 13,480 | 6.09 | 46.70 | 13,480 | 6.09 |
| 7" | 22.05 | 8820 | 6.70 | 36.25 | 16,100 | 8.01 | 55.40 | 16,840 | 7.64 | 55.40 | 16,840 | 7.64 |
| 8" | 26.44 | 10,580 | 7.88 | 47.40 | 20,800 | 9.32 | 68.40 | 21,120 | 10.00 | 68.40 | 21,120 | 10.00 |
| 10" | 28.90 | 11,560 | 8.79 | 52.00 | 20,800 | 10.34 | 60.50 | 24,200 | 10.92 | 60.50 | 24,200 | 10.92 |
| 14" | 32.80 | 13,120 | 9.75 | 58.76 | 23,150 | 11.70 | 68.40 | 27,320 | 12.34 | 68.40 | 27,320 | 12.34 |
| 18" | 36.10 | 14,400 | 10.80 | 65.40 | 26,150 | 13.00 | 76.50 | 30,570 | 13.80 | 76.50 | 30,570 | 13.80 |

In these tables coal has been figured at \$4.00 per ton of 2000 lbs.—13,000 B.T.U. per lb. of coal—labor, boiler room expense, etc., taken at \$1.00 per ton, making total value of coal fired \$5.00 per ton. Boiler efficiency taken at 70 per cent. Air temperature 70 deg. Fahr. Experimental data obtained at the *Mellon Institute*.

Domestic Hot Water Heating

There are four distinct items that should be considered in the hot water supply for a building—first, the amount of water to be heated; second, the temperature rise; third, the rate at which it is to be heated; and, fourth, the equipment used for heating. The amount of water to be heated must be calculated from the charts below. The equipment used may be an instantaneous gas heater or a storage tank system. Where a continuous flow of hot water is required, the instantaneous heater can be used. Where a large flow of hot water is necessary at any one time, the storage system should be used. Where large amounts of hot water are to be used, such as a group of shower baths, large groups of fixtures, or swimming pools, a steam water heater makes an ideal piece of equipment.

Chart No. 15 Showing Flow in Gallons per Minute Delivered by Ordinary Plumbing Fixtures.

| Fixture | Fair Flow | Good Flow | Excellent Flow |
|-----------------------------------|------------------|-----------|----------------|
| | GALLONS PER MIN. | | |
| Kitchen Sink Bibbs | 2 | 4 | 6 |
| Pantry Sink—High Goose Neck Bibbs | 2 | 2 | 3 |
| Pantry Sink—Large Plain Bibbs | 4 | 6 | 8 |
| Vegetable Sink Bibbs | 2 | 4 | 6 |
| Laundry Tray Bibbs | 4 | 6 | 8 |
| Slop Sink Bibbs | 3 | 4 | 6 |
| Lavatory Basin Bibbs | 2 | 3 | 4 |
| Bathtub Bibbs | 3 | 4 | 6 |
| Shampoo Spray | 1/2 | 1 | 2 |
| Shower Baths | | | |
| 5-inch rain heads | 2 | 3 | 4 |
| 6 1/2-inch rain heads | 2 | 3 | 5 |
| 8-inch rain heads | 4 | 6 | 8 |
| 8-inch Tubular heads | 6 | 8 | 10 |
| Needle Baths | 20 | 30 | 40 |
| Manicure Tables | 1 | 1 1/2 | 2 |

Chart No. 16 Showing Gallons of Hot Water Used per Apartment in a Typical Apartment Building.

| Fixture | Gallons Per Min. Good Flow | Times Used | Minutes Used | Gallons Used |
|----------|----------------------------|------------|--------------|--------------|
| Lavatory | 3 | 4 | 1 | 12 |
| Tub | 4 | 1 | 4 | 16 |
| Sink | 4 | 1 | 1/2 | 1 1/2 |
| Trays | 3 | 1 | 2 | 6 |
| Total | | | | 35 1/2 |

How To Determine Tank Capacities and Fuel Consumption for a Given Quantity of Hot Water Supply

EXAMPLE

- What capacity tank will be required to store sufficient hot water for 5 bath tubs, 5 lavatories and 5 kitchen sinks?
- How many cubic feet of gas will be consumed in heating this water, if it is raised from 40 degrees to 120 degrees?

SOLUTION (a)

5 lavatories $5 \times 3 = 15$ gallons
 5 tubs will use per minute $5 \times 4 = 20$ gallons
 5 kitchen sinks $5 \times 4 = 20$ gallons

The storage capacity should equal the total amount of water used in one hour during the heaviest demand or the peak load period.

Referring to chart No. 16, page 364.

| Fixture | Gallons used per minute | Times used per hour | Minutes used | Gallons used per hour |
|--------------|-------------------------|---------------------|--------------|-----------------------|
| 5 Lavatories | 15 | 4 | 1 | 60 |
| 5 Tubs | 20 | 1 | 4 | 80 |
| 5 Sinks | 20 | 1 | 1/2 | 10 |

Total Gallons 150

The tank capacity required would be 150 Gallons.

SOLUTION (b)

To raise 150 gallons of water from 40 degrees to 120 degrees, a temperature rise of 80 degrees. Change gallons to pounds—150 gallons $\times 8 1/3$ pounds = 1250 pounds.

One B. T. U. will raise 1 pound of water one degree—1250 pounds $\times 1$ B. T. U. $\times 80$ degrees = 100,000 B. T. U.

Gas Burning Domestic Hot Water Heaters are about 80% efficient. Manufactured gas has 550 B. T. U. per cubic foot—80% of this is available.

$550 \times 80\% = 440$ B. T. U. per cubic foot of gas.

100,000 B. T. U. required to heat water divided by 440 available B. T. U. in gas equals 245 cubic feet.

Answer for solution (b) is 245 cubic feet of gas per hour.

See pages 154-155 for sizes and ratings of coal fired Hot Water Supply Boilers.



NATIONAL ENGINEERING DATA

Typical Problem of Determining Size of Boiler, and
Number of Feet of Pipe Coil Required for a
Hot Water Installation in Connection
with Swimming Pool

The increasing number of swimming pools being installed is enlarging a field of heating well worth cultivation. The problems involved in determining the size of boiler and the number of feet of pipe coil required, are simple, and will be fully understood from the specimen problem quoted below. The heat content of the coal should be varied to conform to the fuel used in your territory.

Example: (a) How many square feet of grate will be necessary to heat the water in a swimming pool the size of which is 60 ft. long, 30 ft. wide and 7 ft. deep using a water boiler? Water is to be raised from 40° to 80° in 24 hours. (b) How many feet of copper tube in a steam heater?

(a) Solution:

Contents of pool = $60 \times 30 \times 7 = 12600$ cu. ft.
Water to be raised in 1 hr. = $12600 \div 24 = 525$ cu. ft.
Lbs. of water to be heated = 525 cu. ft. $\times 62.42$ lbs. = 32760 lbs.
Rise of temperature of water in pool = 40 degrees
B. T. U. necessary per hour = $32760 \times 40 = 1310400$
Coal necessary with 8333 B. T. U. per lb. available,
 $1310400 \div 8333 = 157.251$ lbs.
8 lbs. of coal per sq. ft. of grate = $157.25 \div 8 = 19.65$ sq. ft.

The answer to this question, then, would be to install boilers having 19.6 sq. ft. of grate. Page 73 of the National Heating Guide shows a National Imperial Boiler No. W-942, which can be used for this installation.



NATIONAL ENGINEERING DATA

(b) Solution:

Temperature of steam 220°
Mean temperature of water 60°
Temperature difference 160° between steam and water.
1 sq. ft. of copper pipe condenses 50 lbs. of steam per hour under above conditions.
Amount of coal burned per hour, 157 lbs.
157 lbs. coal will evaporate $1310400 \div 1000 = 1310$ lbs. steam which, if divided by 50 lbs. =
*26.2 sq. ft. of copper which is equivalent to:
56 ft. of 1½" copper pipe—or
65 ft. of 1¼" copper pipe—or
79 ft. of 1" copper pipe—or
100 ft. of ¾" copper pipe.
*1 sq. ft. copper at 160° Temperature difference transmits 50,000 B. T. U. per hour; $1,310,400 \div 50,000 = 26.2$ sq. ft. of copper surface required.

Applying Taco Indirect Heater to Swimming
Pool Installations

INDIRECT heaters are suitable for this service and when selecting them it should be remembered that Taco heaters are rated in gallons of water heated from 50 to 150 degrees in three hours when installed below the water line of a steam boiler. When used with live steam at two to five pounds pressure for heating water from 40 to 80 degrees F., as in the problem stated above, size of Taco should be selected as follows:

First, determine the number of square feet of copper tubing required from the above formula. Second, multiply this by 40 to secure the rating of the proper size of Taco indirect heater to use. Example: from the above, 26 sq. ft. times 40 equals 1040 gallons. A No. 20 Super Taco rated at 1000 gallons should be selected if the heater is to be installed in a vertical position, or a Taco No. 6 rated at 960 gallons if a horizontal heater is desired.



NATIONAL ENGINEERING DATA

How to Select and Install Taco Heaters

Size of Storage Tank. Apartments having three to five rooms, and the usual private residences, require a storage capacity for domestic hot water of 30 gallons for each family or bath.

Tank size must be increased to provide for kitchen and laundry use and waste when there are a number of servants. For such an installation, whether in detached houses or apartments, 50 or more gallons storage capacity should be allowed per bath with a minimum storage of 100 gallons.

When considering the rated capacities of Taco heaters, whether operated under the standard conditions with coal-fired boilers or under intermittent firing conditions as with an oil burner and Taco-Abbott system, it should be understood that the rated capacities, as stated, were obtained from tests when operating under favorable conditions. This means with heater properly piped, the storage tank favorably located, and—in the case of coal-fired ratings—with the boiler steaming.

It is good practice to allow a margin when selecting Tacos of the proper size, to provide for loss of efficiency due to fouling. Future increased demands for hot water and unusual requirements demanded by guests, should also be considered. A larger size Taco is always a good

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Taco Heaters (continued)

investment, particularly in mild weather when the boiler fires may be banked for hours at a time.

Horizontal storage tanks smaller than 18 or 20 inches in diameter, are not recommended because of the difficulty of preventing the hot and cold water from mixing, especially when large quantities of hot water are being drawn.

Pipe Sizes. Pipe sizes should be the full size of Taco openings. This is particularly important in the piping between the Taco and the boiler. Brass pipe is recommended for domestic water connections and where used it may usually be one size smaller than Taco tappings. See table.

Valves and Drains. The installation of the valves and drains shown in Figures AH and BH is necessary to permit flushing out the shell and coil of the heater at regular intervals.

Losses by Radiation. Radiation losses should be kept at a minimum and proper insulation of the Taco and its piping connections and the storage tank, is urged. This is particularly important in connection with the Taco-Abbott system where the heating boiler is operated during the summer months for domestic hot water supply only.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Fig. AH—Indirect Heater connected to a vertical tank.

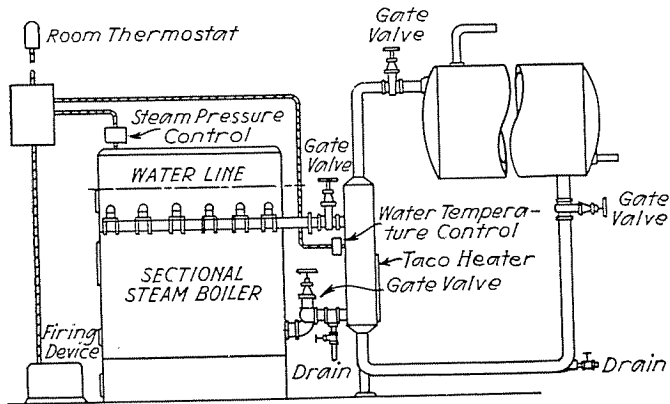
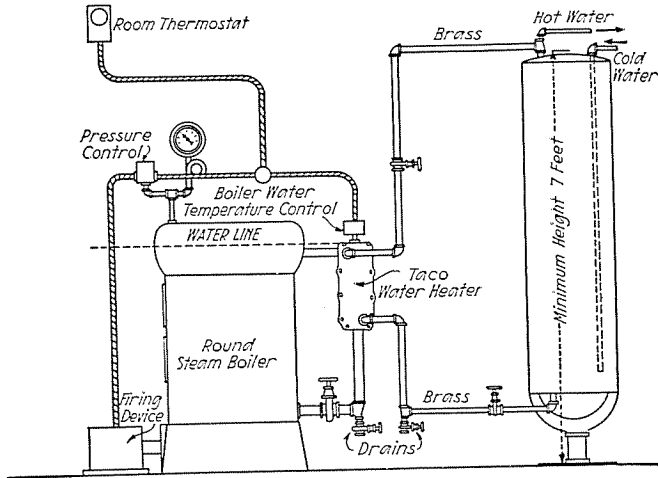


Fig. BH Indirect Heater connected to a horizontal tank.
Top of tank should be at least 3' above water line.

Table Showing Sizes and Data
Taco Indirect Heaters

| | | | | | | | | | | | | | | | | | | | | | | |
|------------------------------|-------|-------|-------|-----|-------|-------|-------|-------|-------|-------|-------|-------|------|-----|-----|-----|-----|-----|-----|-----|------|----|
| *#Tank capacity, gallons | 30-40 | 40-60 | 66 | 85 | 100 | 120 | 140 | 150 | 180 | 220 | 250 | 295 | 365 | 420 | 450 | 500 | 525 | 575 | 720 | 855 | 1000 | |
| TACO Size No. | 1-A | 2 | 2-A | 3 | 3 | 3 | 4 | 9 | 9 | 10 | 10 | 12 | 12 | 20 | 20 | 20 | 25 | 25 | 25 | 35 | 35 | 50 |
| Usual number of families | 1 | 1 | 1-2 | 2-3 | 3 | 3 | 4 | 4-5 | 4-5 | 5-6 | 7 | 8 | 9-10 | 12 | 14 | 15 | 16 | 17 | 19 | 24 | 27 | 40 |
| *#Boiler connection, in. . . | 1 1/2 | 1 1/2 | 1 1/2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 1/2 | 2 1/2 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 4 | 4 | 4 | 4 |
| Tank connection, in. | 3/4 | 3/4 | 1 | 1 | 1 1/4 | 1 1/4 | 1 1/4 | 1 1/4 | 1 1/4 | 1 1/2 | 1 1/2 | 1 1/2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 3 | 3 | 3 |

*#Brass piping recommended for domestic water connections. **With storage tank of proper size. See "Size of Storage Tank," Page 368.

Heating and Piping Contractors National Association Engineering Standards consider one gallon of storage tank capacity to be equivalent to one-half square foot of radiation when a submerged heater is used with a storage tank.

NATIONAL ENGINEERING DATA

Minimum Allowable Sizes of Safety Valves for Steam Heating Boilers

Safety Valves furnished in National Boilers conform to the A. S. M. E. code. For replacements, sizes may be determined from this table.

Safety Valve

| Diameter Inches | Area Sq. In. | Discharge Capacity 1 lb. per Hour | Area of Grate Sq. Ft. |
|-----------------|--------------|-----------------------------------|-----------------------|
| 1/4 | 0.0491 | 15 | 1 |
| 3/8 | 0.1104 | 30 | 1.5 |
| 1/2 | 0.1963 | 60 | 2 |
| 3/4 | 0.4418 | 120 | 3 |
| 1 | 0.7854 | 230 | 4 |
| 1 1/4 | 1.2272 | 360 | 6.5 |
| 1 1/2 | 1.7671 | 515 | 9 |
| 2 | 3.1416 | 920 | 14 |
| 2 1/2 | 4.9087 | 1435 | 19 |
| 3 | 7.0686 | 2070 | 24 |
| 3 1/2 | 9.6211 | 2810 | 29 |
| 4 | 12.5660 | 3675 | 34 |
| 4 1/2 | 15.9040 | 4650 | 39 |

1—Capacity of safety valve based on 33 1/3 per cent over pressure, valve set to relieve at 10 or 15 pounds per square inch.

Note—the foregoing table is based upon the following formulas:

Where grate area does not exceed 4 sq. ft.

$$\text{Diam. of safety valve, in.} = \frac{\text{Grate area (sq. ft.)}}{4}$$

Where grate area exceeds 4 sq. ft.

$$\text{Diam. of safety valve, in.} = \left[\frac{\text{Grate area (sq. ft.)}}{10} \right] + 0.6$$

If liquid or gaseous fuel is used, a grate area shall be assumed equal to that which would be required if coal were used for fuel.

NATIONAL ENGINEERING DATA

Chimneys

Provisions of Underwriters Code

THE construction of chimneys should be in accordance with the National Board of Fire Underwriters' Chimney Code. Briefly summarized, the code provisions follow.


The construction, location, height and area of the chimney to which a heating boiler is connected affect the operation of the entire heating system. Most residence chimneys are built of brick and may be either lined or unlined, but in either case the walls must be air-tight and there should be only one smoke opening into the chimney. Cleanout, if provided, must be absolutely air-tight when closed.

The walls of brick chimneys shall be not less than 3 3/4 in. thick (width of a standard size brick) and shall be lined with fire-clay flue lining. Fire-clay flue linings shall be manufactured from suitable refractory clay, either natural or compounded, and shall be adapted to withstand high temperatures and the action of flue gases. They shall be of standard commercial thickness but not less than 3/4 in. All fire-clay flue linings shall meet the standard specification of the Eastern Clay Products Association. The flue sections shall be set in special mortar, and shall have the joints struck smooth on the inside. The masonry shall be built around each section of lining as it is placed, and all spaces between masonry and linings shall be completely filled with mortar. No broken flue lining shall be used. Flue linings shall start at least

Chimneys (continued)

4 in. below the bottom of smoke-pipe intakes of flues, and shall be continued the entire heights of the flues and project at least 4 in. above chimney top to allow for a 2 in. projection of lining. The wash or splay shall be formed of a rich cement mortar. To improve the draft the wash surface should be concave wherever practical.

Flue lining may be omitted in brick chimneys, provided the walls of the chimneys are not less than 8 in. thick, and that the inner course shall be a refractory clay brick. All brickwork shall be laid in spread mortar, with all joints push-filled. Exposed joints both inside and outside shall be struck smooth. No plaster lining shall be permitted.

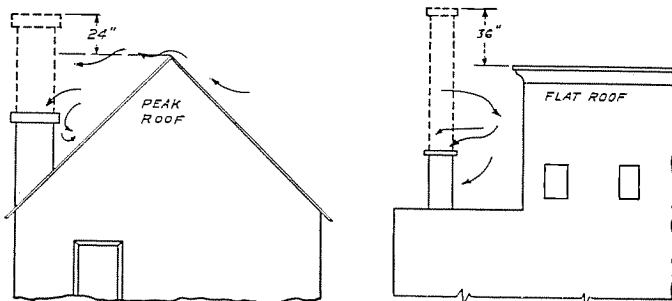

CHIMNEY TOP SHOULD ALWAYS EXTEND ABOVE THE HIGHEST PART OF ROOF AT LEAST 24 INCHES ON PEAK ROOF AND 36 INCHES ON FLAT ROOF

Chimneys shall extend at least 3 ft. above flat roofs and 2 ft. above the ridges of peak roofs when such flat roofs or peaks are within 30 ft. of the chimney. The chimney shall be high enough so that the wind from any direction shall not strike the top of the chimney from an angle above the horizontal. The chimney shall be properly capped with stone, terra cotta, concrete, cast iron,

Chimneys (continued)

or other approved material; but no such cap or coping shall decrease the flue area.

There shall be but one connection to the flue to which the boiler or furnace smoke-pipe is attached. The boiler or furnace smoke-pipe shall be thoroughly grouted into the chimney and shall not project beyond the inner surface of the flue lining.

The size or area of flue lining or of brick flue for warm-air furnaces depends on height of chimney and capacity of heating system. For chimneys not less than 35 ft. in height above grate line, the net internal dimensions of lining should be at least 7 x 11½ in. for a total leader pipe area up to 790 sq. in. Above 790 and up to 1000 sq. in. of leader pipe area the lining should be at least 11¼ x 11¼ in. inside. In case of brick flues not less than 35 ft. in height with no linings, the internal dimensions should be at least 8 x 12 in. up to 790 sq. in. of leader area, and at least 12 x 12 in. for leader capacities up to 1000 sq. in. Chimneys under 35 ft. in height are unsatisfactory in operation and hence should be avoided.

Smoke Test

The chimney flue shall be subjected to a smoke test by the mason contractor in the presence of the architect or his representative, after the mortar has thoroughly hardened, and must be *smoke tight*.

The method of conducting this test shall be as follows: With a good fire in the boiler or furnace, or in the base of the chimney, put about a square yard of tar paper on

NATIONAL ENGINEERING DATA

Chimneys (continued)

the fire. As soon as smoke appears at the top of the chimney close the top of the flue with a piece of old carpet or wet newspapers held down by a weighted board. Keep the tar paper burning in the firepot for five minutes. The architect or his representative shall sign an acceptance in triplicate, stating that the chimney was tight under the above test, and shall give one copy to the mason contractor, one copy to the heating contractor and one copy to the owner.

Standard Dimensions of Fire Clay Flue Linings

| Rectangular Flues | | |
|---|--|---|
| Outside Dimensions of Flue Linings Inches | Inside Dimensions of Flue Linings Inches | Inside Cross Sectional Area of Flue Linings Square Inches |
| 7 1/2 x 7 1/2 | 6 1/4 x 6 1/4 | 39.06 |
| 8 1/2 x 8 1/2 | 7 1/4 x 7 1/4 | 52.56 |
| 8 1/2 x 13 | 7 x 11 1/2 | 80.5 |
| 8 1/2 x 18 | 6 3/4 x 16 1/4 | 109.69 |
| 13 x 13 | 11 1/4 x 11 1/4 | 126.56 |
| 13 x 18 | 11 1/4 x 16 1/4 | 182.84 |
| 18 x 18 | 15 3/4 x 15 3/4 | 248.06 |
| 20 x 20 | 17 1/4 x 17 1/4 | 297.56 |
| 20 x 24 | 17 x 21 | 357.0 |
| 24 x 24 | 21 x 21 | 441.0 |

| Round Flues | | |
|---|--|---|
| Outside diameter of Flue Linings Inches | Inside Diameter of Flue Linings Inches | Inside Cross Sectional Area of Flue Linings Square Inches |
| 7 1/4 | 6 | 28.27 |
| 9 1/4 | 8 | 50.26 |
| 11 3/4 | 10 | 78.54 |
| 14 | 12 | 113.0 |
| 17 1/4 | 15 | 176.7 |
| 20 1/4 | 18 | 254.4 |
| 22 3/4 | 20 | 314.1 |
| 25 1/4 | 22 | 380.13 |
| 27 1/4 | 24 | 452.3 |
| 31 | 27 | 572.5 |
| 34 1/4 | 30 | 706.8 |
| 37 1/2 | 33 | 855.3 |
| 41 | 36 | 1017.9 |

NATIONAL ENGINEERING DATA

Chimneys

Residence Chimney Dimensions Based on Total Volume of Building.

This table is provided for the use of the architect or builder, to enable him to determine a suitable size of chimney when designing residences—even before the specific boiler is selected.

| Residence Volume Cu. Ft. | Maximum Requirement—See Basis of Table B.T.U./Hr. | Maximum Requirement | | Rectangular Flue | | | Round Inside Diameter of Lining Inches | Height from Grate Feet |
|--------------------------|---|---------------------|---------------|---------------------|------------------------------------|-------------------------------------|--|------------------------|
| | | Sq.Ft.*Steam | Sq.Ft.**Water | Inside Area Sq. In. | Inside Dimensions of Lining Inches | Outside Dimensions of Lining Inches | | |
| | | | | | | | | |
| 22120 | 265000 | 1106 | 1772 | 126.5 | 11 1/4 x 11 1/4 | 13 x 13 | 12 | 38 |
| 35800 | 430000 | 1790 | 2865 | 182.8 | 11 1/4 x 16 1/4 | 13 x 18 | 15 | 42 |
| 54000 | 660000 | 2750 | 4400 | 248.0 | 15 3/4 x 15 3/4 | 18 x 18 | 18 | 47 |
| 71600 | 860000 | 3580 | 5730 | 297.5 | 17 1/4 x 17 1/4 | 20 x 20 | 20 | 50 |

* Basis of Table

One Sq. Ft. Steam Radiation will heat 40 Cu. Ft. Maximum B. T. U. requirement equals twice the direct radiator load (or its equivalent) multiplied by 240. Maximum B. T. U. requirement will therefore be the volume multiplied by 240 divided by 20.

** Basis of Table

One Sq. Ft. Water Radiation will heat 25 Cu. Ft. Maximum B. T. U. requirement equals twice the direct radiator load (or its equivalent) multiplied by 150. Maximum B. T. U. requirement will therefore be the volume multiplied by 150 divided by 12.5.

Note

For residences having unusual auxiliary equipment:

Figure Maximum B. T. U. requirement. Use Chart No. 17, page 378, to determine chimney dimensions.

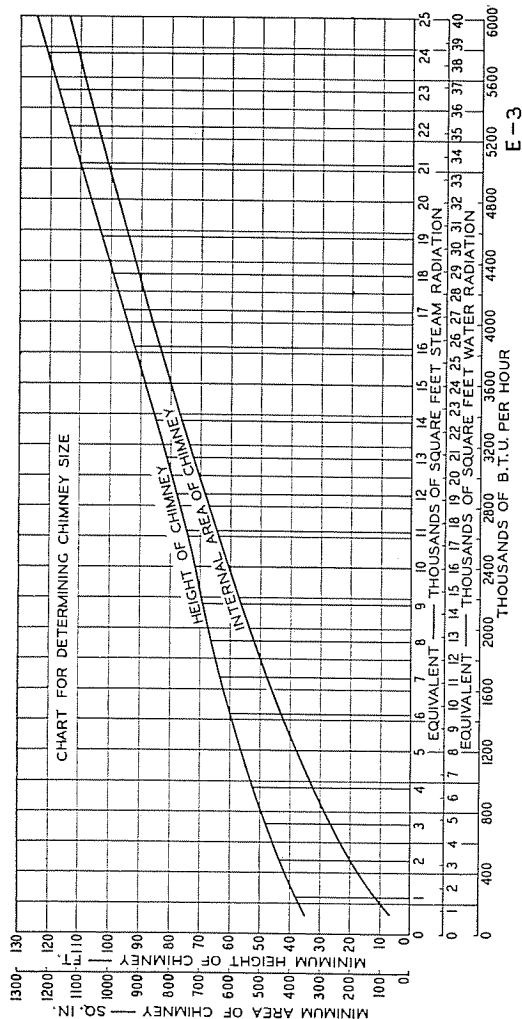


Chart No. 17 is provided for the use of the architect or engineer, to enable him to determine a suitable size of chimney after ascertaining *all* heat demands of the building.

Chimneys

Determining Proper Chimney Size

THE chart shown was prepared by the Special Technical Committee of the Institute of Boiler and Radiator Manufacturers, and is part of the National Board of Fire Underwriters' "Ordinance for Construction of Chimneys."


The chart shows the minimum inside area and height of chimney that should be provided for various total heat requirements—the chimney dimensions to be chosen *after* ascertaining the total maximum demands of whatever character that will be made on the boiler—including suitable allowance for pick-up load.

In using the chart, the total load in equivalent direct steam radiation, equivalent direct water radiation, or thousands of B. T. U's. per hour is found on the proper horizontal scale. Directly above find the intersection of the vertical line from this point with the curve showing the internal area of the chimney. On the area scale at the left on a line with this intersection, read the minimum internal area in square inches of the chimney. The intersection of the same vertical line with the "Height of Chimney" curve will give the minimum height of chimney, which is read on the "Minimum Height of Chimney" scale at left.

A typical example of the use of this chart follows:

| | | | |
|------------------------------|---|-------|------------------|
| Direct Steam Radiation | = | 2,000 | Sq. Ft. E. D. R. |
| Piping Load | = | 500 | " " " |
| Blast Heater Load | = | 1,800 | " " " |
| Blast Heater Piping Load | = | 200 | " " " |
| Hot Water Supply Load | = | 1,000 | " " " |
| Allowance for "pick-up" load | = | 1,000 | " " " |
| Total E. D. R. Requirement | = | 6,500 | " " " |

Chimney Dimensions—Chart No. 17 = 450 Sq. Ins. x 62 Ft.

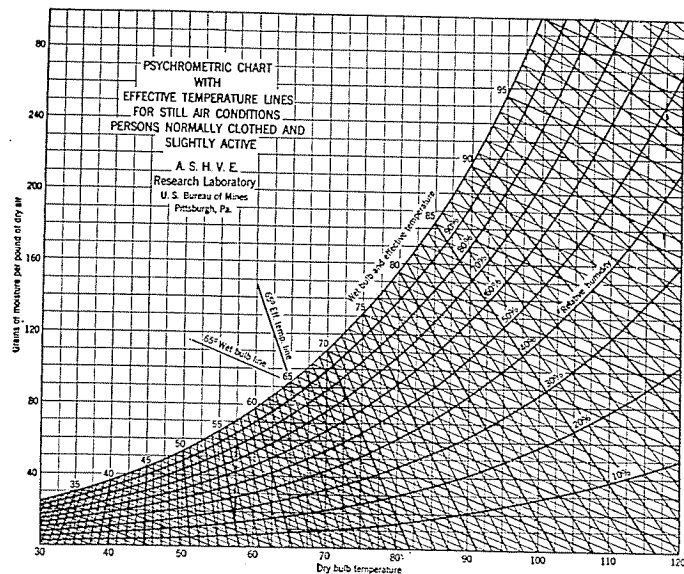

PSYCHROMETRIC CHART No. 18 WITH EFFECTIVE TEMPERATURE LINES FOR STILL AIR
SHADED AREA INDICATES THE COMFORT ZONE

Temperature Lines for the Best Still Air Conditions for Persons Normally Clothed and Slightly Active

The diagram shows the best air conditions for persons normally clothed and slightly active. The shaded portions of this diagram indicate the ranges of temperature and wet bulb reading in which a normal person will feel comfortable. The dry bulb temperature reading can be obtained on the bottom scale. The wet bulb reading can be obtained on the upper curved scale. The relative humidity can be obtained on the super-imposed curves. This chart gives the relation of temperature and humidity for comfort to the average person who is normally clothed and is resting in still air. For the same degree of comfort for persons at work or in different air movements, other than still air, reference is made to the American Society of Heating and Ventilating Engineers Guide.

Greenhouse Heating Systems

Temperature Required, Steam Heating Systems, Hot Water Radiation, Location of Radiation, Air Circulation.

A glass structure for horticultural purposes, owing to the manner of its construction and the material employed, offers less resistance to the penetration of frost and cold winds than many other kinds of buildings and necessarily requires a proportionately greater amount, and a more even distribution, of heat.

The heating apparatus must be so arranged as to diffuse an even heat throughout every part of the house, and must be of sufficient heating power to increase the heat quickly in case of sudden changes in the weather, and so maintain the desired temperature during the night.

The temperatures usually required depend on the class of vegetation to be grown and are given in Table A.

Although the same tables, formulae and other data used to estimate the heating requirements of systems in the usual types of buildings are also applicable to greenhouse heating and although the same pumps, traps, regulators, valves and other devices and fittings are used in greenhouses as in other systems, there are many differences that must be kept in mind so that due allowance may be made in the specification of a heating plant.

For instance—the highest temperatures in greenhouses are required at night, whereas with most other systems the maximum temperatures are required in the day time.

Greenhouse fires are almost always banked during the day throughout the firing season, even in mid-winter when the sun is shining; this in marked contrast to prac-



NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)


tically all other types of heating systems where the fires are banked at night.

Greenhouse radiation is almost exclusively made up of piping. The temperature demands are almost always below 70 degrees and horizontal piping carries a higher coefficient of emission than the radiating surfaces used in other systems. Special care must, therefore, be given to the selection of the boiler; the demands on it will be higher than with other forms of radiation.

The Bonded Ratings of National Boilers can be safely used in selecting boilers for greenhouses. The additional demands are compensated for by the allowance included in the ratings for piping loss, always present in buildings other than greenhouses.

Long runs of pipe are used and expansion and contraction require more consideration than in house-heating work; piping must be tied up, anchored; installations must be flexible. Although expansion joints are no more desirable in greenhouse heating than elsewhere, expansion must be compensated for by "spring" of pipe and by swivel fitted joints, expansion joints being used where expansion may not be compensated otherwise. See tables on Page 360, for data on expansion of piping.

The height of the heating coils above the boiler affects the design and proportion of the heating mains. In many greenhouses the coils are not more than 1 ft. 6 in. above the top of boiler and the arrangement of the greenhouse doors necessitates some of the coils being much shorter than others. In this case special care is necessary to avoid short circuiting, or interference with the circulation of the water in the longer coils.



NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)

Table A. Usual Temperatures Required in Greenhouses

| Kind of Vegetation | Temperature Required, Deg. Fahr. |
|-----------------------------------|----------------------------------|
| Violets..... | } 40 to 45 |
| Camelias..... | |
| Azaleas..... | |
| Lettuce..... | |
| Cool Palm Houses..... | } 50 to 55 |
| Carnations..... | |
| General Purposes..... | } 55 to 60 |
| Roses..... | |
| Mushrooms..... | |
| Forcing Houses..... | } 60 to 65 |
| Conservatories..... | |
| Orchid Houses..... | |
| Fern Houses..... | |
| Peach House..... | } 65 to 70 |
| Vinery..... | |
| Early Tomatoes and Cucumbers..... | |
| Tropical Palm House..... | |

Private greenhouses and medium size commercial greenhouses are mostly heated by hot water, and the large commercial houses by steam.

The radiation is made up of coils of pipe placed along the outside walls and under the benches.



NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)

Twenty or twenty-five years ago, it was customary to use 3 or $3\frac{1}{2}$ in. pipe for the hot-water heating coils as the large water content of this size pipe maintained a steady temperature in the houses where there was no night fireman and the gardener gave no attention to the fire during the night.

Now, in most commercial houses where hot-water heat is used, the heating coils consist of 2 in. wrought iron or steel pipe. This smaller size, holding much less water per square foot of radiation than the larger sizes, enables the fireman to raise the temperature of the house much quicker than when larger size pipe is used; and when the sun shines the house can be cooled off much quicker—which is often desirable.

For small houses and long firing periods 3 in. pipe is best. In proportioning the amount of hot-water radiation required for a greenhouse, it is almost impossible to figure the air leakage through the laps of the glass. This is not of any importance, however, for in cold weather these laps freeze and seal tight. Those that have had years of experience and specialize in greenhouse heating consider the exposed glass surface and its equivalent only and can guarantee a specified temperature by dividing the exposed glass and its equivalent by the factors in Table B, which are based on the mean temperature of the water in the coils at 150 degrees and temperature outside at zero.



NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)

Greenhouses are generally partly glass, partly other materials. To simplify computation, the brick or concrete used is reduced to *equivalent* glass—i. e., a heat loss factor is applied to find the amount of glass which would have the same heat loss as does the building material used.

To reduce 9" brick wall to equivalent glass, multiply number of square feet of wall surface by .8

To reduce 6" concrete wall to equivalent glass, multiply number of square feet of wall surface by 1.3

To reduce 8" concrete wall to equivalent glass, multiply number of square feet of wall surface by 1.14

To reduce 10" concrete wall to equivalent glass, multiply number of square feet of wall surface by 1

(Heat loss through 1 sq. ft. of 10" concrete wall is same as heat loss through 1 sq. ft. of double thick glass).

To reduce a frame wall, sheeting and clapboards on studding, to equivalent glass, multiply number of square feet of wall surface by 1

Having found the equivalent glass surface of the masonry material add it to the actual glass surface as indicated in Table B.

Greenhouse heating frequently can not be as easily and accurately figured as heating for other structures. Two greenhouses covering the same amount of ground surface may be quite different in square feet of exposed surface. The workmanship, quality of glass, and exposure to pre-

NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)

vailing cold winds must be taken into consideration. The humid atmosphere of greenhouses—and for some purposes the atmosphere is much more humid than for others, as for instance, for rose growing—at some temperatures causes the laps to seal with condensation, thus checking, or stopping the air loss through the laps. At lower temperatures, these laps are sealed with ice and at still lower temperatures, the inside surface of the glass is entirely frosted over so that its conductivity is changed. It may be much more difficult to heat a greenhouse at 15 to 25 degrees above zero with the wind blowing, than at zero or below, because at the low temperature the house may be sealed with ice, as stated.

Table B. Factors for estimating Hot Water Radiation for Greenhouses to obtain square feet of hot water pipe surface required*

| | | | | | | | | | | |
|--|----|---|----|---|---|---|---|---|---|------|
| For 70 to 75 deg. divide square feet of glass and equivalent by 2.00 | | | | | | | | | | |
| " | 65 | " | 70 | " | " | " | " | " | " | 2.28 |
| " | 60 | " | 65 | " | " | " | " | " | " | 2.62 |
| " | 55 | " | 60 | " | " | " | " | " | " | 3.00 |
| " | 50 | " | 55 | " | " | " | " | " | " | 3.46 |
| " | 45 | " | 50 | " | " | " | " | " | " | 4.00 |
| " | 40 | " | 45 | " | " | " | " | " | " | 4.67 |
| " | 35 | " | 40 | " | " | " | " | " | " | 5.50 |

*Based on average water temperature of 150°, a flow main temperature of 180°, and a 0° outside temperature.

Table B gives the factors for dividing the square feet of glass and equivalent in order to determine the square feet of hot water pipe surface. (See table Page 361 for square feet of surface in various pipe sizes). Table B factors are based on average water temperature of 150°F., a temperature in flow mains of 180°F. and outside temperature of 0°F.

NATIONAL ENGINEERING DATA

Greenhouse Heating (continued)

Table C. Factors to Multiply Figures Obtained from Table B to Determine Square Feet of Hot Water Radiation for Other Than 0° outside temperature.

| Outside Temperatures | | | |
|----------------------|------|----------------|------|
| 5 deg. above 0 | 0.92 | 5 deg. below 0 | 1.06 |
| 10 " " 0 | 0.84 | 10 " " 0 | 1.15 |
| 15 " " 0 | 0.75 | 15 " " 0 | 1.24 |
| 20 " " 0 | 0.66 | 20 " " 0 | 1.33 |
| 25 " " 0 | 0.58 | 25 " " 0 | 1.42 |
| 30 " " 0 | 0.50 | 30 " " 0 | 1.50 |
| | | 35 " " 0 | 1.58 |
| | | 40 " " 0 | 1.63 |

Tables A and B are based on the house being of ordinary sound construction and tightly glazed with double thick glass.

Position of Radiation

Greenhouses are piped in all sorts of ways to suit the great number of different ideas of greenhouse owners and operators; the location and arrangement of the piping are governed largely by the plant bench or plant bed arrangement, suiting the special requirements of the plants or flowers to be grown in the houses. In houses for vegetable growing, where planting is directly on the floor of the greenhouse, piping should be mainly, and if possible, entirely, on the sides so as to provide the maximum growing surface. For rose growing the piping should be more scattered or distributed than for any other purpose—if there are raised benches, some heating surface must be under every bench; if there are solid beds, some radiating surface must be in every walk.

The bulk of the piping for all purposes, however, should be on the side walls, or just inside the outer walls of the greenhouse. For sweet pea growing, most of the pipe surface should be on the side walls and some on the pipe columns, generally high enough to permit walking under. There is much latitude, however, in the placing of pipe coils.

Air Circulation

Recent experience shows that proper air circulation and conditioning greatly accelerates the growth of most plants and also prevents the growth of spores and moulds. This is accomplished by the use of proper mechanical apparatus for supplying and exhausting the air and for controlling its temperature and humidity.

(Compiled from the American Society of Heating and Ventilating Engineers Guide).

NATIONAL ENGINEERING DATA

Chart No. 19 Sizes of Heating Fuels

The following chart shows the standard screen round mesh (in inches) used in sizing various fuels.

| Name | Will Pass Thru | Will Not Pass Thru |
|------------------------------|----------------------------------|-----------------------------------|
| Anthracite | | |
| Broken or Grate | 4 ⁷ / ₁₆ " | 3 ⁷ / ₁₆ " |
| Egg* | 3 ⁷ / ₁₆ " | 2 ¹ / ₂ " |
| Stove | 2 ¹ / ₂ " | 1 ⁹ / ₁₆ " |
| Chestnut | 1 ⁹ / ₁₆ " | 1 ¹ / ₁₆ " |
| Pea | 1 ¹ / ₁₆ " | 1 ¹ / ₂ " |
| No. 1 Buckwheat | 5 ⁸ / ₈ " | 3 ⁷ / ₈ " |
| No. 2 Buckwheat | 3 ⁸ / ₈ " | 3 ⁷ / ₈ " |
| No. 3 Buckwheat | 3 ⁸ / ₁₆ " | 3 ¹⁶ / ₁₆ " |
| Culm—residue from screening. | | 3 ²² / ₁₆ " |

*This is classed as "Egg" in the East. In Chicago the classifications for Egg are

| | | |
|-----------|---------------------------------|---------------------------------|
| Large Egg | 4" | 2 ³ / ₄ " |
| Small Egg | 2 ³ / ₄ " | 2" |

Domestic By-Product Coke

| | | |
|-------------|---------------------------------|---------------------------------|
| Egg | 3" | 2 ¹ / ₂ " |
| Large Stove | 2 ¹ / ₂ " | 2" |
| Small Stove | 2" | 1 ¹ / ₂ " |
| Nut | 1 ¹ / ₂ " | 3 ⁴ / ₄ " |
| Pea | 3 ⁷ / ₄ " | 1 ¹ / ₂ " |

Bituminous Coal

| | | |
|---------------------------|---------------------------------|---------------------------------------|
| "Lump" or "Block" | | 6" |
| Egg | 6" | 3" |
| No. 1 Roller Screened Nut | 3 ¹ / ₂ " | 2" |
| No. 2 Roller Screened Nut | 2" | 1 ¹ / ₂ " |
| No. 3 Roller Screened Nut | 1 ¹ / ₂ " | 1" |
| No. 1 Washed Egg | 3" | 2" |
| No. 2 Washed Stove | 2" | 1 ¹ / ₄ " |
| No. 3 Washed Chestnut | 1 ¹ / ₄ " | 3 ⁴ / ₄ " |
| No. 4 Washed | 3 ⁴ / ₄ " | 1 ¹ / ₄ " |
| No. 1 Domestic Nut | 3 ⁴ / ₄ " | 1 ¹ / ₂ " or 2" |
| No. 2 Nut | 2" | 1 ¹ / ₄ " |
| No. 3 Nut | 1 ¹ / ₄ " | 3 ⁴ / ₄ " |
| Duff | 1 ⁸ / ₈ " | |

"Run of Mine"—fine and large lumps. "Screenings"—usually smallest sizes. "Pocahontas Smokeless"—generally sized as nut, egg, lump, and mine run. "Cannel Coal"—for fire places. "Hand picked lump;" for stoves, "egg".

NATIONAL ENGINEERING DATA

Weights of Various Fuels

The weight per cubic foot of various fuels is as follows:

| | |
|-----------------|-----------|
| Anthracite..... | 52.5 lbs. |
| Bituminous..... | 45 " |
| Coke..... | 28 " |

The above weights can be used in determining the size of fuel bin required to store a pre-determined quantity. For example: If a heating system requires 20 tons of coal per season and it is desired to provide a fuel bin for the entire season's requirements, the cubical storage space can be computed as follows:

Divide the 40,000 lbs. (20 tons) by 52.5 pounds (the weight of 1 cu. ft. of anthracite) = 76.1 cu. ft. of space.

Firing Various Types of Fuel

Anthracite. Best results are obtained from anthracite when a deep bed of fuel is maintained at all times, even in mild weather. Infrequent, heavy fuel charges is the best and easiest method to follow. In mild weather, ashes should be allowed to accumulate on the grate to reduce the amount of air passing through the fuel bed and to assist in maintaining the temperature in the fire



NATIONAL ENGINEERING DATA

Firing Various Fuels (continued)

box required for combustion. An anthracite fire should never be disturbed from the top because this interferes with combustion, causes draft holes and clinkers and tends to bring the ash to the surface of the fuel bed. Grates should be shaken with short, quick strokes which will sift the ashes through the grates without undue loss of fuel. The fire should not be checked by opening the fire door, because this chills the gases and interferes with combustion.

Grate Size Anthracite—on account of the size of the lump—can not be burned successfully in house heating boilers because of large air spaces between the lumps. In an emergency, however, it can be utilized when mixed with pea coal or buckwheat. These smaller sizes of coal fill the spaces between the lumps, thus forming a mass of burning fuel and preventing excessive air passage through the fuel bed. Grate size anthracite can be used in boilers with large fire boxes alone or mixed with smaller sizes.

Egg Size Anthracite should only be used in large fire pots, 25" and over, and where a deep fuel bed can be maintained. Improved results can be obtained by mixing it with smaller sizes of anthracite, as explained in the preceding paragraph.



NATIONAL ENGINEERING DATA

Firing Various Fuels (continued)

Stove Size Anthracite is the most popular size for domestic heating boilers. It is small enough to burn successfully in the smallest house heating boilers and large enough to permit carrying a deep fire without danger of the coal packing so closely that the air necessary for combustion is prevented from flowing through the fuel bed.

Chestnut Size Anthracite should be used in fire pots up to 20" in diameter and particularly in boilers which have a shallow fire box.

Pea Size Anthracite is an economical fuel to burn as it is relatively low in price.

A grate with fine mesh should be used in boilers to prevent loss of fuel through the grate. If regular grates with coarse mesh are used, care must be exercised in shaking the grates; otherwise, there will be an undue loss of fuel through the mesh. In starting a new fire on coarse grates, it will be found advantageous to mix chestnut or stove size anthracite with the pea coal until sufficient ash has been accumulated on the grates to hold the pea coal in the fire box.

A fire box should be only partially filled with pea coal; otherwise insufficient air will pass through the fuel bed,



NATIONAL ENGINEERING DATA

Firing Various Fuels (continued)

due to the compactness of this type of fuel. Pea coal requires a stronger chimney draft than larger sizes.

Buckwheat Size Anthracite requires the same attention as pea coal and is not recommended, excepting where fine mesh grates are used and a strong chimney draft exists.

A small blower to provide an induced draft will be found advantageous in connection with the use of buckwheat size coal.

Coke—Coke is fast becoming popular as a domestic fuel. It burns rapidly and requires less draft than anthracite. In order to control the burning of coke, it is important that all openings or leaks in the ash pit should be tightly closed. A deep bed of coke should be maintained at all times and a boiler with a deep fire bed should be selected when coke is to be used as fuel.

Grates should be shaken with short, sharp strokes and in mild weather a bed of ashes should be allowed to remain on the grates to assist in checking the fire. The best size of coke for house heating boilers is the size which will pass over a 1-inch screen and through a 1½-inch screen.

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS



NATIONAL ENGINEERING DATA

Firing Various Fuels (continued)

Bituminous Coal—Bituminous coal should never be fired over the entire fuel bed at one time. A portion of freely-burning coal should be left exposed to ignite the gases distilled from the new fuel charges. Air should be admitted over the fire through a special secondary air device or slide door. Before firing a new charge, the burning coal should be pushed back, leaving a depression in the fire box to receive the new charge. The fuel bed of burning coal should be carried as deep as possible, in order to have as much coked fuel as possible. A deep fuel bed obtains the longest firing intervals. The boiler output obtained when burning bituminous coal will generally exceed the output of a boiler where anthracite coal is used. Bituminous coal, however, requires frequent attention because of its free and rapid burning qualities.

Proportions of average Fuel Consumption by Months — Vicinity of New York

Calculations over a period of 33 years

| | | |
|---------------|--------|------------------|
| October..... | 7.98 | per cent of fuel |
| November..... | 12.96 | “ “ “ “ |
| December..... | 17.07 | “ “ “ “ |
| January..... | 19.01 | “ “ “ “ |
| February..... | 18.18 | “ “ “ “ |
| March..... | 14.87 | “ “ “ “ |
| April..... | 9.93 | “ “ “ “ |
| TOTAL | 100.00 | per cent |

NATIONAL MADE-TO-MEASURE HEATING SYSTEMS

Pipe Welding

THE welding of steam pipes is rapidly coming into general practise. It lowers the cost of installation where large pipes are required and materially reduces the weight.

Welding is practicable and economical for all sizes of pipes 2" and larger. The facility with which both regular and unusual fittings may be welded from pieces or ends of straight pipe is particularly advantageous both from the viewpoints of appearance and economy. The saving of time lost in waiting for deliveries of special fittings is also a factor in favor of the welding process.

Welding requires an experienced and skilled mechanic, since the welded joint must become homogeneous with the metal of the adjacent pipes. Welded joints properly made are stronger than pipe of corresponding size and possess greater strength than cast iron fittings.

The equipment required is inexpensive and consists merely of the torch with suitable welding and cutting tips of assorted sizes, with gas regulators and gauges for tank connections and suitable lengths of pressure hose. A two-wheel truck to hold the gas tanks is also desirable.

Welding is facilitated by the use of pattern charts obtainable from one of the principal sources of oxygen and acetylene gas supply.

Directions for Cleaning Boilers

THE boiler and system must be cleansed, as grease, oil and foreign matter prevents steaming, and causes foaming and an unsteady water line. Each National boiler is provided with a tapping for skimming oil and grease from the surface of the water; this tapping is termed the "skimmer tapping". In sectional boilers (excepting Low Water Line Series) it is located in the front section in a line with the upper nipple ports. The "skimmer tapping" is located in the end section of Low Water Line Boilers in a line with the upper nipples. In round boilers it is located in the steam dome section near the water line. By removing the plug from the skimmer tapping and attaching a nipple and a gate valve thereto the boiler can be thoroughly boiled out and all grease and oil skimmed from the surface of the water.

To do this shut off the valve (if there is one) connecting the return main to the boiler and maintain the water in the boiler at boiling temperature and at the level of the skimmer tapping. As the water boils out through this opening replace it with fresh water, always maintaining the water level up to the skimmer tapping. Continue this operation until the water emitted from the skimmer tapping runs clean and clear. (This may require a number of hours or even an entire day.) Then close the valve on the connection to skimmer tapping and the valves on the steam main or the supply valve on every radiator if the mains are not valved. Raise the pressure in the boiler to about 10 lbs. and blow the boil-



NATIONAL ENGINEERING DATA

Cleaning Boilers (continued)

er down completely through the blow-off connection at the bottom and rear of the boiler. Dump the fire immediately and allow the boiler to cool. This operation should clear the boiler of all solid matter.

It is also necessary to thoroughly cleanse the entire heating system of grease, filings, and foreign matter. This is accomplished by refilling the boiler, after it has cooled, with clean fresh water and raising several pounds of steam pressure. Circulate steam through the entire system under boiler pressure and dump the returns into the sewer without allowing them to come back into the boiler. For this purpose a tee should be placed in the return line to boiler ahead of a cut-off valve so that the returns may be dumped into the sewer without entering the boiler. During this operation feed fresh water constantly into the boiler so that an even water line is maintained. Continue the operation until the returns from the system which are dumped into the sewer run clean and clear. Foreign matter in the heating system will accumulate in the boiler if the system is not cleaned out.

The above cleaning operations are absolutely necessary in order to obtain satisfactory results and should be repeated from time to time until both the boiler and the heating system are thoroughly cleaned and free from all trace of grease, oil and foreign matter.

The importance of properly and thoroughly cleaning steam and vapor systems of oil and grease can not be emphasized too strongly.